

ADDENDA E-2

The information listed below is to form part of the Contract Documents. All associated costs are to be included in Tender Price shown on Tender Form. Acknowledgment of this Addendum, by number, to be shown in space provided on Tender Form.


1 DRAWINGS

1.1 E200 – Electrical Power and Systems Plan (re-issued)

- .1 Provide I-Star ultra door controller and associated power/data provisions in 'Closet B112B' as shown on the attached drawing.

END OF ADDENDUM

END OF SECTION

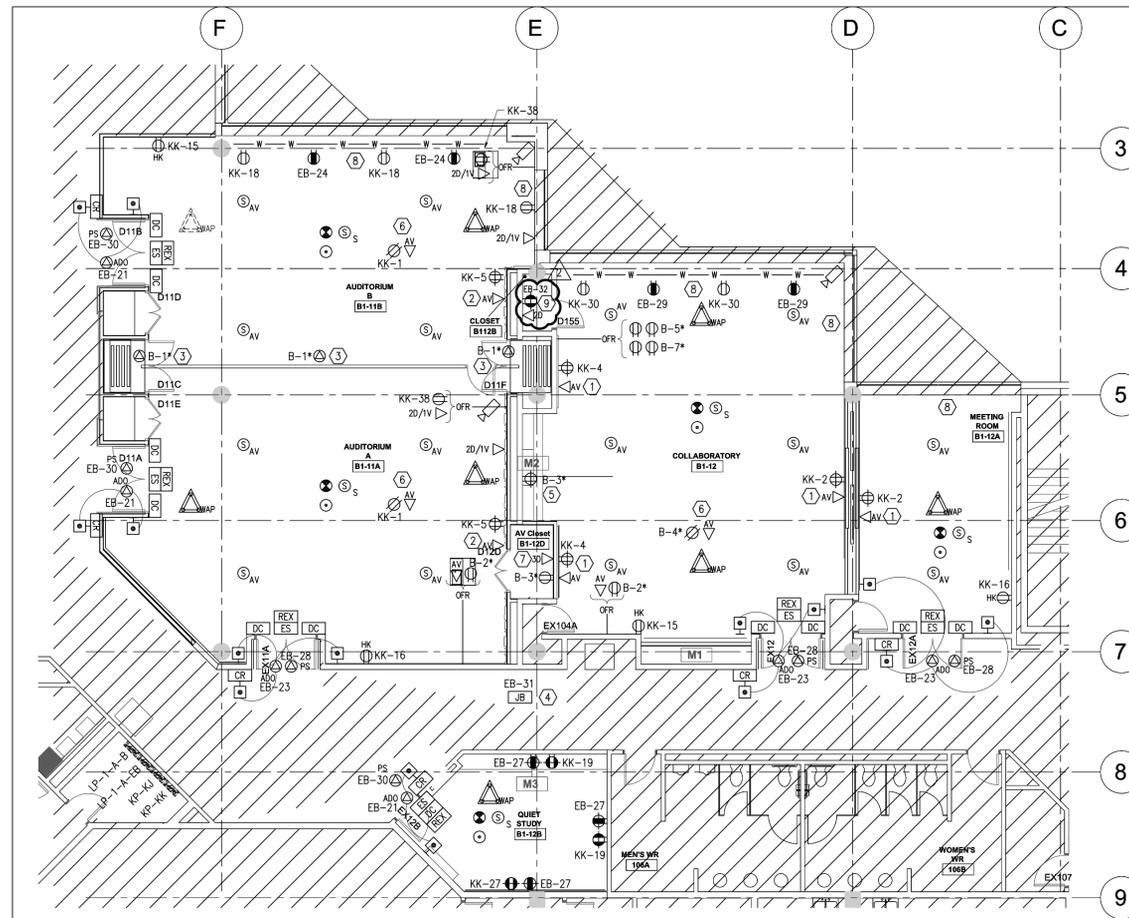

2 LEVEL 1 PARTIAL FLOOR PLAN - ELECTRICAL POWER AND SYSTEMS PROPOSED PLAN
E200 SCALE: 1:100


DRAWING NOTES:

- 15/20A, 120V, 1Ø RECEPTACLE AND EMPTY CONDUIT FOR SHORT-THROW PROJECTOR. PROVIDE EMPTY CONDUIT C/W PULL STRING BACK TO CLOSET B112B.
INSTALL RECEPTACLE AND BLANK FACEPLATE FOR CONDUIT ON WALL NEAR FINISHED CEILING HEIGHT. COORDINATE EXACT HEIGHT WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.
- 20A, 120V, 1Ø RECEPTACLE AND DATA FOR VIDEO CONFERENCE SCREEN. COORDINATE EXACT MOUNTING HEIGHT WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.
- 20A, 120V, 1Ø DIRECT CONNECTION FOR MOTORIZED PARTITION. COORDINATE ELECTRICAL REQUIREMENTS WITH PARTITION SUPPLIER.
- 20A, 120V, 1Ø DIRECT CONNECTION FOR MECHANICAL V.A.V. BOXES.
- INSTALL RECEPTACLE AT 42" A.F.F. COORDINATE EXACT LOCATION WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.
- 15/20A, 120V, 1Ø CEILING-MOUNTED RECEPTACLE AND EMPTY CONDUIT FOR PROJECTOR. PROVIDE EMPTY CONDUIT C/W PULL STRING BACK TO AV CLOSET B1-12D. PROVIDE BLANK FACEPLATE FOR EMPTY CONDUIT ON FINISHED CEILING. COORDINATE EXACT LOCATION WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.
- PROVIDE CAT6 CABLING FROM THIS LOCATION BACK TO I.T. CLOSET E/E2 WITH LOCATION SHOWN ON DRAWING E100.
- PROVIDE 3/4" EMPTY EMT CONDUIT FROM THIS WINDOW LOCATION BACK TO LOCAL AV. CLOSET SHOWN ON THIS DRAWING. CONDUIT FOR FUTURE MOTORIZED ROLLER SHADES.
- PROVIDE 1-STAR DOOR CONTROLLER PANEL C/W DOUBLE DUPLEX RECEPTACLE AND DATA DROP AS SHOWN. COORDINATE EXACT LOCATION WITH OWNER/ARCHITECT PRIOR TO INSTALLATION.

GENERAL NOTES:

- PROVIDE NEW 20A-1P SIEMENS RETROFIT BREAKERS IN EXISTING I.T.E. PANELS IN SCOPE FOR ALL CIRCUITS SHOWN ON THIS DRAWING. ENSURE NEW BREAKERS ARE COMPATIBLE WITH EXISTING I.T.E. PANELS SHOWN.
- CIRCUITS MARKED WITH '1' SUFFIX ARE DIAGRAMMATIC ONLY. UTILIZE SPACE IN APPROPRIATE PANEL THAT HAS BEEN FREED UP AS A RESULT OF THE DEMOLITION WORK SHOWN ON DEMOLITION DRAWING E100. PROVIDE NEW 20A-1P SIEMENS RETROFIT BREAKERS FOR THESE CIRCUITS.
- PROVIDE FOR AN ADDITIONAL TEN (10) SPARE RECEPTACLES IN THE BASE CONTRACT. RECEPTACLES SHALL BE 120V, 15/20A T-SLOT RECEPTACLES EACH COMPLETE WITH 3/4" EMT CONDUIT AND 2 #8 AWG + GND WIRE WITH A DISTANCE OF 175'.
- PROVIDE FOR AN ADDITIONAL FIVE (5) RUNS OF EMPTY 1" EMT CONDUIT. EACH RUN SHALL BE 100'.

1 POWER AND SYSTEMS DRAWING NOTES
E200 SCALE: N/A




GOW HASTINGS ARCHITECTS

275 SPADINA ROAD
TORONTO ONTARIO M5R 2V3
416-920-0031
GOWHASTINGS.COM

ALL DRAWINGS, SPECIFICATIONS, RELATED DOCUMENTS AND DESIGN ARE THE COPYRIGHT PROPERTY OF THE ARCHITECT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF THIS DRAWING, SPECIFICATIONS, RELATED DOCUMENTS AND DESIGN WHOLE OR IN PART IS STRICTLY FORBIDDEN WITHOUT THE ARCHITECT'S WRITTEN PERMISSION. THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNLESS COUNTERSIGNED.



HH Angus
HH Angus & Associates Limited Consulting Engineers
1127 Leslie Street, Toronto, ON, M3C 2J6 Canada
www.hhangus.com | T 416 443 8200 | F 416 443 8290



KEY PLAN

4. ISSUED FOR ADDENDUM #E2 2019/07/02
3. ISSUED FOR TENDER 2019/06/07
2. REVISION TO PERMIT 2019/05/17
1. ISSUED FOR ADDENDUM #E1 2019/05/09

No.	ISSUED/REVISED	DATE
-----	----------------	------

SJHC LEARNING CENTRE

30 THE QUEENSWAY
TORONTO, ON M6R 1B5

ELECTRICAL POWER AND SYSTEMS PLAN

Scale: As Indicated
Project Number: 2161346
Drawn By:
Checked By:

E200