

ELECTRICAL HEATER SCHEDULE									
TAG NO.	SERVICE	MANUFACTURER/ MODEL NO.	CAPACITY OUTPUT (KW)	V/Ph/Hz	WEIGHT (KG)	FAN		NOTES	
FAH-01	BARRIER FREE WASHROOM - 111	OUELLET OACP2000	2	240/1/60	10.9	POWER (KW)	FLOW (LPS)	PROVIDE DISCONNECT SWITCH AND BUILT-IN THERMOSTAT	
						-	75		

EXHAUST FAN SCHEDULE									
TAG NO.	SERVICE	MANUFACTURER/ MODEL NO.	CAPACITY (LPS)	S.P. (Pa)	FAN		MOTOR		NOTES
					TYPE	HP	RPM	V/Ph/Hz	
EF-01	BARRIER FREE WASHROOM - 111	GREENHECK MODEL SP-B110ES	40	93	CEILING FAN, DIRECT DRIVE	0.04	-	115/1/60	CONTROLLED BY LIGHT SWITCH, C/W EXHAUST GRILLE, DISCONNECT SWITCH, BACKDRAFT DAMPER, ROUND DUCT CONNECTOR

E

CLIENT

CITY OF TORONTO



Corporate Real Estate Management  
Project Management Office  
Metro Hall Toronto, ON  
M5V 3C6

**COPYRIGHT**  
This drawing has been prepared solely for the intended use. Thus any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

**IBI Group Professional Services (Canada) Inc.**  
is a member of the IBI Group of companies

ISSUES		
No.	DESCRIPTION	DATE
A	50% SUBMISSION	2021-09-23
B	90% SUBMISSION	2022-01-04
C	ISSUED FOR PERMIT	2022-01-04
D	ISSUED FOR TENDER	2022-11-01
E	ADDENDUM-01	2022-11-25

CONSULTANTS

SEAL

PRIME CONSULTANT



IBI GROUP

175 Galaxy Blvd, Unit 100  
Toronto, ON M9W 0C9, Canada  
tel 416 679 1930 fax 416 675 4620  
ibigroup.com


PROJECT TITLE  
CITY OF TORONTO  
ACCESSIBILITY UPGRADES

PROJECT ADDRESS  
  
FIRE HALL NO. 227  
1904 QUEEN ST. E.


PROJECT NO: 122260	
DRAWN BY: K.DURUKAN	CHECKED BY: B.LIAO
PROJECT MGR: F.BOLOURIAN	APPROVED BY: S.LIU

SHEET TITLE  
EQUIPMENT SCHEDULE

SHEET NUMBER G28-103-M0201	ISSUE E
-------------------------------	------------

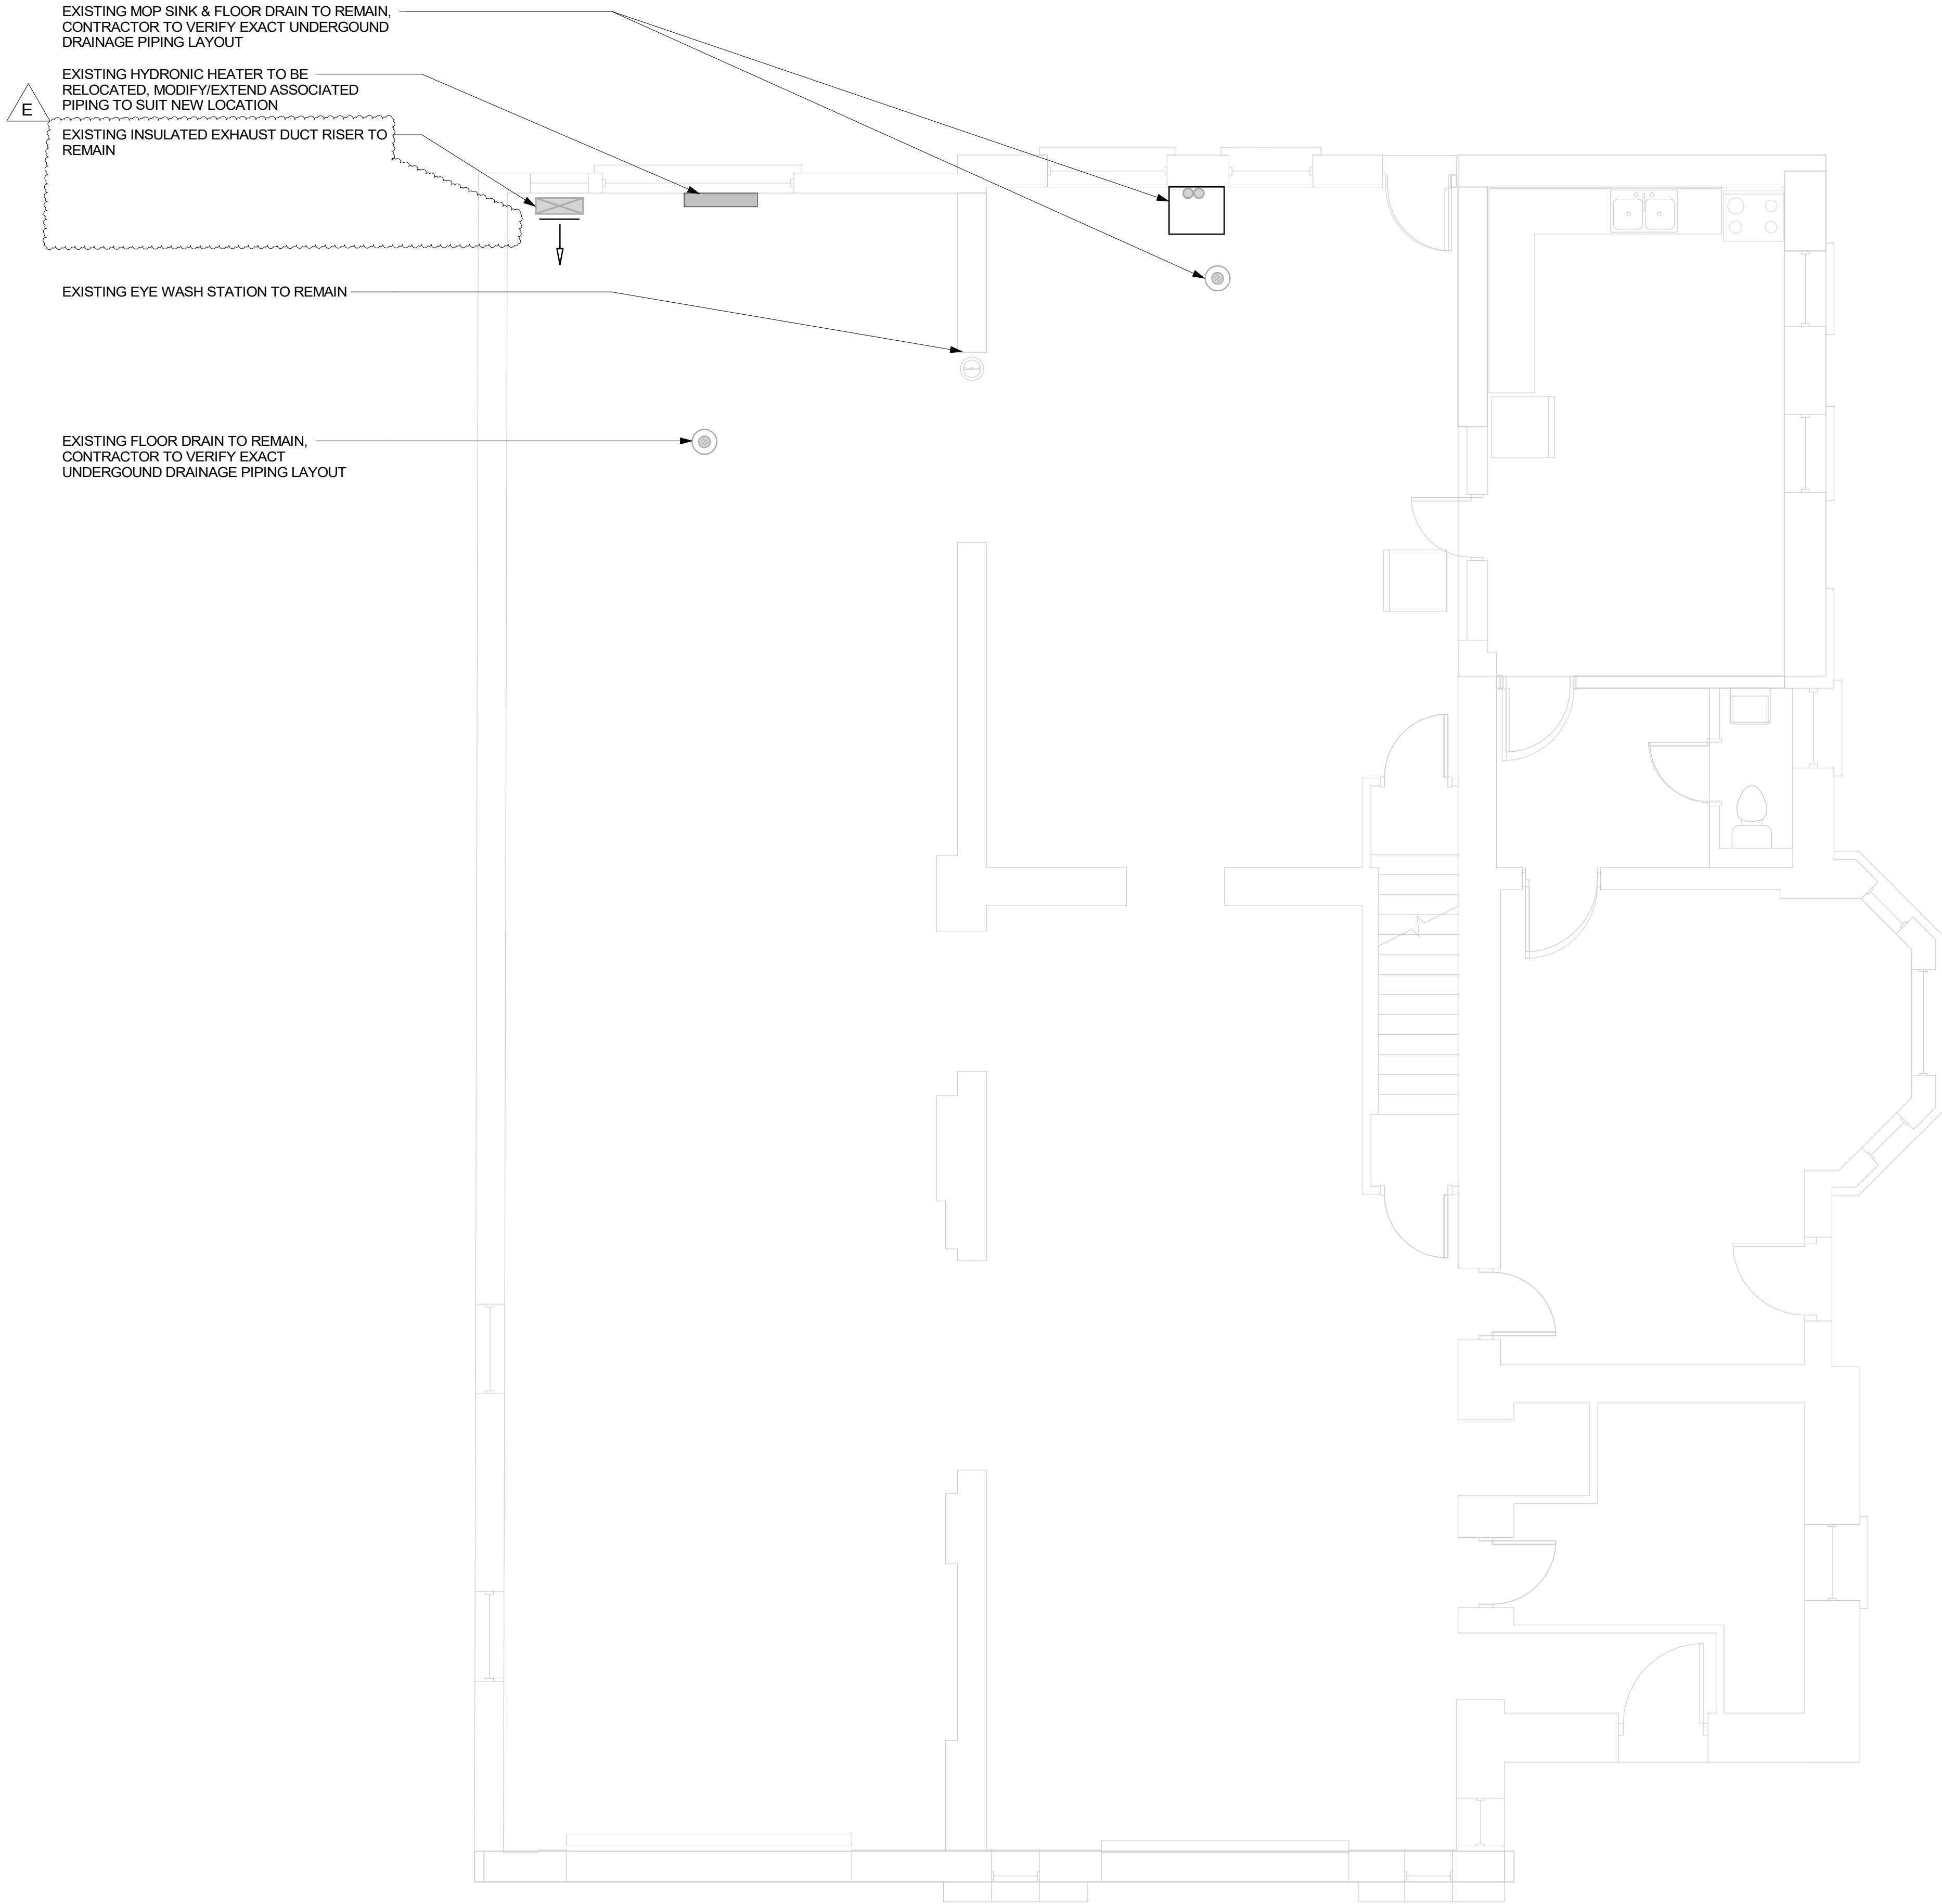

- GENERAL NOTES:
1. CONTRACTOR TO VERIFY SITE CONDITION.
  2. REMOVE AND CAP EXISTING SERVICES AS SHOWN ON THE DRAWING.
  3. ALL EXISTING SERVICES SHALL REMAIN UNLESS OTHERWISE NOTED.



2022-11-21 3:25:35 PM



CLIENT

CITY OF TORONTO



Corporate Real Estate Management

Project Management Office

Metro Hall Toronto, ON

M5V 3C6

COPYRIGHT

This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.

is a member of the IBI Group of companies

ISSUES

No.	DESCRIPTION	DATE
A.	50% SUBMISSION	2021-09-23
B	90% SUBMISSION	2022-01-04
C	ISSUED FOR PERMIT	2022-01-04
D	ISSUED FOR TENDER	2022-11-01
E	ADDENDUM-01	2022-11-25

CONSULTANTS

SEAL

PRIME CONSULTANT



IBI GROUP

175 Galaxy Blvd, Unit 100

Toronto, ON M5W 0C9, Canada

tel 416 679 1930 fax 416 675 4620

ibigroup.com

PROJECT TITLE

CITY OF TORONTO

ACCESSIBILITY UPGRADES

PROJECT ADDRESS

FIRE HALL NO. 227

1904 QUEEN ST. E.

PROJECT NO:

122260

DRAWN BY:

K.DURUKAN

CHECKED BY:

B.LIAO

PROJECT MGR:

F.BOLOURIAN

APPROVED BY:

S.LIU

SHEET TITLE

DEMOLITION PLAN -

GROUND FLOOR

SHEET NUMBER


G28-103-M1101

ISSUE

E

BIM 360//122260 - CoT TAU Upgrades R2020122260-TAU-28-103-1904QUEEN-M-F201.rvt  
11m

2022-11-21 3:25:35 PM




PROVIDE NEW 200 DCW & 130 DHW LINES SERVING NEW WASHROOM, CONNECT FROM EXISTING DCW & DHW MAIN LINES SERVING EXISTING MOP SINK. CONTRACTOR SHALL VERIFY EXACT MAIN LINES LOCATION ON SITE. C/W SHUT-OFF VALVES FOR NEW WASHROOM BRANCH LINES


PROVIDE LAV C/W 130 DCW & DHW LINES

PROVIDE NEW TANK TYPE WC C/W 200 DCW LINE

EXISTING EYE WASH STATION TO REMAIN

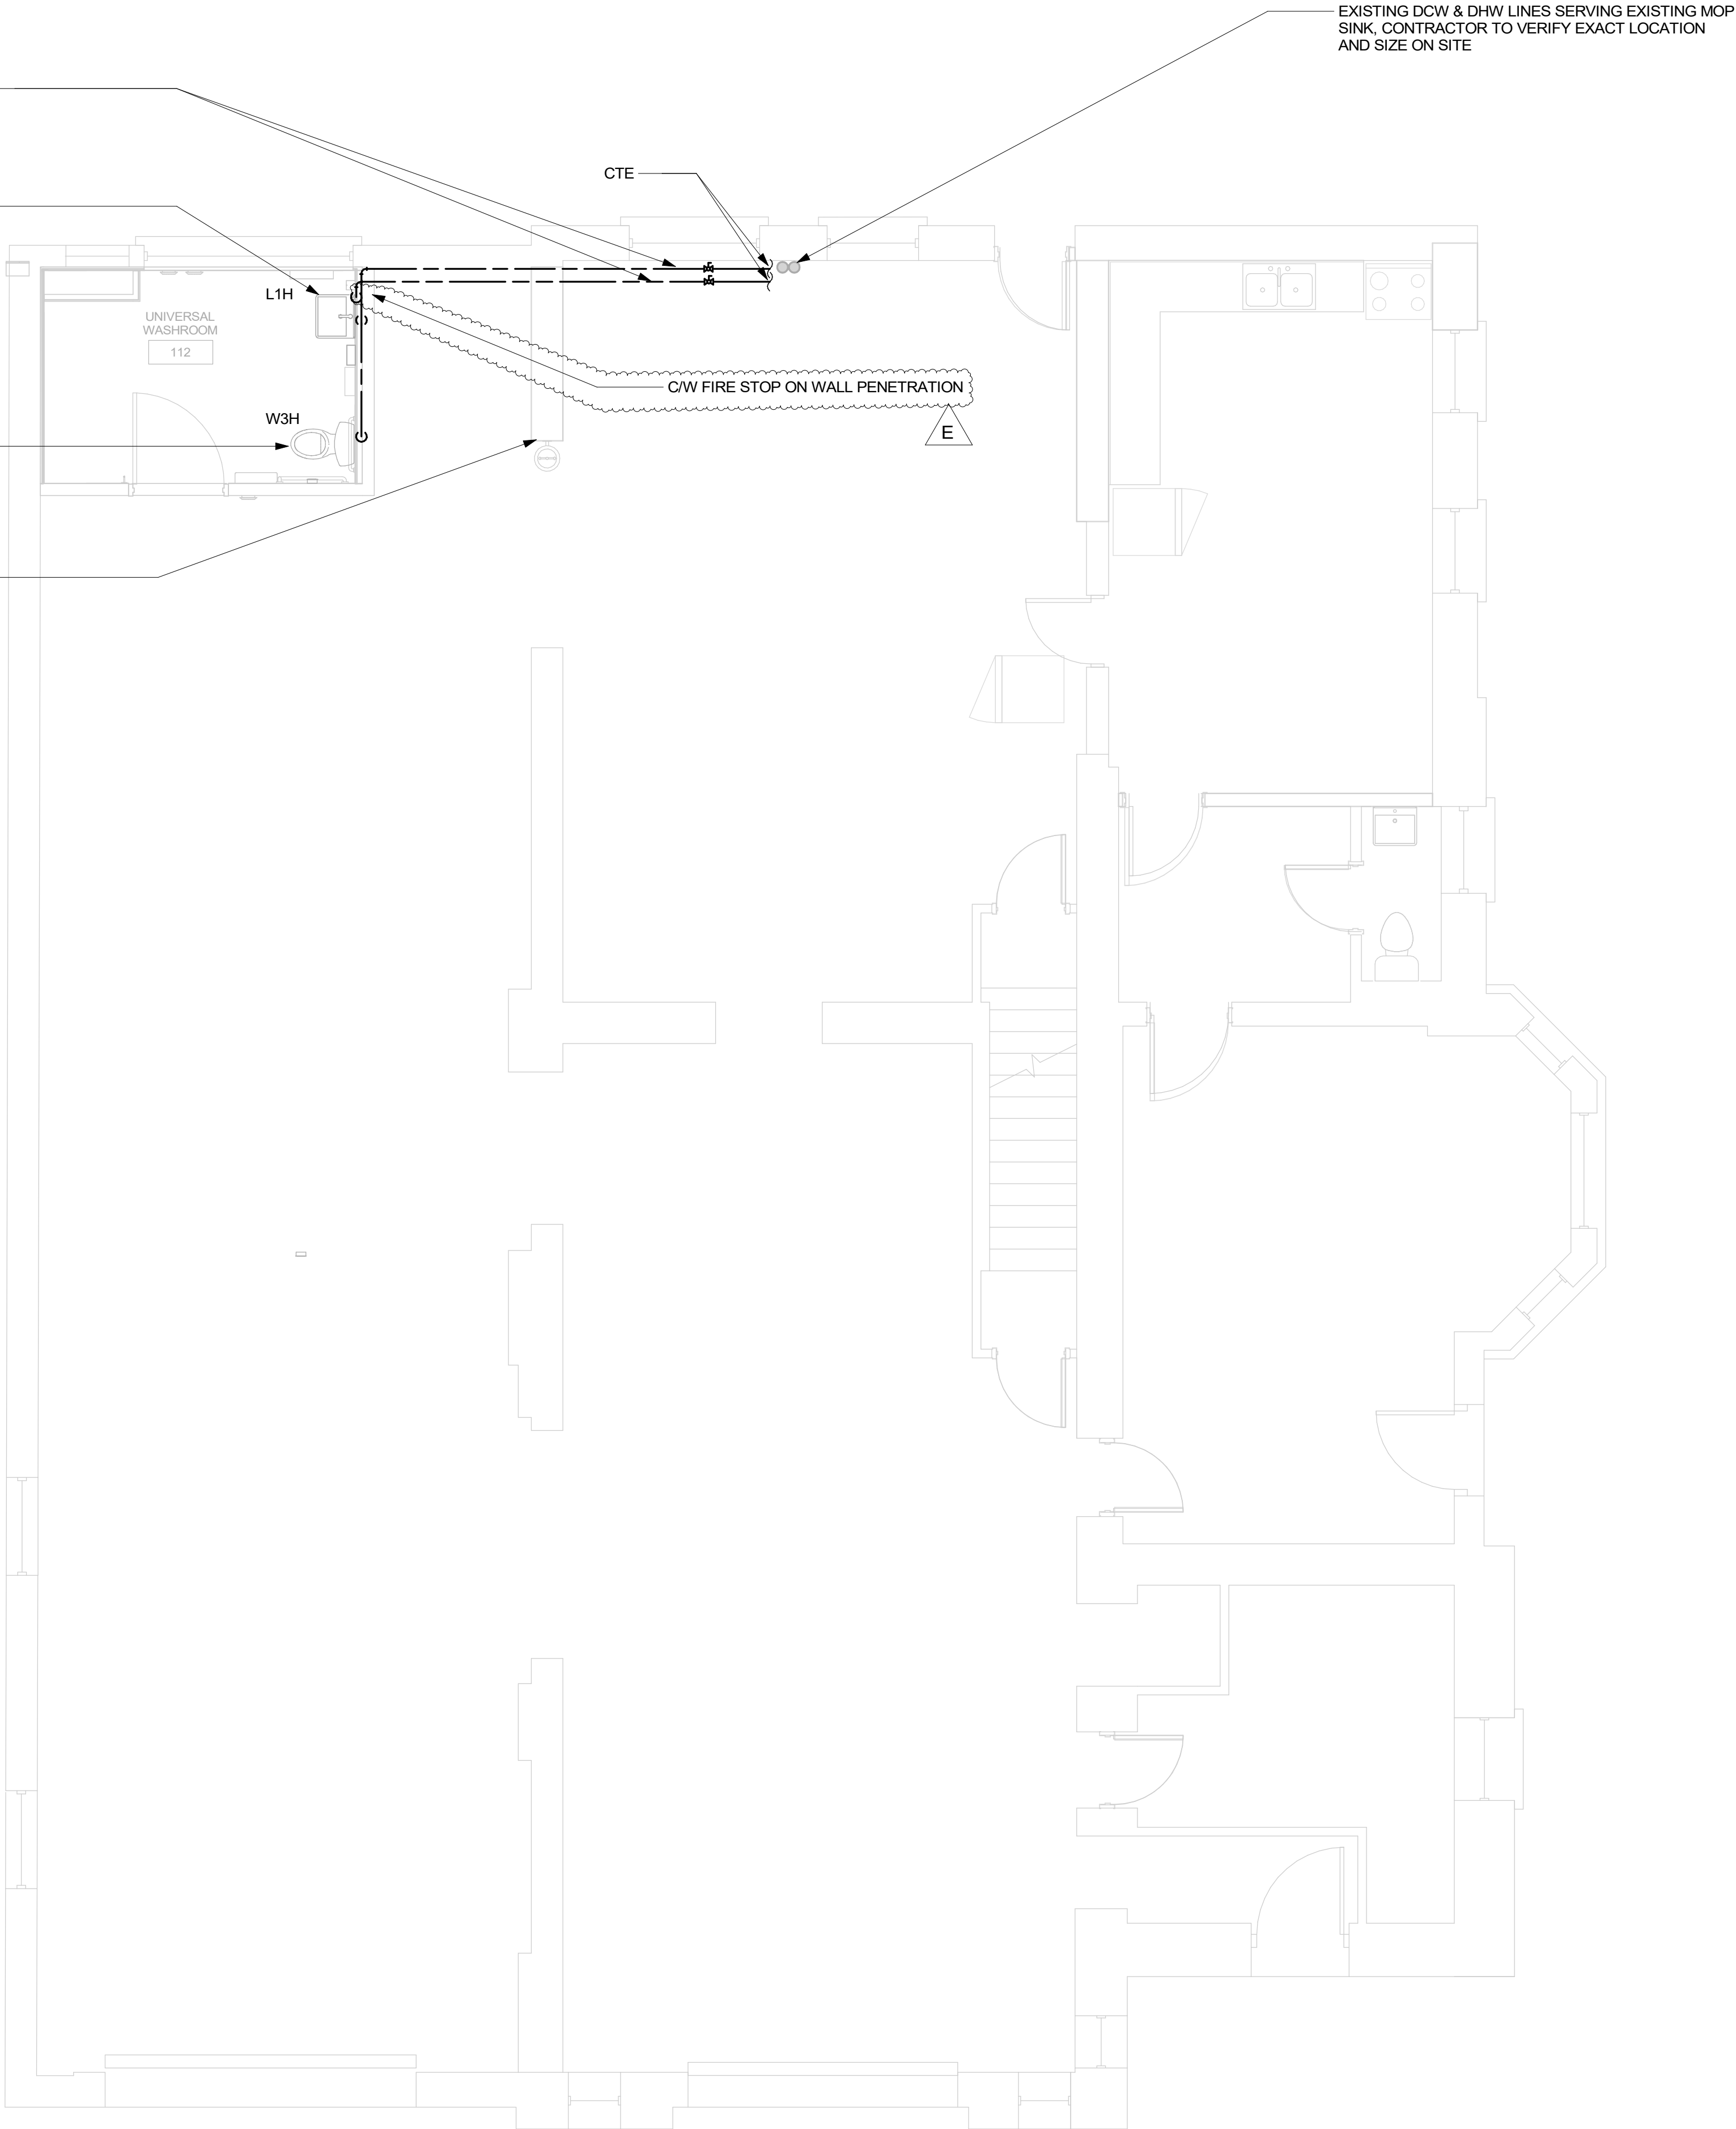

- GENERAL NOTES:
- REFER TO SPECIFICATIONS FOR PLUMBING FIXTURE UNIT TYPES.
  - ALL NEW FIXTURES TO BE FITTED WITH ISOLATION VALVES.



CLIENT

**CITY OF TORONTO**

Corporate Real Estate Management  
Project Management Office  
Metro Hall Toronto, ON  
MSV 3C6

**COPYRIGHT**  
This drawing has been prepared solely for the intended use. No reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

**IBI Group Professional Services (Canada) Inc.**  
is a member of the IBI Group of companies

ISSUES		
No.	DESCRIPTION	DATE
A	50% SUBMISSION	2021-09-23
B	90% SUBMISSION	2022-01-04
C	ISSUED FOR PERMIT	2022-01-04
D	ISSUED FOR TENDER	2022-11-01
E	ADDENDUM-01	2022-11-25

CONSULTANTS

SEAL

PRIME CONSULTANT

**IBI GROUP**  
175 Galaxy Blvd, Unit 100  
Toronto, ON M5W 0C9, Canada  
tel 416 679 1930 fax 416 675 4620  
ibigroup.com

PROJECT TITLE  
**CITY OF TORONTO  
ACCESSIBILITY UPGRADES**


PROJECT ADDRESS  
**FIRE HALL NO. 227  
1904 QUEEN ST. E.**

PROJECT NO: 122260	
DRAWN BY: <b>K.DURUKAN</b>	CHECKED BY: <b>B.LIAO</b>
PROJECT MGR: <b>F.BOLOURIAN</b>	APPROVED BY: <b>S.LIU</b>


SHEET TITLE  
**PLUMBING - GROUND  
FLOOR**

SHEET NUMBER <b>G28-103-M2101</b>	ISSUE <b>E</b>
--------------------------------------	-------------------

BIM 360/122260 - CoT TAU Upgrades R2020122260-TAU-28-103-1904QUEEN-M-F201.rvt  
1 mm



- GENERAL NOTES:
1. ADD AND ADJUST DUCTS TO FIT NEW DIFFUSERS/GRILLES.
  2. THERMOSTATS TO BE MOUNTED AT 1200mm A.F.F.



2022-11-21 3:25:35 PM



CLIENT

**CITY OF TORONTO**

Corporate Real Estate Management  
Project Management Office  
Metro Hall Toronto, ON  
M5V 3C6

**COPYRIGHT**  
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

**IBI Group Professional Services (Canada) Inc.**  
is a member of the IBI Group of companies

ISSUES		
No.	DESCRIPTION	DATE
A	50% SUBMISSION	2021-09-23
B	90% SUBMISSION	2022-01-04
C	ISSUED FOR PERMIT	2022-01-04
D	ISSUED FOR TENDER	2022-11-01
E	ADDENDUM-01	2022-11-25

CONSULTANTS

SEAL

PRIME CONSULTANT

**IBI GROUP**  
175 Galaxy Blvd, Unit 100  
Toronto, ON M9W 0C9, Canada  
tel 416 679 1930 fax 416 675 4620  
ibigroup.com

PROJECT TITLE  
**CITY OF TORONTO  
ACCESSIBILITY UPGRADES**

PROJECT ADDRESS

**FIRE HALL NO. 227  
1904 QUEEN ST. E.**

PROJECT NO:  
122260

DRAWN BY:  
**K.DURUKAN**

CHECKED BY:  
**B.LIAO**

PROJECT MGR:  
**F.BOLOURIAN**

APPROVED BY:  
**S.LIU**

SHEET TITLE  
**HVAC - GROUND FLOOR**

SHEET NUMBER

**G28-103-M5101**

ISSUE

**E**

BIM 360//122260 - CoT TAU Upgrades R2020122260-TAU-28-103-1904QUEEN-M-F201.rvt 1/11