




**AA PRIMARY POWER CABLES DUCTBANK**  
 E-901 TYPICAL ARRANGEMENT FOR PROVISIONAL DUCTBANK Scale NTS

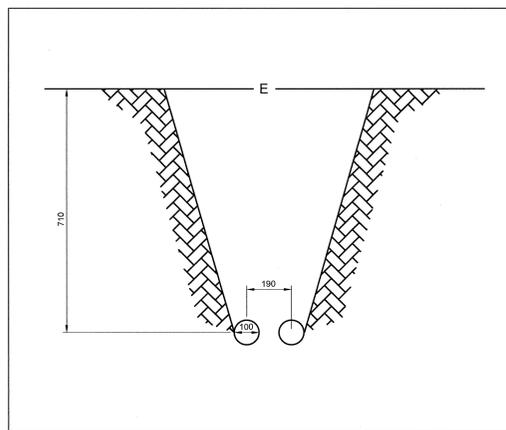


**BB COMMUNICATION CABLES DUCTBANK**  
 E-901 Scale NTS

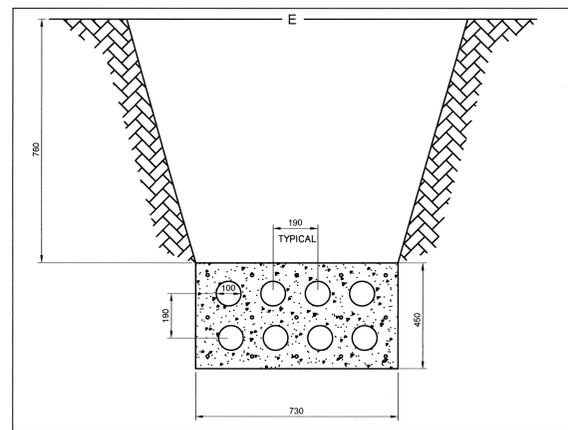

**CC SECONDARY POWER CABLES DUCTBANK**  
 E-901 Scale NTS

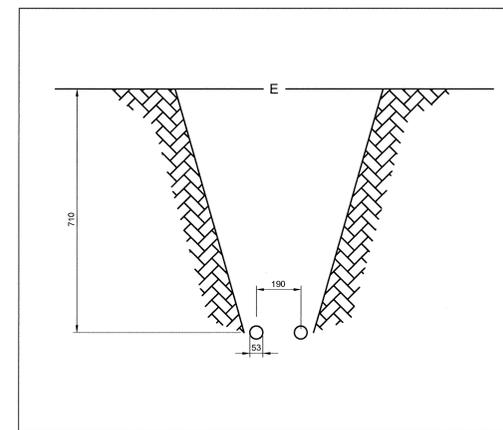


**DD BIOFILTER/GENERATOR DUCTBANK TYP.**  
 E-901 Scale NTS

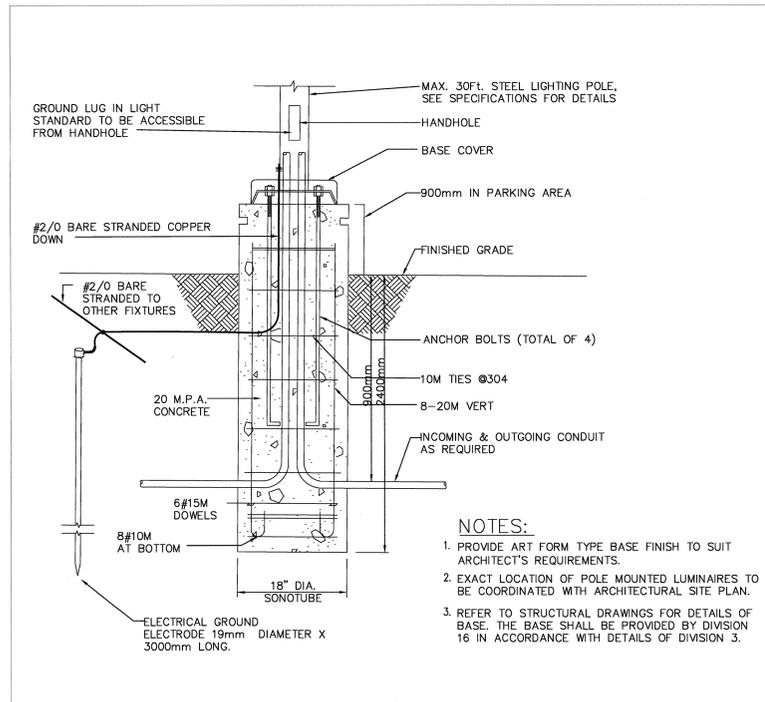

**1 LAMP POST FOOTING DETAIL**  
 E-901 NTS

- NOTES:**
1. PROVIDE ART FORM TYPE BASE FINISH TO SUIT ARCHITECT'S REQUIREMENTS.
  2. EXACT LOCATION OF POLE MOUNTED LUMINAIRES TO BE COORDINATED WITH ARCHITECTURAL SITE PLAN.
  3. REFER TO STRUCTURAL DRAWINGS FOR DETAILS OF BASE. THE BASE SHALL BE PROVIDED BY DIVISION 16 IN ACCORDANCE WITH DETAILS OF DIVISION 3.

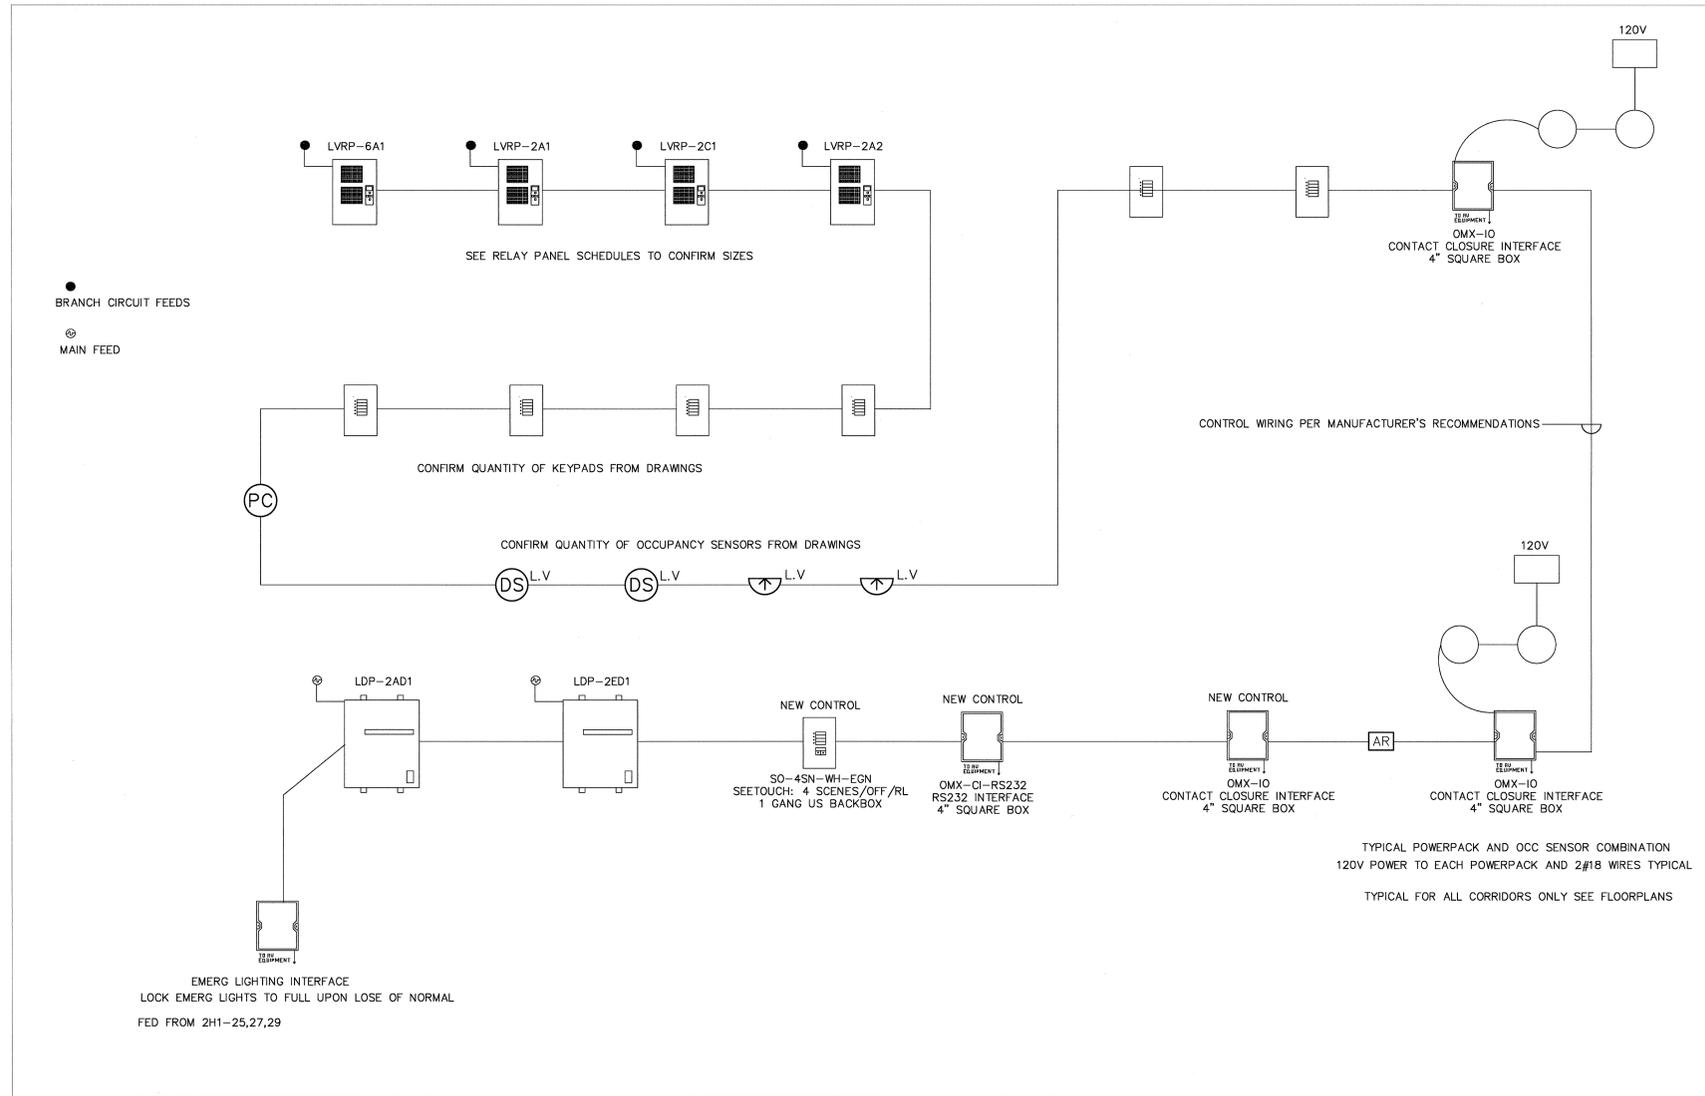

**2 LIGHTING CONTROL SCHEMATIC**  
 E-901 NTS



York Regional Police Training Facility

**AECOM**  
 AECOM Canada Architects Limited  
 105 Commerce Valley Drive West  
 Markham, Ontario  
 905.886.7022 tel 905.886.9494 fax  
 www.aecom.com

**PARKIN**  
 ARCHITECTS LIMITED  
 PARKIN Architects Limited  
 1 Valleybrook Drive  
 Toronto, Canada  
 416.467.8000 tel 416.467.8001 fax  
 www.parkin.ca



**ISSUE/REVISION**

NO.	DATE	DESCRIPTION
2	15-05-06	ISSUED FOR CONSTRUCTION
1	14-11-27	ISSUED FOR BID
1/R		

**KEY PLAN**

PROJECT NUMBER  
 60312302

SHEET TITLE  
 STANDARD SITE PLAN DETAILS

SHEET NUMBER  
 E-901