




GENERAL INFORMATION:

PROJECT ID	DAD	TESTED BY:	AA/RS
PROJECT NAME	Dixie	DATE	Oct 12-23
BUILDING ADDRESS	Dixie and Docksteader Brampton, Ontario	TIME	11:30:00 PM

WATER MAIN INFORMATION:

MAIN SIZE / MATERIAL	NA
CONFIGURATION	Looped

HYDRANT LOCATION:

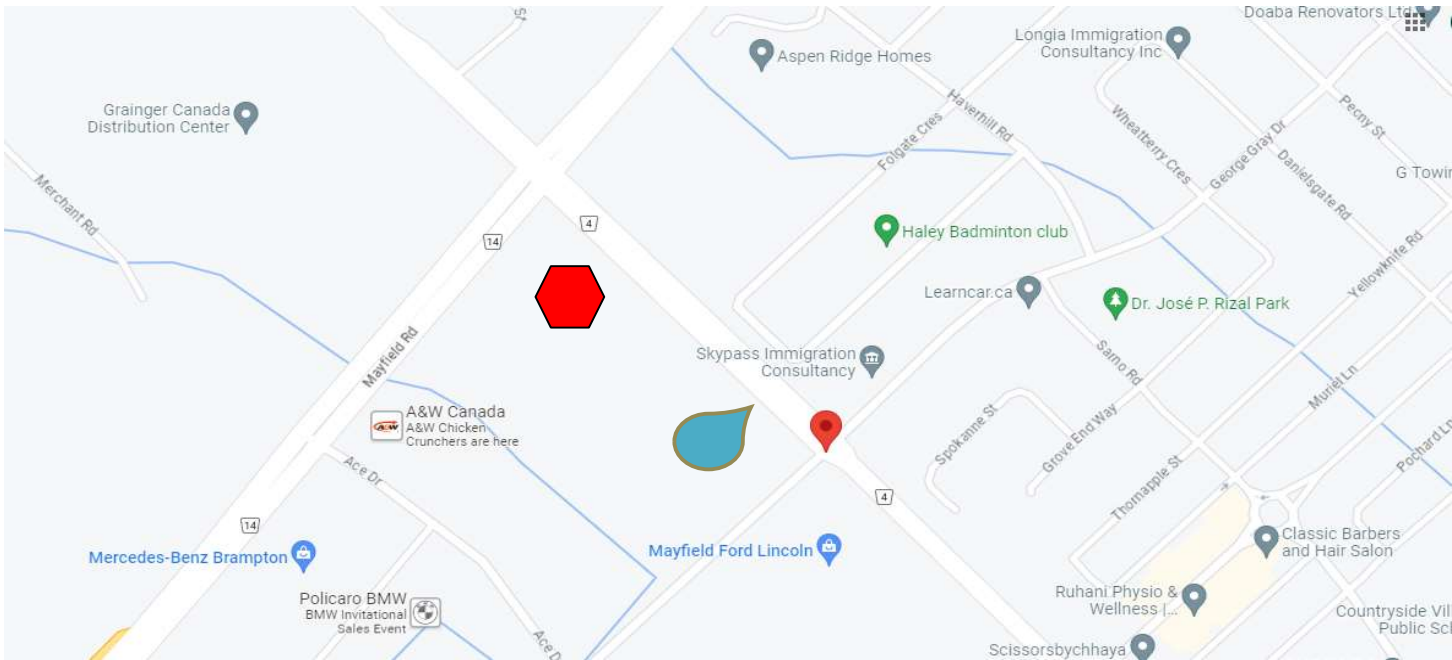

LEGEND:



STATIC HYDRANT



RESIDUAL HYDRANT

FINAL RESULTS:

Test #	Number of Outlets	Orifice Size (in)	Pitot Reading (psig)	EquivInt Flow (usgpm)	Total Flow (usgpm)	Projected flow at 20psi (usgpm)	Gauge Pressure (psig)	Discharge Coef'nt
Static	N/A	N/A	N/A	N/A	0	N/A	58	N/A
1	1	2.47	45	977	977	2646	52	0.8
2	2	2.47	25	728	1456	3377	50	0.8

