



1 EXISTING 3RD FLOOR PLAN  
S1-03 N.T.S

EXISTING 3RD FLOOR SLAB

- STRUCTURAL INFORMATION WAS TAKEN FROM DRAWING S10 PREPARED BY GILLESPIE & JAVIS ARCHITECTS BEARING THE SEAL OF M.S. YOLLES P.ENG DATED 15.6.87
- ORIGINAL LOADING CIRCA 1987  
LIVE LOAD - 40PSF - 4PSF PARTITION ALLOWANCE WITH THE EXCEPTION OF CORRIDORS, TOILETS AND DINING AREAS LL=10PSF
- THE LEVEL 3 SLAB HAS BEEN CHECKED BASED ON LOADING INDICATED ON DRAWING S1-02 AND BASED ON OUR SELECTED CALCULATIONS THE 3RD FLOOR SLAB IS CAPABLE OF SUPPORTING THE LOADING INDICATED WITHOUT ANY ADVERSE EFFECTS
- CONTRACTOR TO X-RAY/SCAN ALL PROPOSED FLOOR PENETRATIONS AND NOTIFY ENGINEER 24HRS IN ADVANCE FOR ONSITE REVIEW PRIOR TO ANY CORING TAKING PLACE.

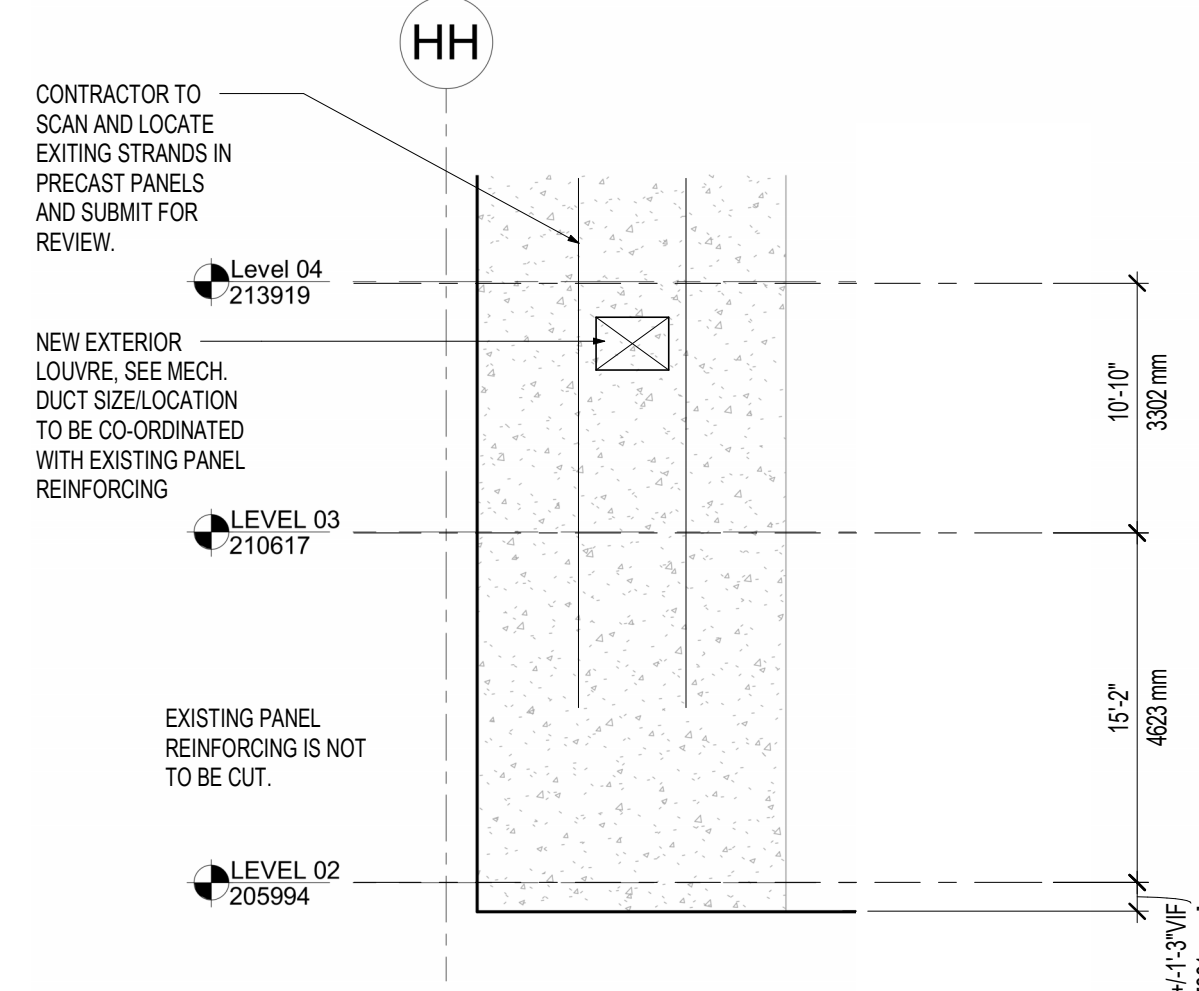

2 WEST EXTERIOR SHAFT WALL  
S1-03 1:100

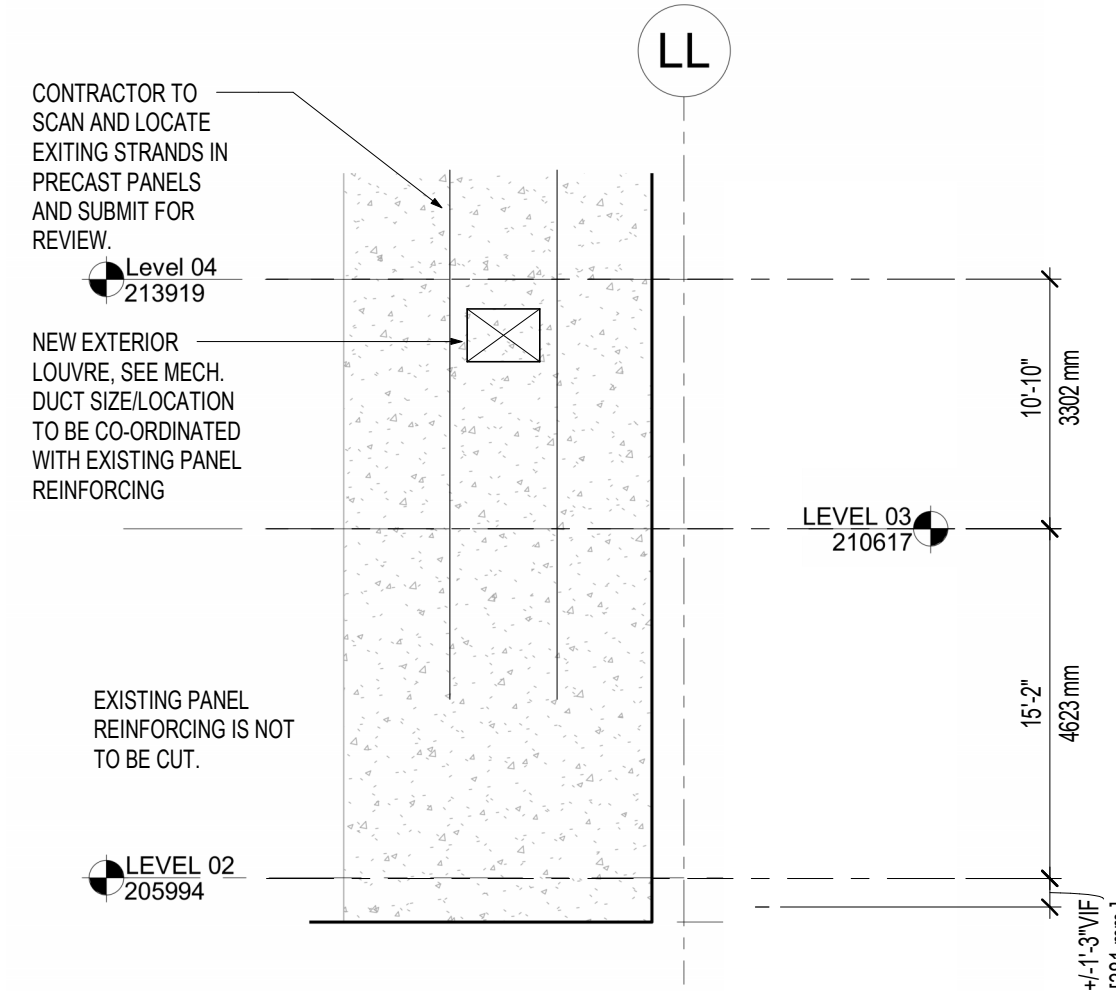

3 EAST EXTERIOR SHAFT WALL  
S1-03 1:100

