


Rev.	Description	Date
4	STAGE 4 SUBMISSION	11/23/2022
3	QA/QC 95% CDs	11/01/2022
2	LEVEL 03 RENOVATIONS - STAGE 3 SUBMISSION	06/30/2021
1	ISSUED FOR REVIEW	06/15/2021

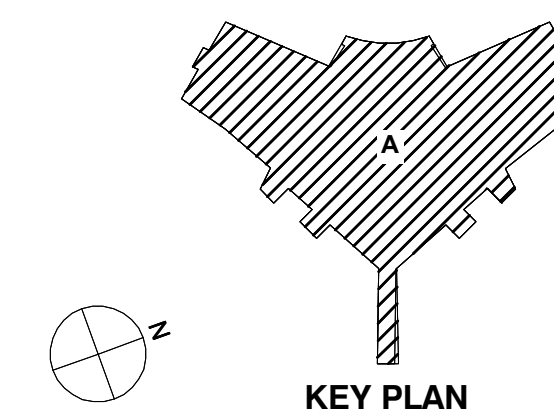

Drawing Title:

LEVEL 03 DEMOLITION  
PLAN - ELECTRICAL

Project No.: 210029 Checked by: JM

ED01

DEMOLITION GENERAL NOTES:


- THE ELECTRICAL CONTRACTOR SHALL INSPECT THE SITE AND SHALL INVESTIGATE ALL CONDITIONS UNDER WHICH THIS WORK WILL BE PERFORMED. THIS SHALL INCLUDE DETERMINATION OF EXACT LOCATIONS OF ITEMS INDICATED ON THE DRAWINGS AS EXISTING.
- REVIEW AND CONFIRM WITH THE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR THE COMPLETE EXTENT OF NECESSARY REMOVAL, RELOCATION, RECONNECTING AND REROUTING OF ELECTRICAL DEVICES AND SERVICES AS REQUIRED.
- THE SCOPE OF WORK INCLUDES DISCONNECTION AND REMOVAL OF ALL EXISTING ELECTRICAL EQUIPMENT, CONDUITS, WIRING, FIXTURES, DEVICES, ETC. IN THE WORK AREA INDICATED UNLESS OTHERWISE NOTED.
- USE CAUTION TO AVOID DAMAGE TO EXISTING SERVICES AND/OR HARM TO PERSONNEL ENGAGED IN WORKING IN ADJACENT AREAS THAT ARE TO REMAIN OCCUPIED.
- IN AREAS WHERE EXISTING ELECTRICAL EQUIPMENT IS TO REMAIN AND IF EXISTING CIRCUIT AND SYSTEM WIRING IS PRESENTLY ROUTED OUTSIDE DESIGNATED AREAS WHERE EXISTING MATERIALS AND/OR EQUIPMENT ARE TO BE REMOVED, THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL RACEWAYS, BOXES, AND NEW WIRING AS REQUIRED TO MAINTAIN EXISTING CIRCUIT AND SYSTEM WIRING TO COMPONENTS WHICH ARE TO REMAIN.
- EXISTING ABANDONED CONDUIT, OUTLETS AND BOXES MAY BE USED AT THE OPTION OF THE ELECTRICAL CONTRACTOR PROVIDED THAT THEY ARE COMPATIBLE FOR USE WITH THIS PROJECT DESIGN, SPECIFICATIONS AND MEET THE REQUIREMENTS OF THE O.E.S.C. AND LOCAL GOVERNING AUTHORITIES.
- EXISTING CONDUIT, WIRING, DEVICES AND OUTLET BOXES, UNLESS NOTED OTHERWISE, WHICH ARE CONCEALED IN EXISTING WALLS AND/OR CEILINGS WHICH ARE TO BE REMOVED SHALL BE DE-ENERGIZED AND REMOVED BY THE ELECTRICAL CONTRACTOR. THE ABOVE ITEMS WHEN FOUND CONCEALED IN EXISTING WALLS AND CEILINGS WHICH ARE TO REMAIN, SHALL BE ABANDONED, WIRING REMOVED AND OUTLETS BLANKED WITH VANDAL PROOF SCREWS BY THE ELECTRICAL CONTRACTOR.
- EXISTING CONDUIT, WIRING, DEVICES AND OUTLET BOXES, UNLESS NOTED OTHERWISE, WHICH ARE SURFACE MOUNTED ON EXISTING WALLS AND/OR CEILINGS WHICH ARE BEING REMOVED SHALL BE DE-ENERGIZED BY THE ELECTRICAL CONTRACTOR AND REMOVED. THE ABOVE ITEMS WHEN FOUND SURFACE MOUNTED ON EXISTING WALLS AND CEILINGS WHICH ARE TO REMAIN SHALL BE DE-ENERGIZED BY THE ELECTRICAL CONTRACTOR AND REMOVED.
- WHERE EXISTING DEVICE OUTLETS ARE INDICATED ON PLAN TO REMAIN, THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ON THAT DEVICE ALL NECESSARY OUTLET BOX EXTENSIONS OF THE PROPER TYPE AND DEPTH AS MAY BE REQUIRED TO ACCOMMODATE ANY NEW WALL FINISH, COVERING OR MATERIAL. THIS WORK SHALL ALSO INCLUDE THE REINSTALLATION AND RECONNECTION OF THE DEVICE AS MAY BE REQUIRED.
- THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE INTEGRITY AND CONDITION OF EXISTING FEEDERS AND BRANCH CIRCUITS WHICH ARE TO REMAIN IN SERVICE. ALL DAMAGED OR NONFUNCTIONAL WIRING SHALL BE BROUGHT TO THE ATTENTION OF THE CONSULTANT AND THE OWNER.
- THE ELECTRICAL CONTRACTOR SHALL RETURN ALL REMOVED, EXISTING AND REUSABLE EQUIPMENT TO THE OWNER. ALL OTHER MATERIALS SHALL BE DISPOSED OF IN AN ACCEPTABLE MANNER AS DIRECTED IN THE FIELD BY THE GENERAL CONTRACTOR.
- ALL EXISTING ELECTRICAL EQUIPMENT SHALL BE PROPERLY PROTECTED AGAINST DAMAGE DURING THE PERIOD OF THIS RENOVATION.

NOTES:

- EXISTING LIFE SAFETY SPEAKER AND SMOKE DETECTOR LIFE SAFETY CIRCUITS LOCATED IN NEW DRY WALL CEILING CORRIDOR (BETWEEN WEST STAIR 'B' AND CENTRE 'A' STAIR ARE TO BE LOWERED FOR NEW FIRE DEVICES AS SHOWN ON DRAWING 603. EXISTING LIFE SAFETY CIRCUITS AS REQUIRED. EXISTING SURFACE MOUNTED LIFE SAFETY SPEAKER AND SMOKE DETECTORS ARE TO BE REMOVED.
- ◇ NOT USED.
- ◇ EXISTING LIGHT FIXTURE BACK BOX TO REMAIN AND TO BE REUSED FOR NEW LIGHT FIXTURE AS SHOWN ON DRAWING E-02.



2 PHOTO OF EXISTING PANEL LP-A3  
SCALE: N.T.S.

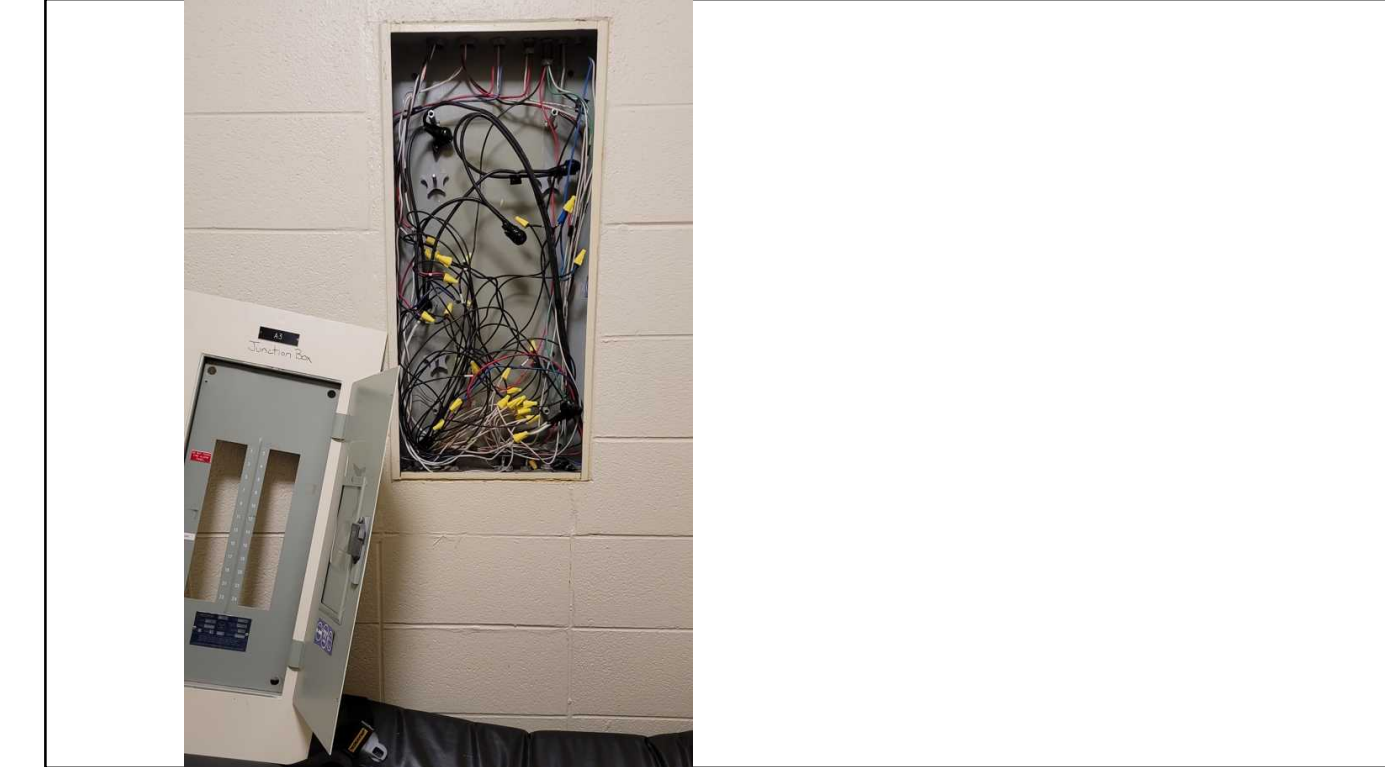

3 PHOTO OF EXISTING TUB  
SCALE: N.T.S.



4 PHOTO OF EXISTING PANEL LP-B3  
SCALE: N.T.S.



5 PHOTO OF EXISTING PANEL LP-C3  
SCALE: N.T.S.



7 PHOTO OF EXISTING KEY SWITCH/MAN PULL STATION  
SCALE: N.T.S.



6 PHOTO OF EXISTING BUS PLUG  
SCALE: N.T.S.

1 LEVEL 03 PLAN  
SCALE: 1:100