



ADDENDUM # 04

REQUEST FOR QUOTATIONS (RFQ)

RFQ NO. CW29854

FOR

SHN Mental Health Inpatient Consolidation Pod 3A

Issue Date: July 8, 2026

1. GENERAL

This Addendum is issued in accordance with the RFQ and amends the original RFQ and associated documents as set out below. The revisions shall become part of the RFQ documents and change the original RFQ documents only in the manner and extent stated.

This Addendum shall be attached to the above-noted RFQ and shall form an integral part of the RFQ. The contents of this Addendum shall be brought to the attention of all concerned.

2. CHANGES

None

3. DOCUMENTS ISSUED UNDER THIS ADDENDUM

None

4. QUESTIONS AND ANSWERS

The following questions pertaining to the RFQ have been received and the following answers are being provided to all Respondents:

Question 1:

We have received request for clarification from EATON, Panel manufacturer for modifications in existing Westinghouse panels.

- **Panels PP-SD-B-AA & PP-SD-B-EAA needs 4 numbers of new 150A breakers & these panels are located in room SD48 on SD Level.**
- **As these panels are very old & connection kits for these breakers are no longer available, since they are not manufacturing any more.**
- **They need to know whether they should provide completely new panel as first option or new interiors with trim as second option.**

Answer 1:

Option 1 would be too disruptive. All bidders to allow for new interiors with trim /retrofit kits as required.


Question 2:

With addendum E-02 , we have received the revised drawing E0-00 with floor plan for location of room SD48 from SD level which is non-scale plan and hence please provide length of the new feeders from panels PP-SD-B-AA & PP-SD-B-

EAA to LP-3D-EA, LP-3D-EB, LP-3D-A & LP-3D-B panels to include them in our quote.

Answer 2:

Exact length cannot be provided as feeder routing must be determined by the awarded contractor. However, please see below additional information:

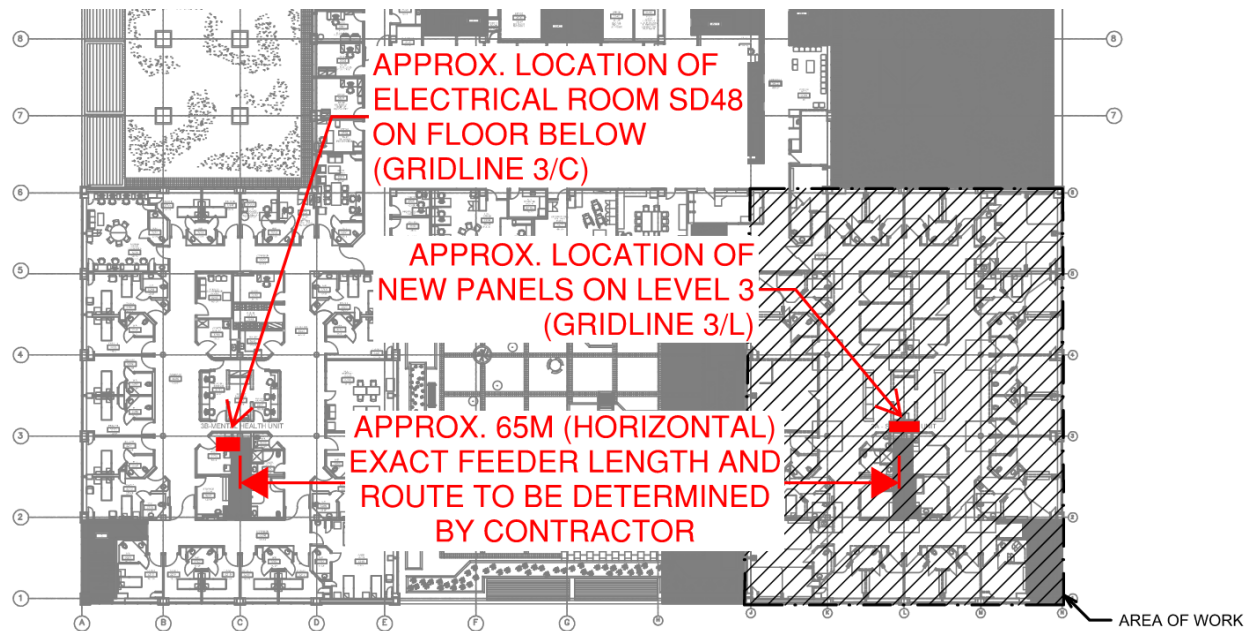

End of Addendum No.04