

FINAL

Designated Substances Survey Report

Police Headquarters
40 College Street, Toronto, Ontario

Prepared for:

The City of Toronto

Facilities Management
55 John Street, 2nd Floor
Toronto ON

Attention: Sara Reid
Environmental Project Manager

December 10, 2015

Pinchin File: 103037



Designated Substances Survey Report

Police Headquarters, 40 College Street, Toronto, Ontario
The City of Toronto

December 10, 2015

Pinchin File: 103037

FINAL

Issued to: The City of Toronto
Contact: Sara Reid
Environmental Project Manager
Issued on: December 10, 2015
Pinchin file: 103037
Issuing Office: 50 Wellington Street East, Suite
200, Toronto, ON M5E 1C8
Primary Contact: Juliette McIntyre

Author:

Joseph Mainwaring, B.A., PCEM
Project Technologist
416.368.6555 ext. 1927
jmainwaring@pinchin.com

Reviewer:

Juliette McIntyre
Senior Project Manager
jmcintyre@pinchin.com

Reviewer:

Mark Stroombergen, C.E.T.
Director, GTA - Hazardous Materials
mstroombergen@pinchin.com



EXECUTIVE SUMMARY

The City of Toronto (Client) retained Pinchin Ltd. (Pinchin) to conduct a Designated Substance survey of Police Headquarters located at 40 College Street, Toronto, Ontario. The survey was performed on September 3, 2015.

The objective of the survey was to document the locations of specified Designated Substances, polychlorinated biphenyls (PCBs) and mould, evaluate their condition, and develop corrective action plans as required for the purposes of long term management. The results of this survey are not intended for construction, renovation, demolition or project tendering purposes.

The survey area consisted of the entire building. The building was occupied at the time of the survey.

SUMMARY OF FINDINGS

Asbestos: Asbestos-containing materials (ACM) were confirmed or assumed to be present as follows:

- Asbestos cement (Transite) pipe present as rain water leader throughout the building;
- 2'x4', deep random fleck and pinhole acoustic ceiling tile (assumed).

Lead: Lead may be present in emergency light batteries, and is assume to be present in paint.

Silica: Crystalline silica is present in concrete, mortar, brick, masonry, ceramics, where present in the building.

Mercury: Mercury vapour is present in fluorescent lamps throughout the building.

Polychlorinated Biphenyls (PCBs): No PCBs were found during this survey.

SUMMARY OF RECOMMENDATIONS

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations.

1. Perform a pre-construction survey and remove all ACM prior to alteration or maintenance work or if ACM may be disturbed by the work.
2. Remove and dispose of mercury-containing items when taken out of service.
3. Follow appropriate safe work procedures when handling or disturbing asbestos, lead, mercury and silica.

Please refer to Section 4.0 of this report for detailed recommendations regarding administrative and remedial actions.



Designated Substances Survey Report

Police Headquarters, 40 College Street, Toronto, Ontario
The City of Toronto

December 10, 2015

Pinchin File: 103037

FINAL

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Survey	1
2.0	BACKGROUND INFORMATION	2
2.1	Building Description	2
3.0	FINDINGS	2
3.1	Asbestos	2
3.2	Lead	9
3.3	Silica	9
3.4	Mercury	9
3.5	Polychlorinated Biphenyls	10
3.6	Mould	10
4.0	RECOMMENDATIONS	10
4.1	General	10
4.2	On-going Management and Maintenance	10
5.0	LIMITATIONS	12
6.0	REFERENCES	12

APPENDICES

APPENDIX I	Drawings
APPENDIX II-A	Asbestos Analytical Certificates
APPENDIX II-B	Lead Analytical Certificates
APPENDIX II-C	PCB Analytical Certificates
APPENDIX III	Methodology
APPENDIX IV	Photographs
APPENDIX V	Survey Form



1.0 INTRODUCTION AND SCOPE

The City of Toronto (Client) retained Pinchin Ltd. (Pinchin) to conduct a Designated Substances Survey of the Police Headquarters, located at 40 College Street, Toronto, Ontario.

The survey was performed by Joseph Mainwaring, B.A., PCEM, Project Technologist on September 3, 2015. The surveyor was accompanied by a representative of the City of Toronto during the survey. The building was occupied at the time of the survey.

The objective of the survey was to document the locations of specified Designated Substances, polychlorinated biphenyls (PCBs) and mould, evaluate their condition, and develop corrective action plans as required. This survey is only to be used for the purposes of long term management and routine maintenance. The results of this survey are not to be used for construction, renovation, demolition or project tendering purposes.

1.1 Scope of Survey

The survey was performed to review the location and type of specified hazardous building materials present in the building.

For the purpose of the survey and this report, hazardous building materials include the following Designated Substances:

- Asbestos
- Lead
- Silica
- Mercury

The survey also included:

- Polychlorinated Biphenyls (PCBs)
- Mould

The following Ontario Designated Substances are not typically found in building materials in a composition/state that is hazardous and were not included in this survey:

- Arsenic
- Acrylonitrile
- Benzene
- Coke oven emissions



- Ethylene oxide
- Isocyanates
- Vinyl chloride monomer

2.0 BACKGROUND INFORMATION

2.1 Building Description

Item	Details
Building Use	Office Building
Number of Floors/Levels	12 stories plus 5 below grade
Total Area of Building (Square Feet)	180,000
Year of Construction	1988
Structure	Structural steel, concrete
Exterior Cladding	Pre-cast concrete, glass
HVAC	Forced air
Roof	Built-up roofing
Flooring	Concrete, carpet, vinyl floor tiles, ceramic tiles, marble, terrazzo, vinyl sheet flooring
Interior Walls	Drywall, concrete
Ceilings	Drywall, concrete, acoustic ceiling tile

3.0 FINDINGS

3.1 Asbestos

3.1.1 Suspect Building Materials Not Found

The following types of building materials may historically contain asbestos but were not observed in the building and are not discussed in the report findings:

- Plaster
- Sealants and Putty

3.1.2 *Spray-Applied Fireproofing and Thermal Insulation*

Non-asbestos fireproofing and overspray is present on the structure throughout the Basement and in select areas on the 1st floor (samples 2012-A0001A-G).



Non-asbestos sprayed fireproofing

3.1.3 *Texture Finishes (Acoustic/Decorative)*

Texture finish is present on concrete walls in the Basement Parking Garages (samples 2013-A0023A-C and 2015-A0023D-G). No asbestos was detected in the texture coat samples.




Non-asbestos texture finish

3.1.4 *Thermal Systems Insulation (TSI)*

3.1.4.1 *Pipe Insulation*

Non-asbestos paring cement (previously sampled) insulation is present on pipe fittings (elbows, valves, tees, hangers etc.) is present in the Penthouse Mechanical Rooms.

All remaining pipes are either not insulated or insulated with non-asbestos fibreglass insulation.

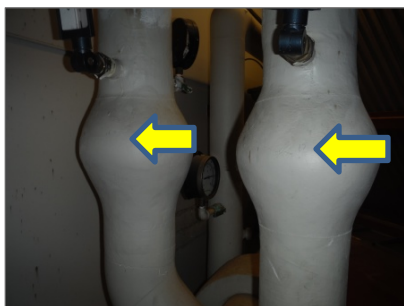

Non-asbestos paring cement



Non-asbestos fiberglass insulation

3.1.4.2 Duct Insulation

Ducts are either uninsulated or insulated with non-asbestos fiberglass and jacketed with either canvas or foil.



Non-asbestos fiberglass insulated ducts jacketed with foil

3.1.4.3 Mechanical Equipment Insulation

Mechanical equipment is not insulated.

3.1.5 Acoustic Ceiling Tiles

Five (5) distinct types of acoustic ceiling tile are present in the assessed area, as follows:

Size, Type, Pattern, Photo #	Locations (Quantity in Square Feet)	Sample Number or Date Code	Asbestos Type
ACT 01 – 2'x4', textured with pinhole, Photo 01	*See Survey Form in Appendix V for Locations	2013-A0019A-C	None Detected
ACT 02 – 2'x4', random dimples and pinholes	*See Survey Form in Appendix V for Locations	2013-A0022A-C	None Detected

Size, Type, Pattern, Photo #	Locations (Quantity in Square Feet)	Sample Number or Date Code	Asbestos Type
ACT 03 – 2'x4', deep random fleck and pinhole	*See Survey Form in Appendix V for Locations	Dated 2010	ACM Assumed
ACT 04 – 2'x4', fibreglass	*See Survey Form in Appendix V for Locations	Visually assessed	Non-Asbestos
ACT 05 – 2'x4', small random fleck and pinhole	*See Survey Form in Appendix V for Locations	2013-A0020A-C	None Detected

Ceiling tiles are considered to be potentially friable and are in good condition.



Photo 01 – Non-asbestos ACT 01

3.1.6 Drywall Joint Compound

Drywall (gypsum board) and drywall joint compound is present as a wall and ceiling finish throughout the building. Drywall joint compound was previously sampled and found to be non-asbestos.

3.1.7 Asbestos Cement Products (Transite)

Transite pipe is present as rain water leaders throughout the building. Transite is assumed to contain asbestos based on visual observation. Transite is non-friable and in good condition.



Asbestos cement (Transite) as rain water leader.

3.1.8 Vinyl Sheet Flooring

Beige vinyl sheet flooring is present throughout the building. The vinyl sheet flooring was previously sampled and found to be non-asbestos (samples 2013-A0026A-C).

3.1.9 Vinyl Floor Tile and Mastic

Vinyl floor tiles are present as follows:

Size, Pattern, Colour and Photo Number	Locations (Quantity)	Sample Number	Asbestos Type (tile)	Asbestos Type (mastic)
VFT-01 – 12"x12", beige, Photo 02	*See Survey Form in Appendix V for Locations	2013-A0024A-C	None Detected	None Detected
VFT-02 – 12"x12", blue shades, Photo 03	*See Survey Form in Appendix V for Locations	2013-A0027A-C	None Detected	None Detected
VFT-03 – 12"x12", white with black streaks, Photo 04	*See Survey Form in Appendix V for Locations	2013-A0025A-C	None Detected	None Detected
VFT-04 – 12"x12", beige, white and grey, Photo 05	*See Survey Form in Appendix V for Locations	2013-A0029A-C	None Detected	None Detected
VFT-05 – 12"x12", grey with white and black smears, Photo 06	*See Survey Form in Appendix V for Locations	2013-A0028A-C	None Detected	None Detected
VFT-06 – 12"x12", blue with white streaks, Photo 07	*See Survey Form in Appendix V for Locations	2013-A0030A-C	None Detected	None Detected

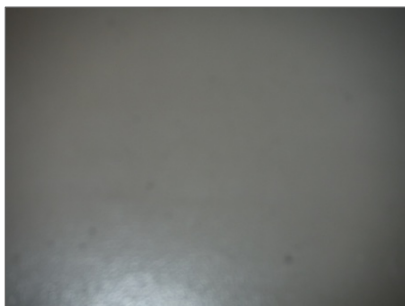


Photo 02 – Non-asbestos VFT-01

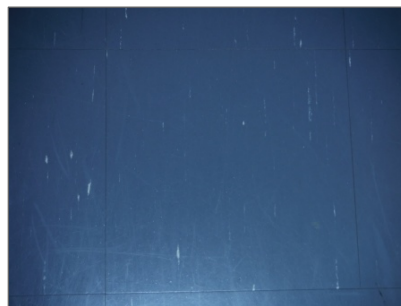


Photo 03 – Non-asbestos VFT-02

Refer to additional photographs in Appendix IV.

3.1.10 Firestopping

Non-asbestos firestopping (samples 2015-A0032A-C) is present in Mechanical Closets throughout the building at pipe and conduit penetrations.



Non-asbestos firestopping

3.1.11 Sealants, Caulking, and Putty

No asbestos was detected in the caulking samples. Caulking is present as follows:

Colour	Locations (Quantity)	Sample Number	Asbestos Type
Light Brown	*See Survey Form in Appendix V for Locations	2015-A0034A-C	None Detected
Black	*See Survey Form in Appendix V for Locations	2015-A0033A-C	None Detected
Grey	*See Survey Form in Appendix V for Locations	2015-A0035A-C	None Detected
White	*See Survey Form in Appendix V for Locations	2015-A0036A-C	None Detected



Non-asbestos light brown caulking



Non-asbestos grey caulking

3.1.12 Other Building Materials

Built-up roofing is present on the roof over the entire building. The built up roofing materials do not contain asbestos (samples 2015-A0031A-C).



Cross-section of non-asbestos roofing materials

3.1.13 Assumed Asbestos Materials

A number of materials which might contain asbestos were not sampled during our survey due to limitations in scope and methodology. Where present, these materials must be assumed to be an asbestos material and are best sampled during project planning and preparation of contract documents for their removal. Materials assumed to contain asbestos include:

- concrete floor levelling compound
- elevator and lift brakes
- electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring
- vermiculite in concrete block wall cavities
- levelling compound

- adhesives and duct mastics

3.2 Lead

3.2.1 Paints

A total of 1 paint chip sample was collected from exterior painted finishes. The following table summarized the sample analytical results and the sampling locations. Appendix II-B presents the analytical results.

Sample Number	Colour, Substrate Description	Locations	Lead (%)
L0001	Blue on metal	Metal structural beams on the roof near the cooling tower	0.048

The above paint was sampled due to poor condition and flaking. The lead concentration is below the City of Toronto action level of 0.1 %.

3.2.2 Lead Products and Applications

Lead-containing batteries are present in emergency lighting present throughout the building.

3.2.3 Assumed Lead Materials

Lead may be present in a number of materials which were not assessed and/or sampled. The following materials, where found, should be considered to contain lead.

- electrical components, including wiring connectors, fibre optic cable sheathing, grounding conductors, and solder

3.3 Silica

Crystalline silica is assumed component of the following building materials where present in the building:

- poured or pre-cast concrete
- masonry and mortar
- stone (granite, slate)
- ceramic tiles, grout

3.4 Mercury

3.4.1 Lamps

Mercury vapour is present in fluorescent lamps where present in the assessed area.

3.4.2 Mercury-Containing Devices

Mercury-containing devices were not found during the survey.

3.5 Polychlorinated Biphenyls

3.5.1 Caulking

Caulking is present at exterior windows and mechanical equipment (samples P0002 – P0005) and contains <0.5 mg/kg PCBs. The material is a non-PCB solid based on the threshold given in SOR/2008-273 (50 ppm).

Refer to analytical results in Appendix II-C.

3.5.2 Lighting Ballasts

Confirmed by visual observations (evidence of T-8 fixtures) the building has been comprehensively re-lamped and will not contain PCB ballasts.

3.5.3 Transformers

All transformers in the building are dry type transformers and do not contain PCB-containing dielectric fluids.

3.6 Mould

Visible mould growth was not found in the assessed area.

4.0 RECOMMENDATIONS

4.1 General

Perform a detailed intrusive survey prior to building renovation or demolition operations. The survey should include; destructive testing (i.e. coring and/or removal of building finishes and components), and sampling of materials not previously tested (i.e. roofing materials, caulking, mastics).

4.2 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the hazardous materials identified.

4.2.1 Asbestos

Perform an assessment of asbestos materials on an annual basis. The next assessment of ACM should be performed prior to August 2016 to remain in compliance.

Remove all asbestos-containing materials (ACM) prior to alteration or maintenance work or if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.

4.2.2 Lead

No lead samples were found to be >0.1% content, however if found then follow the recommendations below.

Disturbance of lead in paint and coatings (or other materials) during maintenance activities may result in over-exposure to lead dust or fumes. The need for work procedures, engineering controls and personal protective equipment will need to be assessed on a project-by-project basis and must comply with provincial standards or guidelines. Performing an exposure assessment during work that disturbs lead in paints and coatings may be able to alleviate the use of some of the precautions specified by these standards or guidelines.

Lead-containing items lead-acid batteries should be recycled when taken out of service.

4.2.3 Silica

Disturbance of silica-containing products during maintenance activities may result in excessive exposures to airborne silica, especially if performed indoors and dry. Cutting, grinding, drilling or demolition of materials containing silica should be completed only with proper respiratory protection and other worker safety precautions that comply with provincial standards or guidelines.

4.2.4 Mercury

Recycle and reclaim mercury from fluorescent light tubes and thermostats when taken out of service. Do not break lamps or separate liquid mercury from components. Light tubes are accepted free of charge at many local recycling depots. Liquid mercury is classified as a hazardous waste and must be disposed of in accordance with local regulations.

4.2.5 Mould

Conduct an intrusive mould investigation to determine the extent of mould growth. The investigation should identify the source of the water intrusion that contributed to the mould growth and water damage observed during this survey.



5.0 LIMITATIONS

The work performed by Pinchin was conducted in accordance with the City of Toronto Contract Number 47018468, effective July 31, 2014.

6.0 REFERENCES

The following legislation and documents were referenced in completing the survey and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.
3. Lead on Construction Projects, Ministry of Labour Guidance Document.
4. Ministry of the Environment Regulation, R.R.O. 1990 Reg. 347 as amended.
5. Surface Coating Materials Regulations, SOR/2005-109, Hazardous Products Act.
6. Silica on Construction Projects, Ministry of Labour Guidance Document.
7. Alert – Mould in Workplace Buildings, Ontario Ministry of Labour.
8. Standard Operating Procedures for Designated Substance Surveys, dated April, 2014, City of Toronto, Facilities Management.

\\pinchin.com\miss\Job\103000st\103037 CITYOFTORONTO\VariousLocati,DSUB,ASSMT\Toronto Police Services\40 College Street\Report\FINAL\40 College St_DSS_2015.docx

Template: Master Report for Hazardous Materials Assessment Report (Tablet Management), Haz, December 10, 2014

APPENDIX I
Drawings



LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
B5 FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:


JM

SCALE:

NTS

1 OF 18

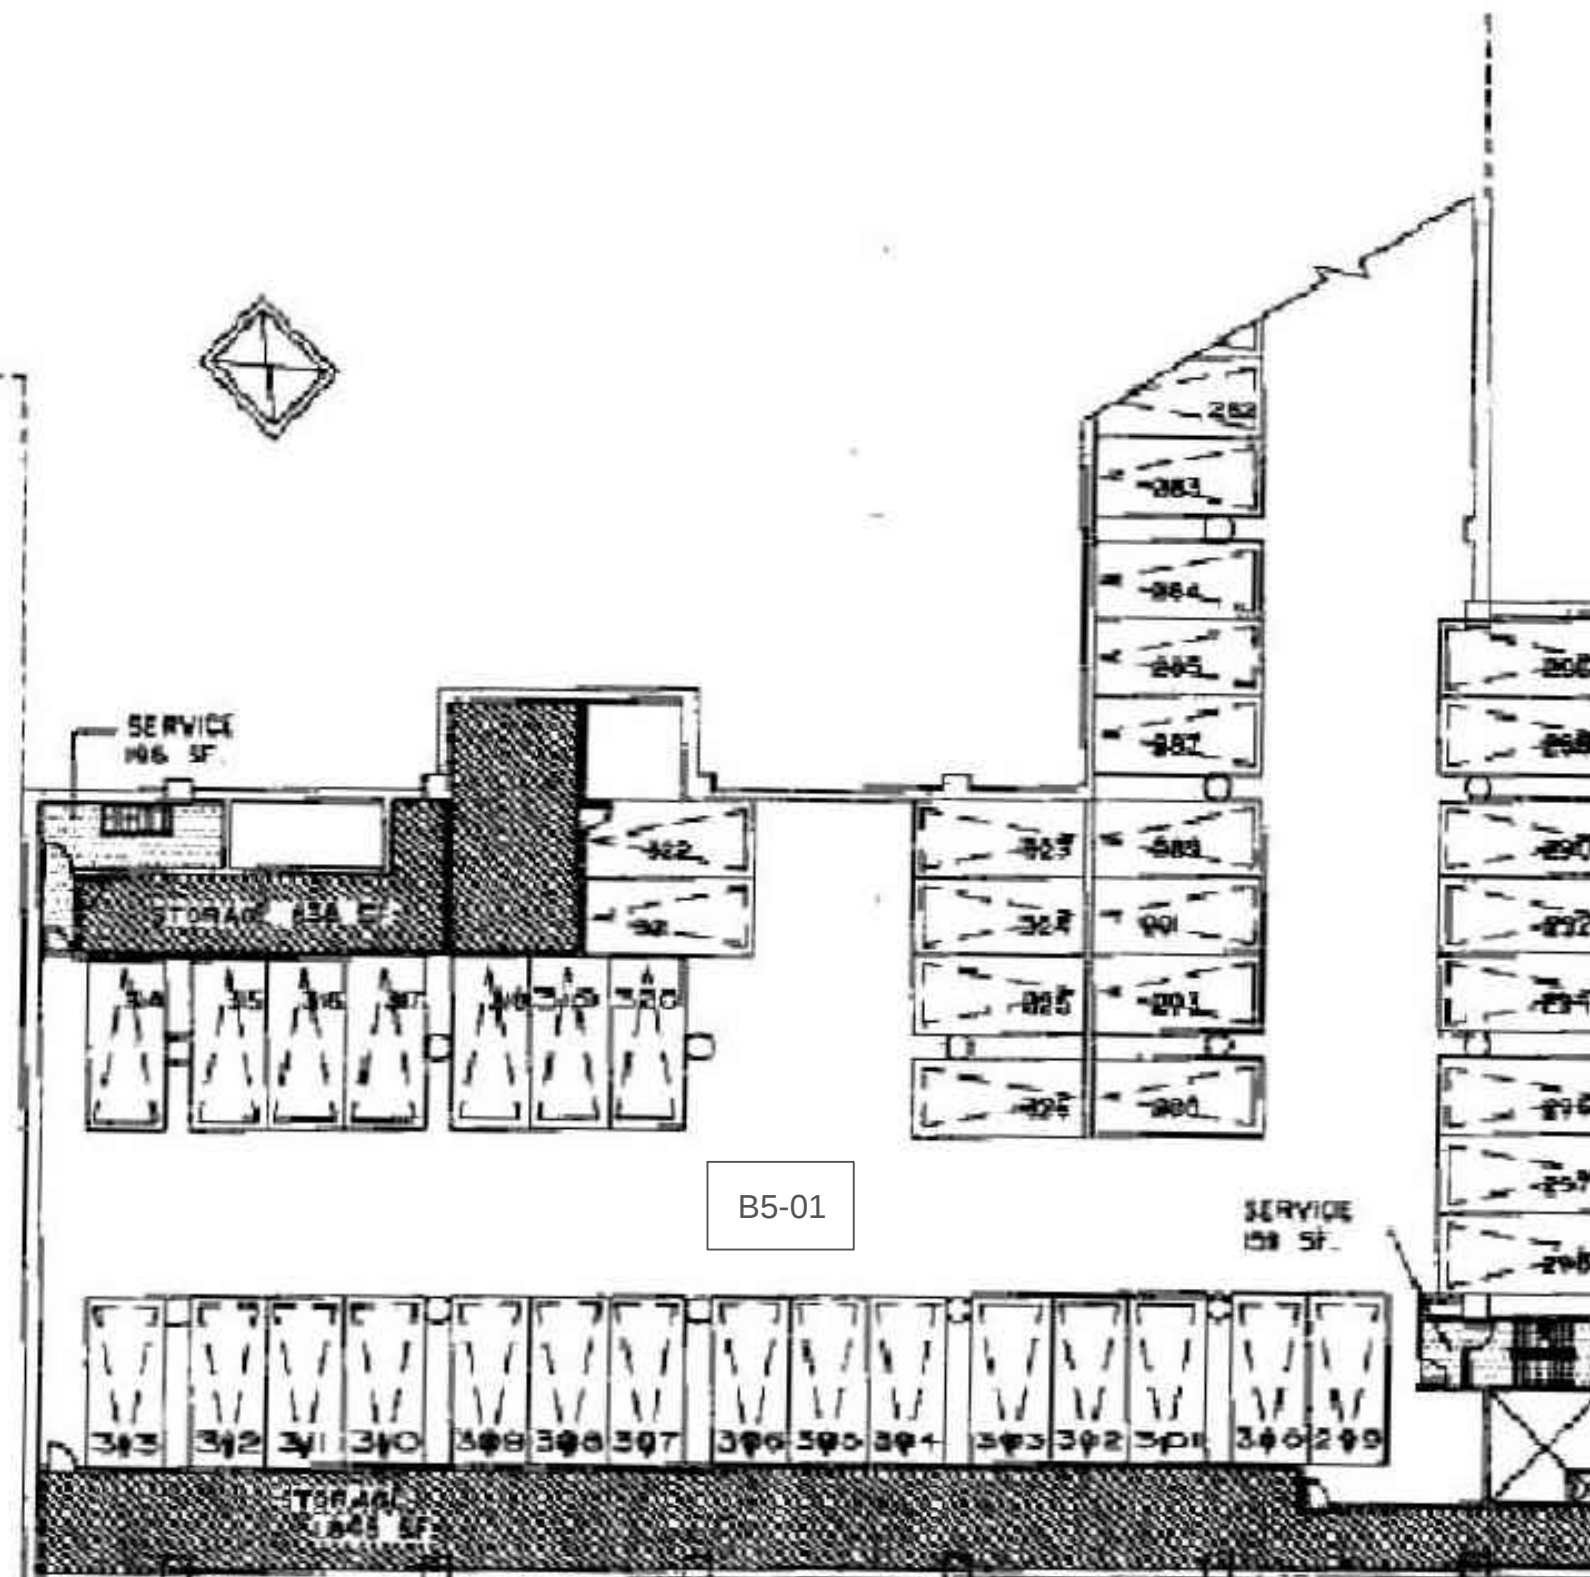

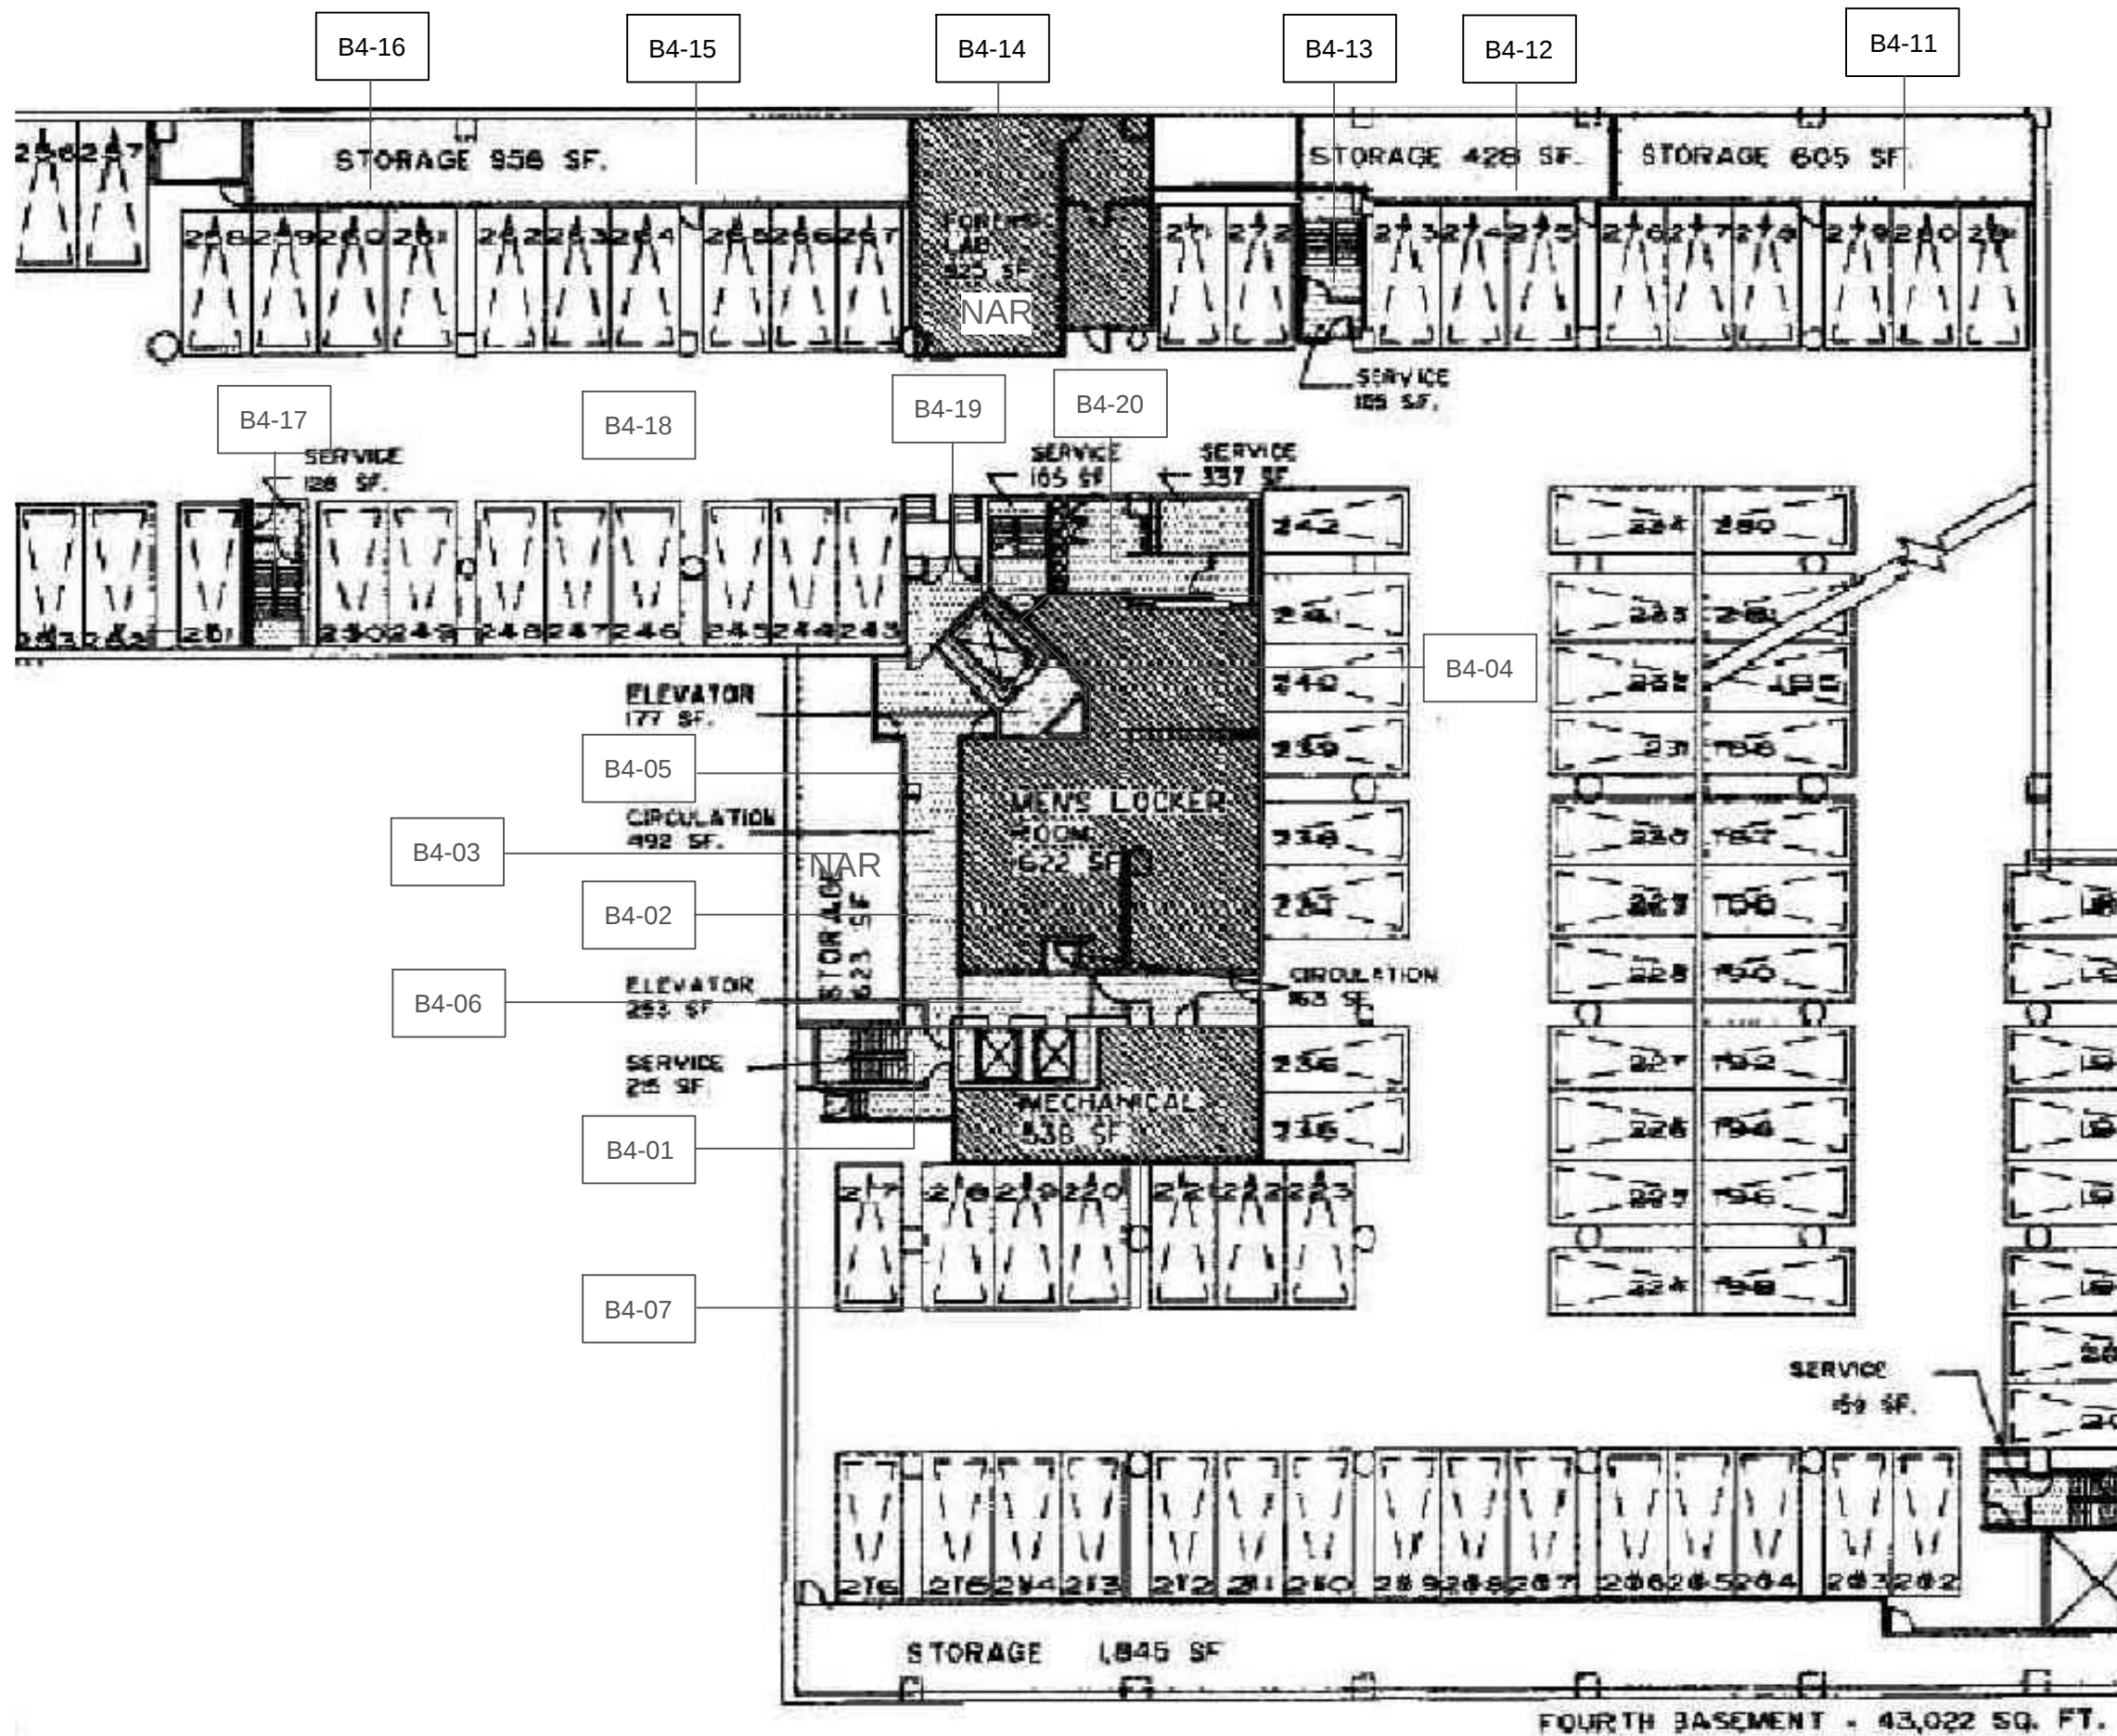

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
B4 FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM

SCALE:

NTS

2 OF 18

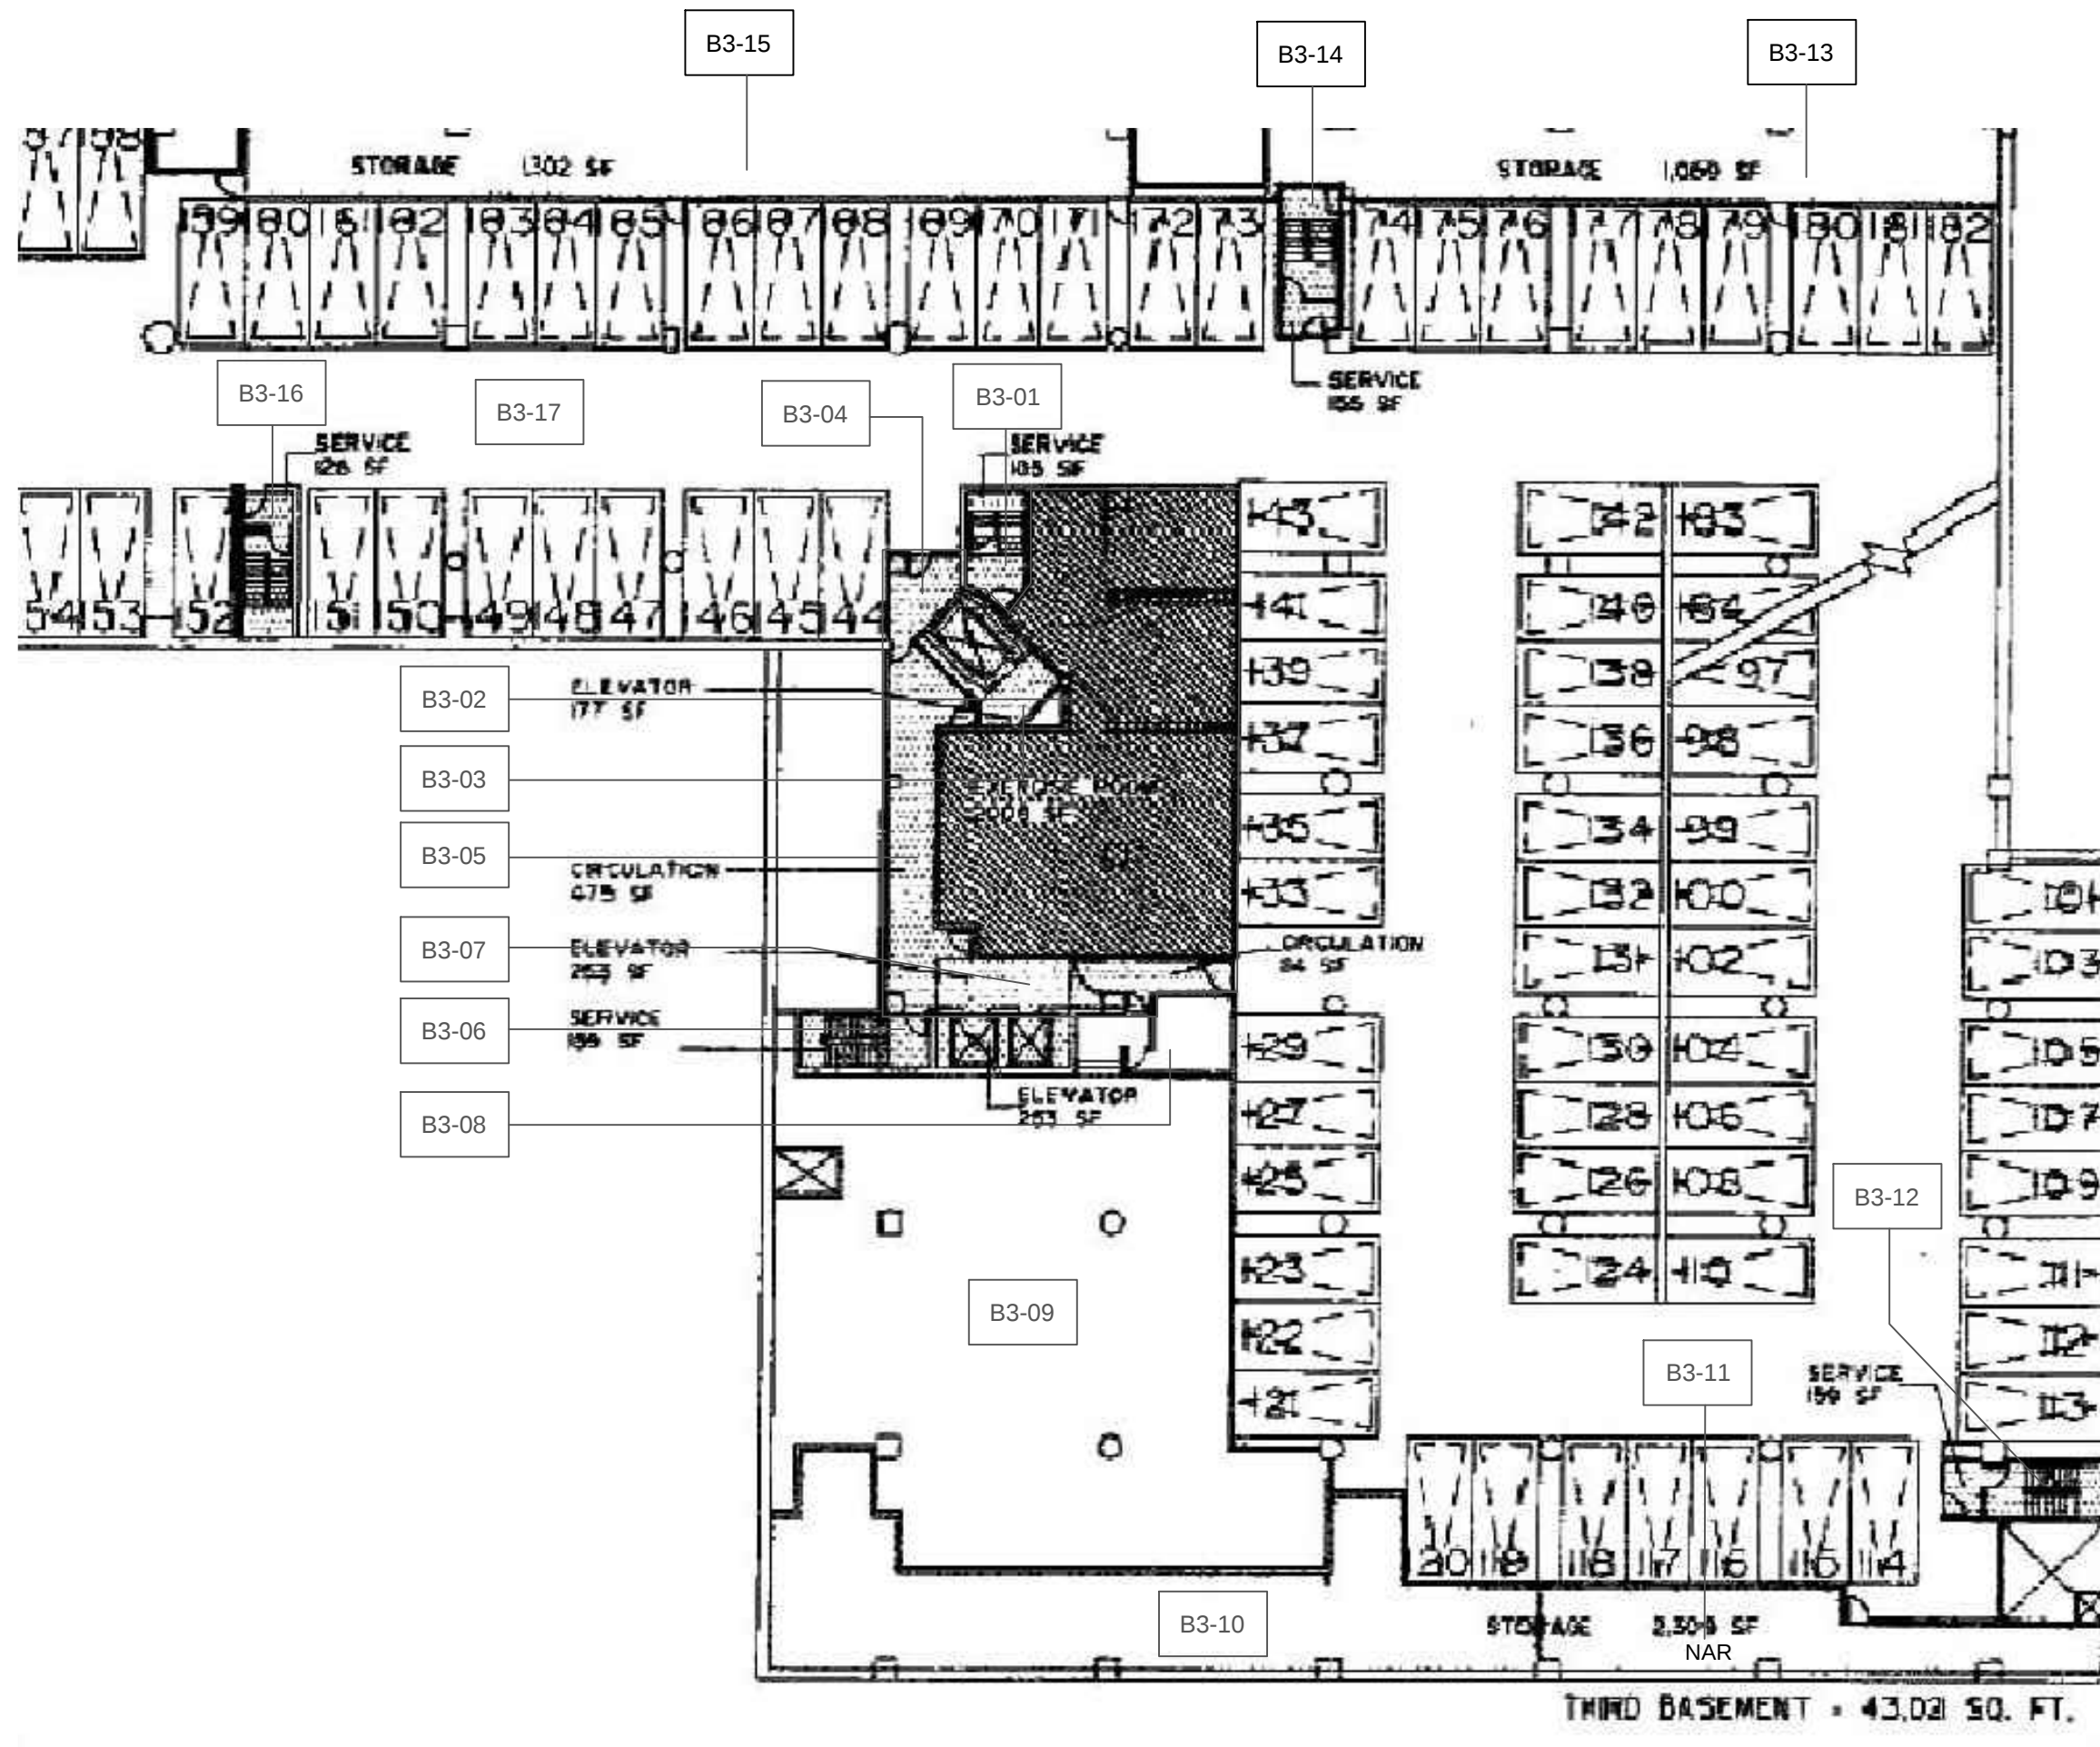

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
B3 FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM

3 OF 18

SCALE:

NTS

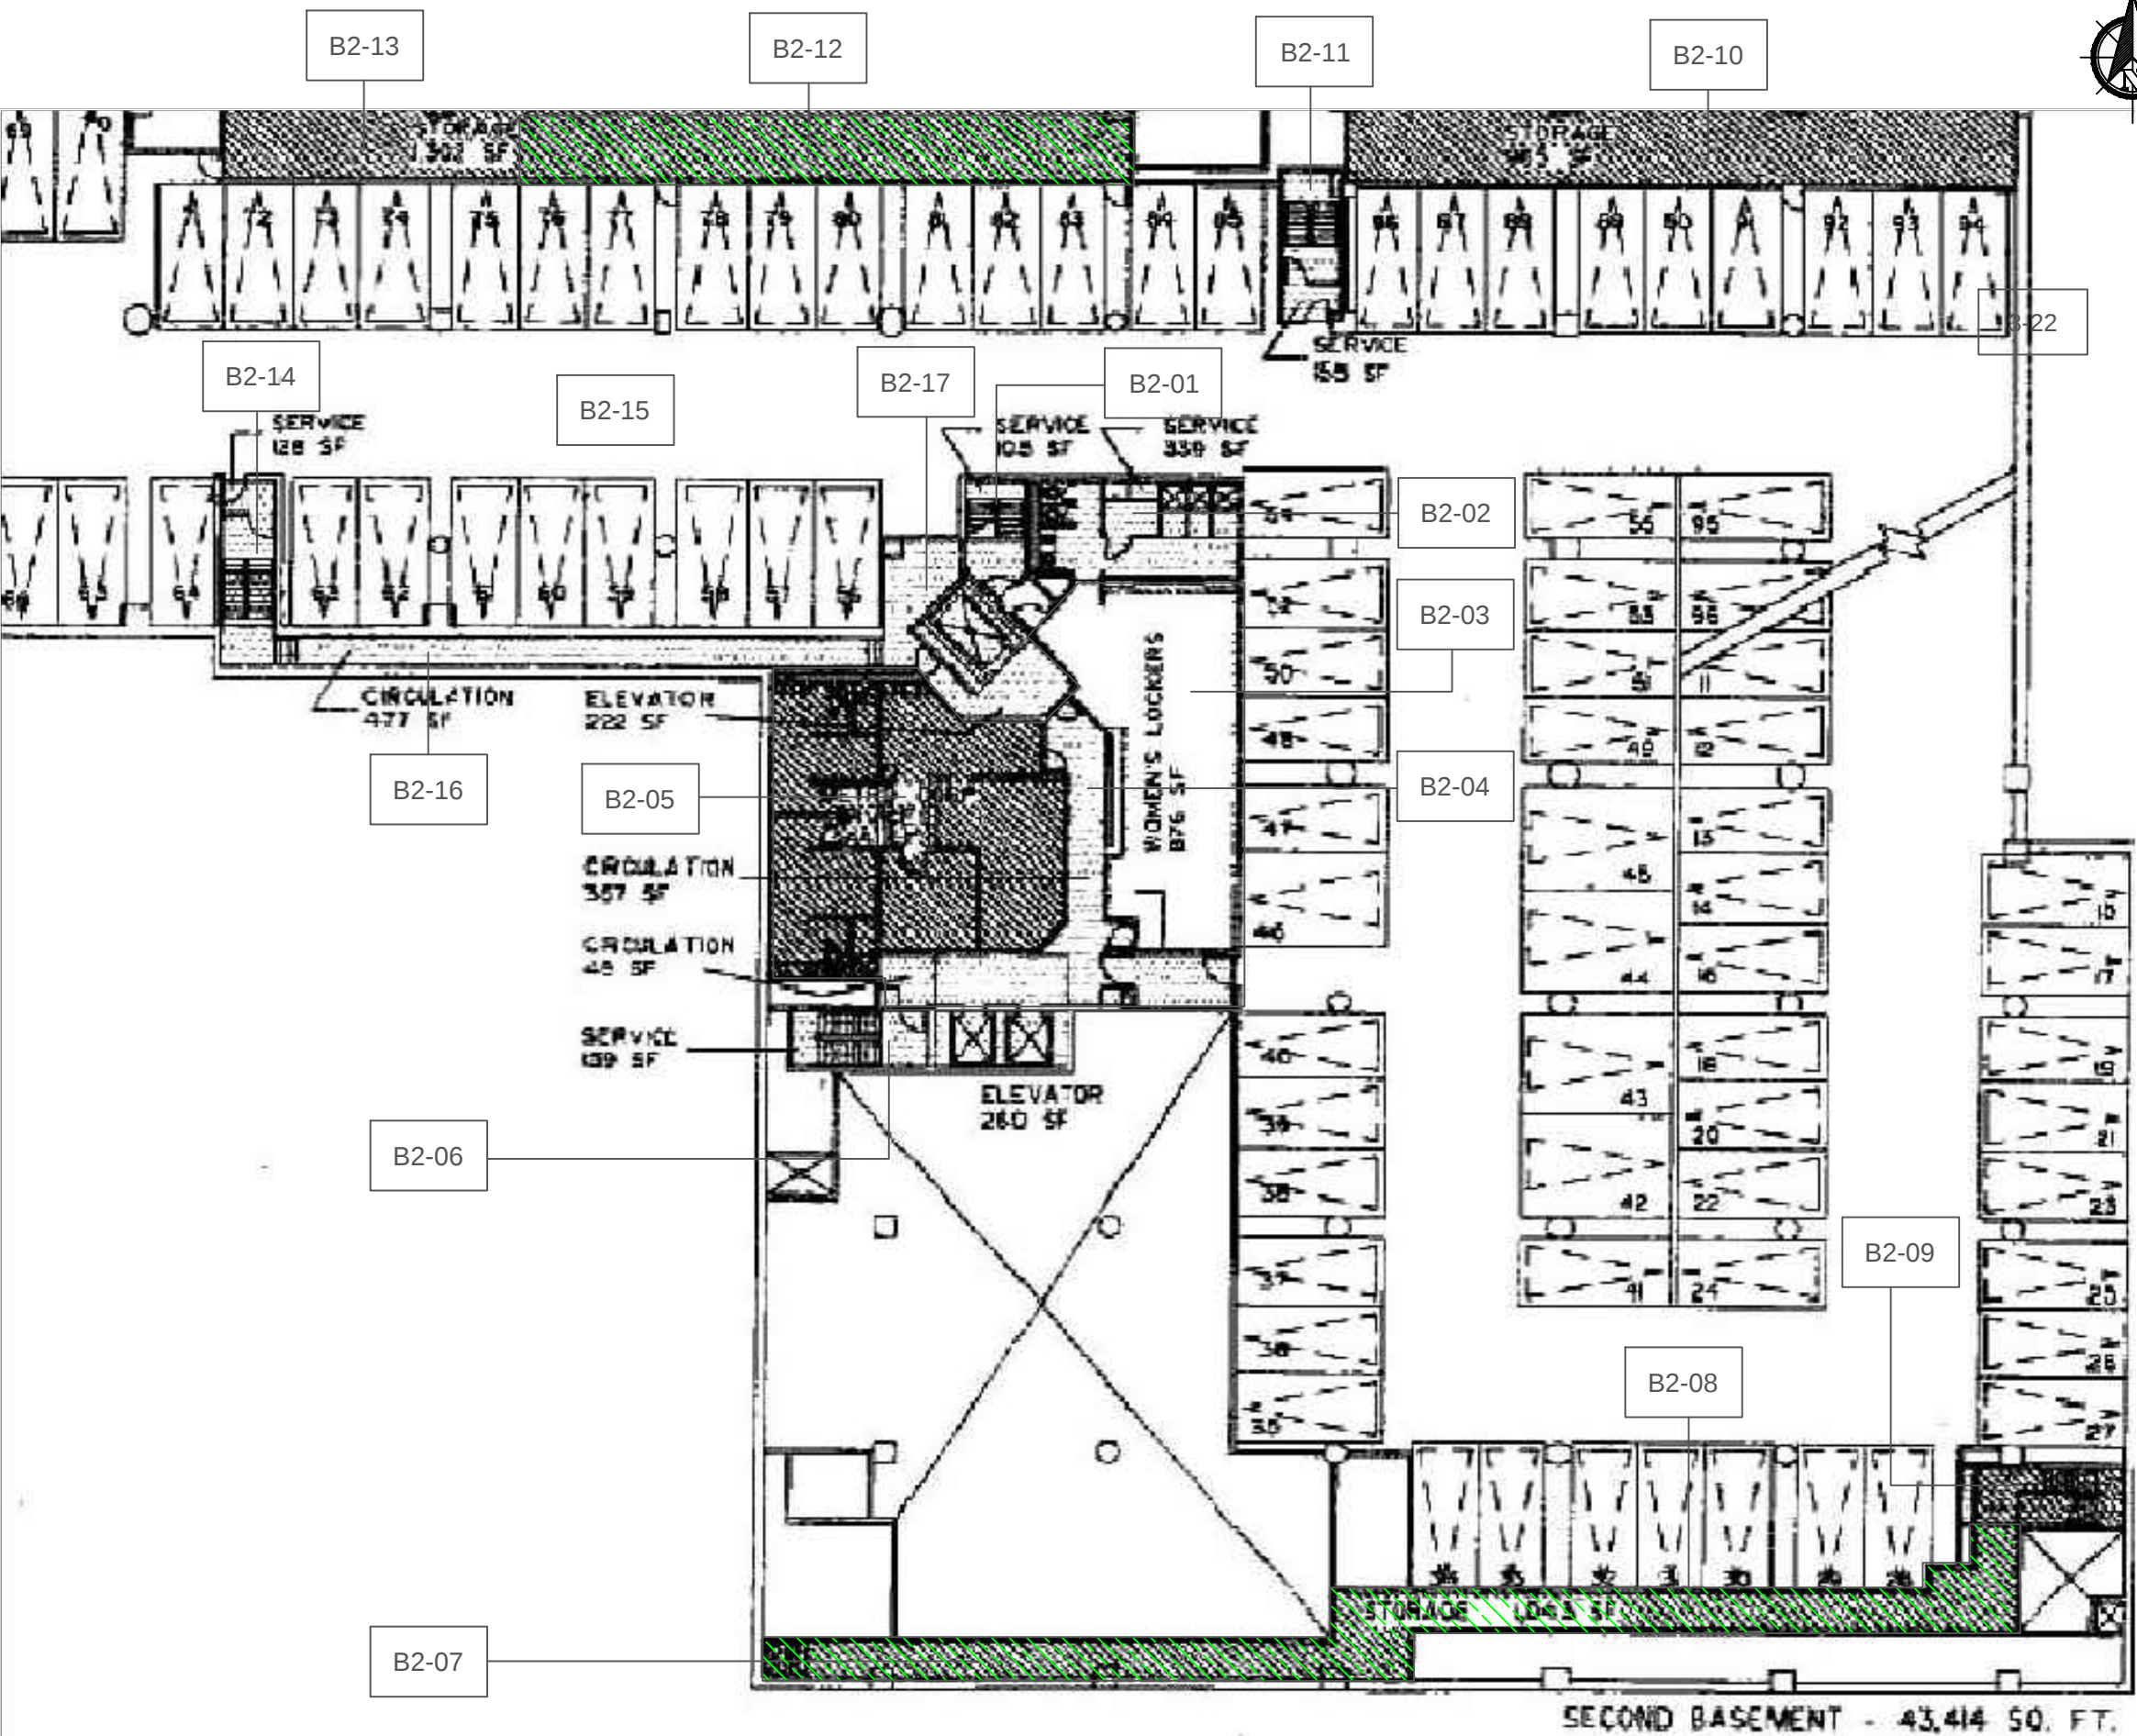

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:		POLICE SERVICES CITY OF TORONTO
LOCATION:		POLICE HEADQUARTERS 40 COLLEGE STREET TORONTO, ONTARIO
TITLE:		HAZARDOUS BUILDING MATERIALS ASSESSMENT B2 FLOOR
DATE:	2015/09/03	PROJECT # : 103037
DRAWN BY:	GH	DRAWING: 4 OF 18
CHECKED BY:	JM	
SCALE:	NTS	



LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
B1 FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:


JM

SCALE:

NTS

5 OF 18

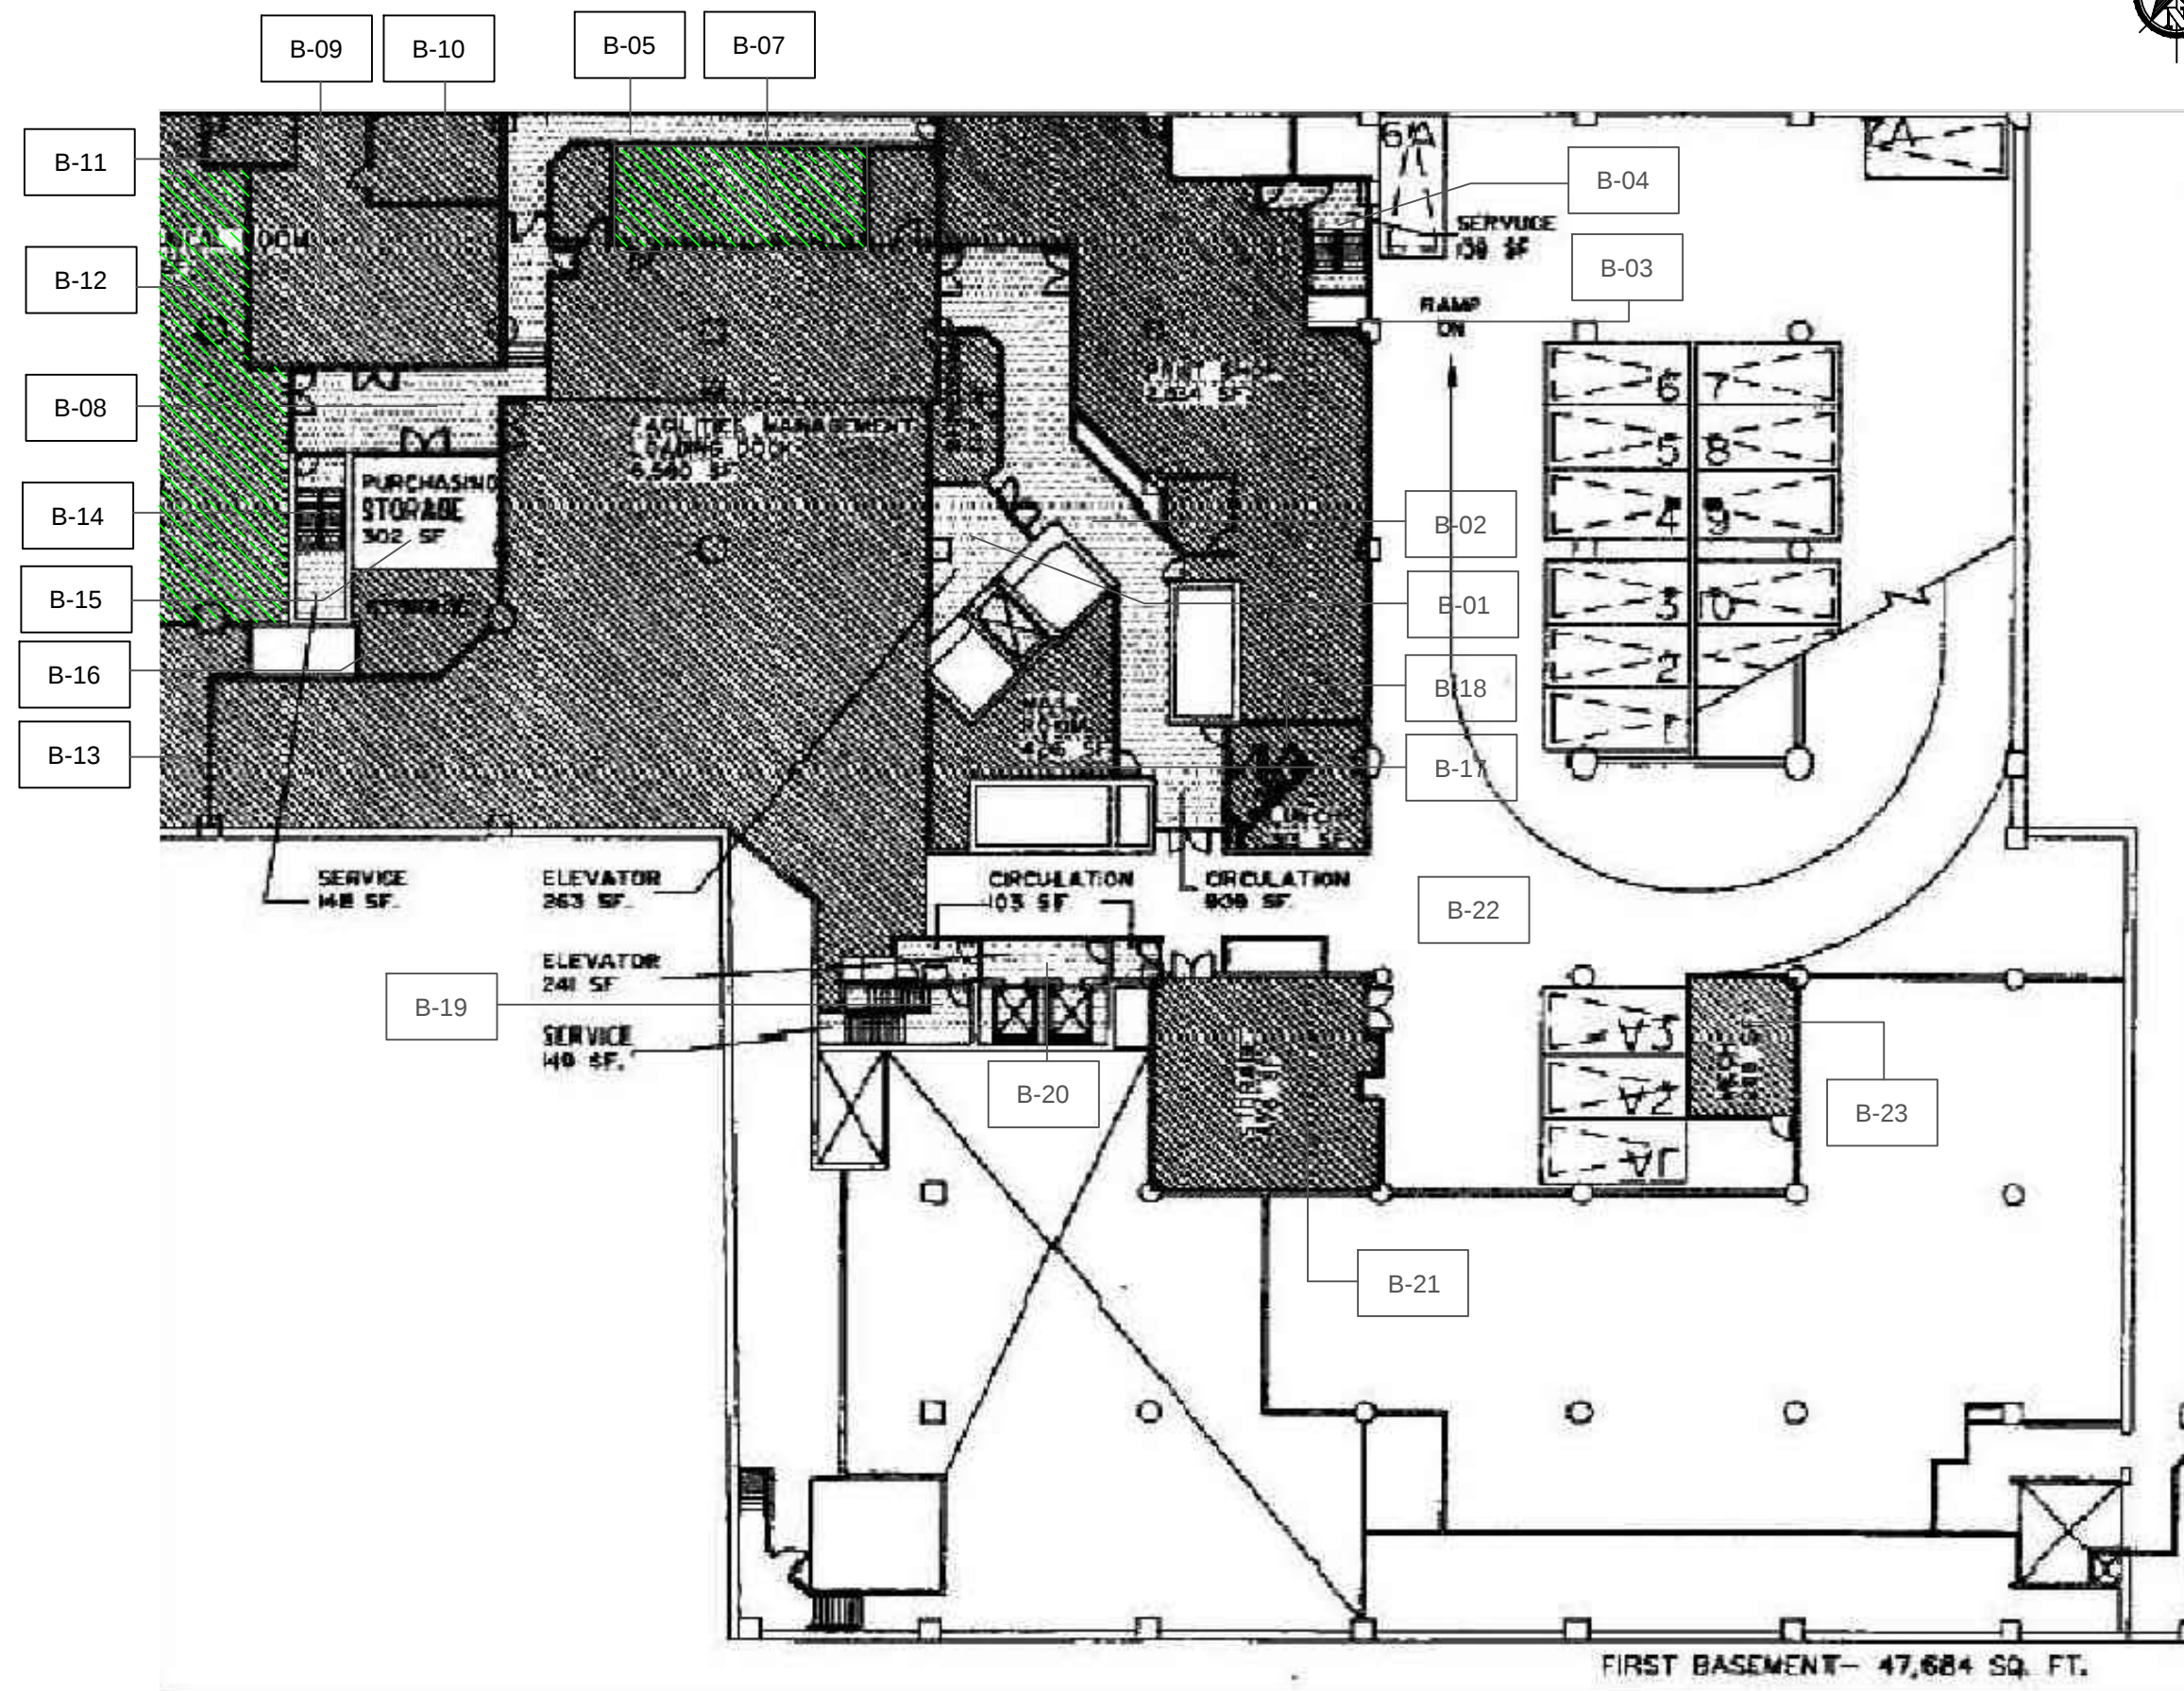

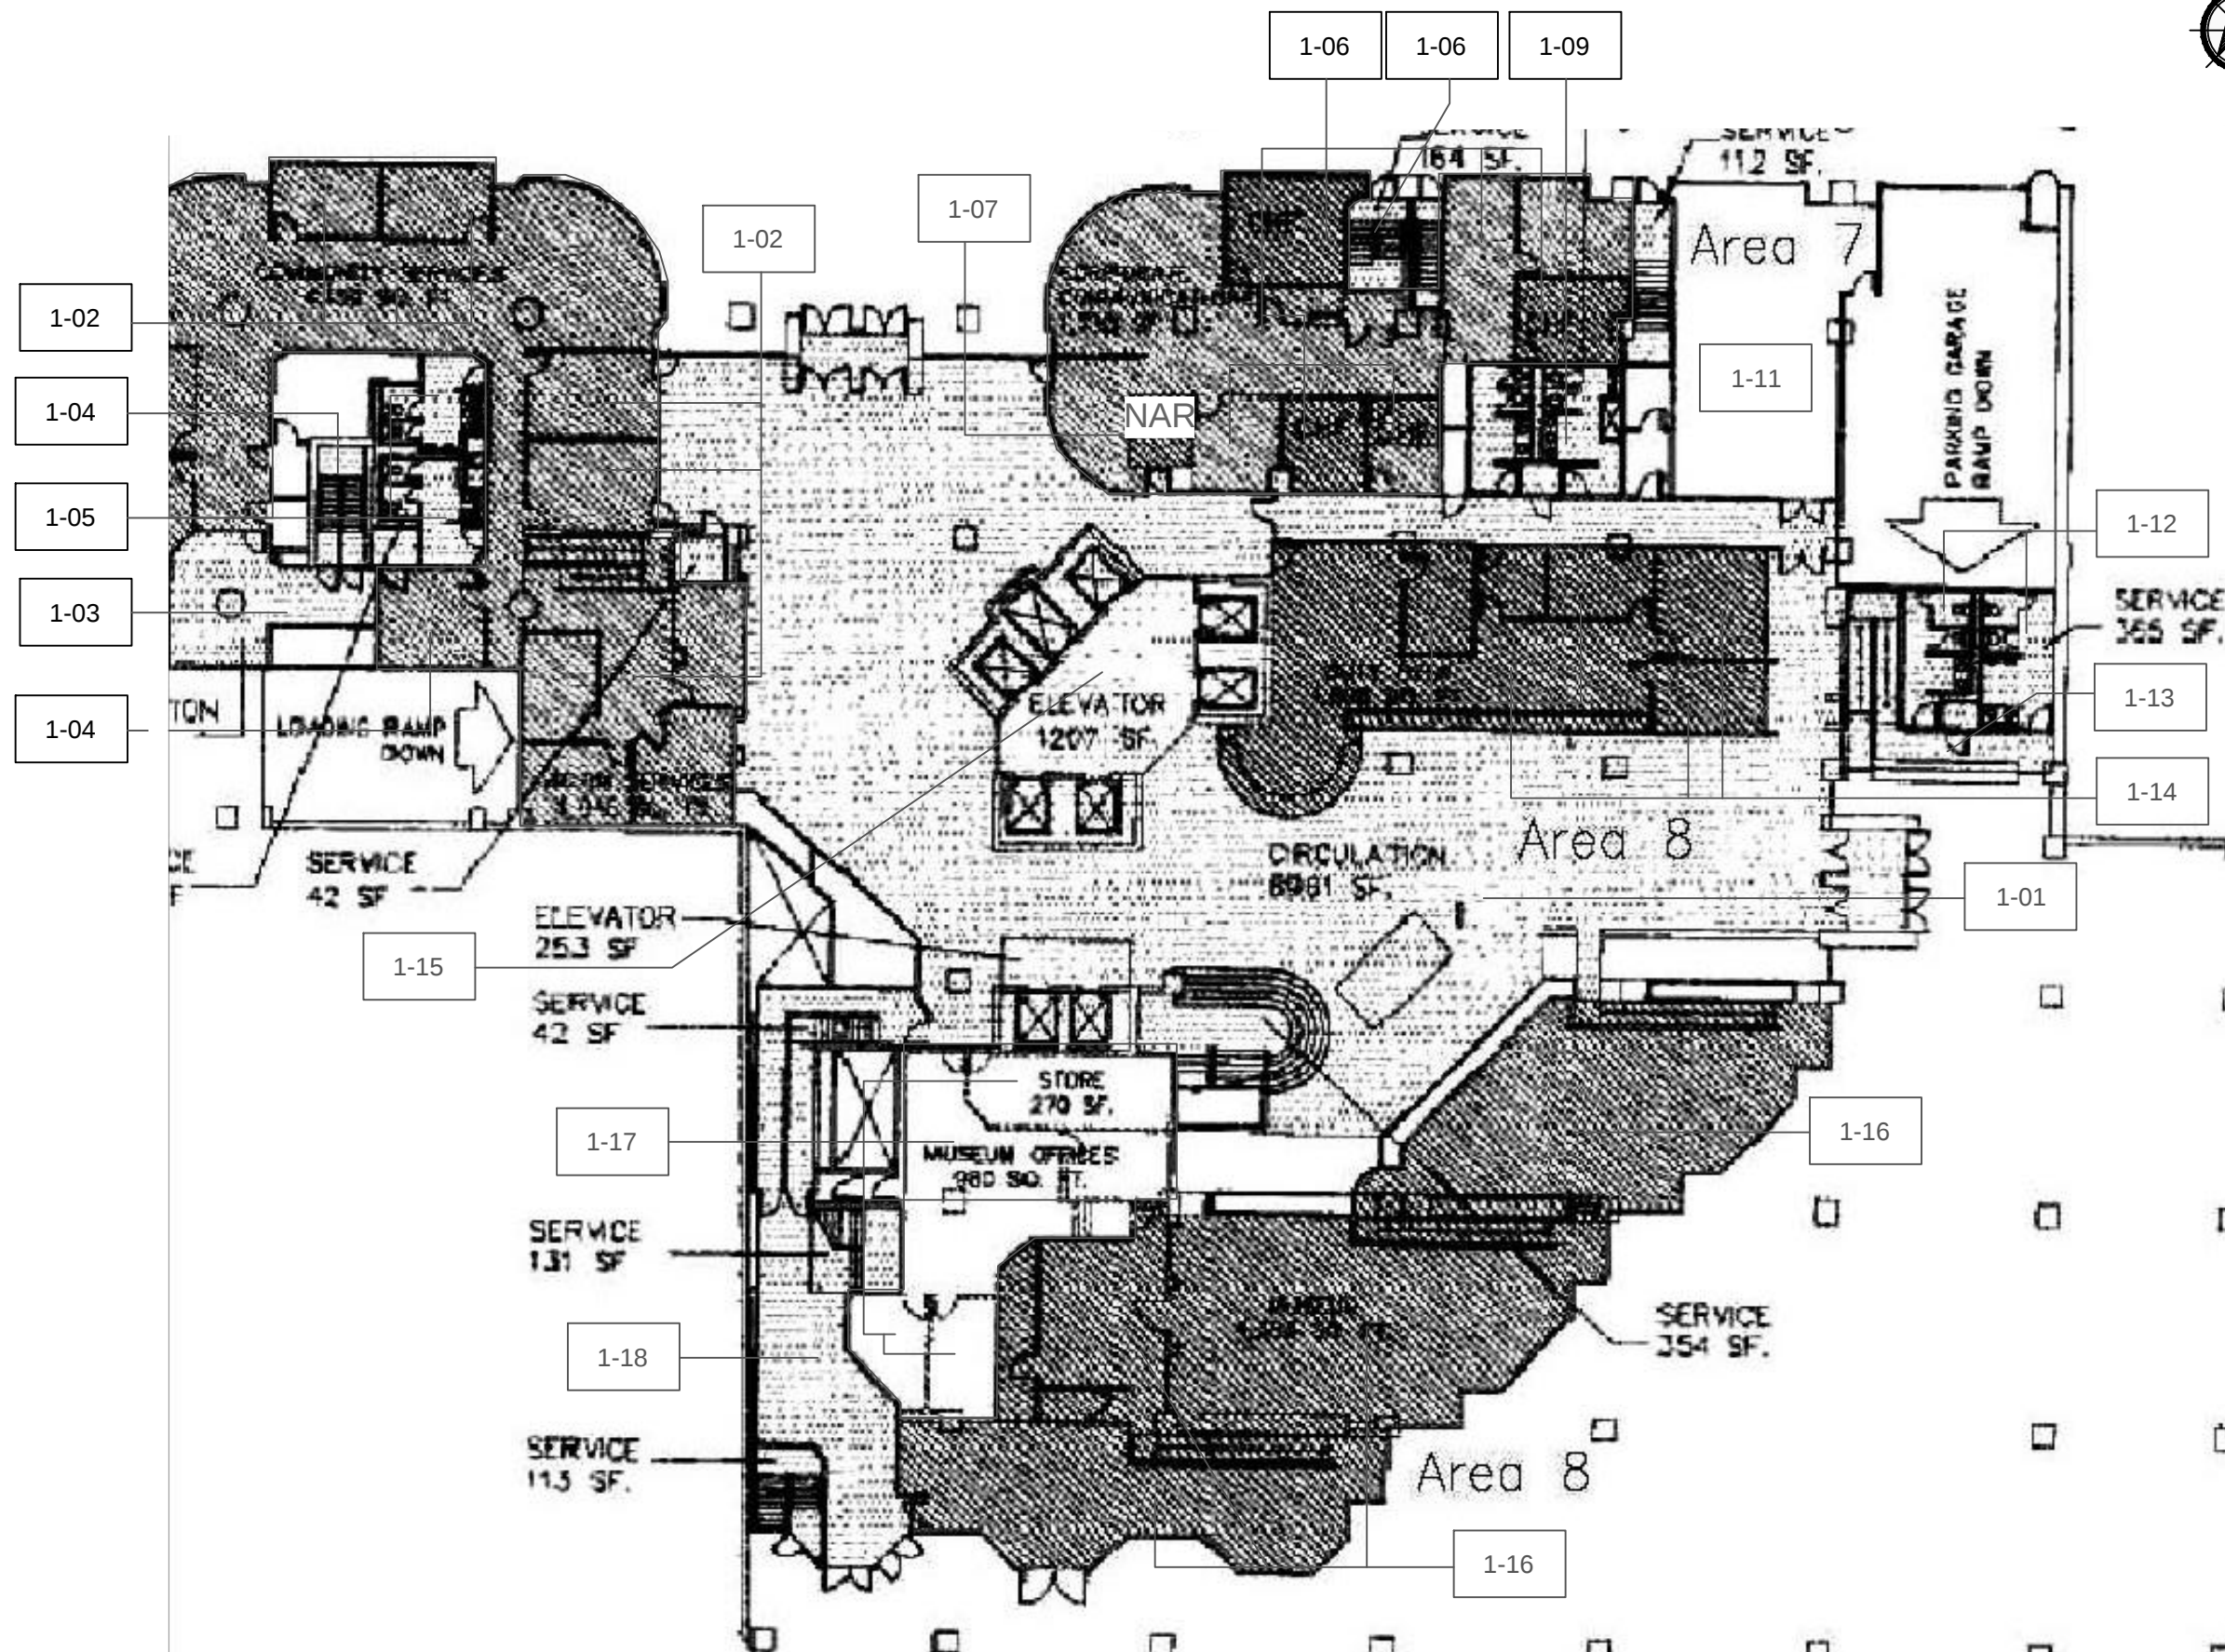

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
GROUND FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM

SCALE:

NTS

6 OF 18

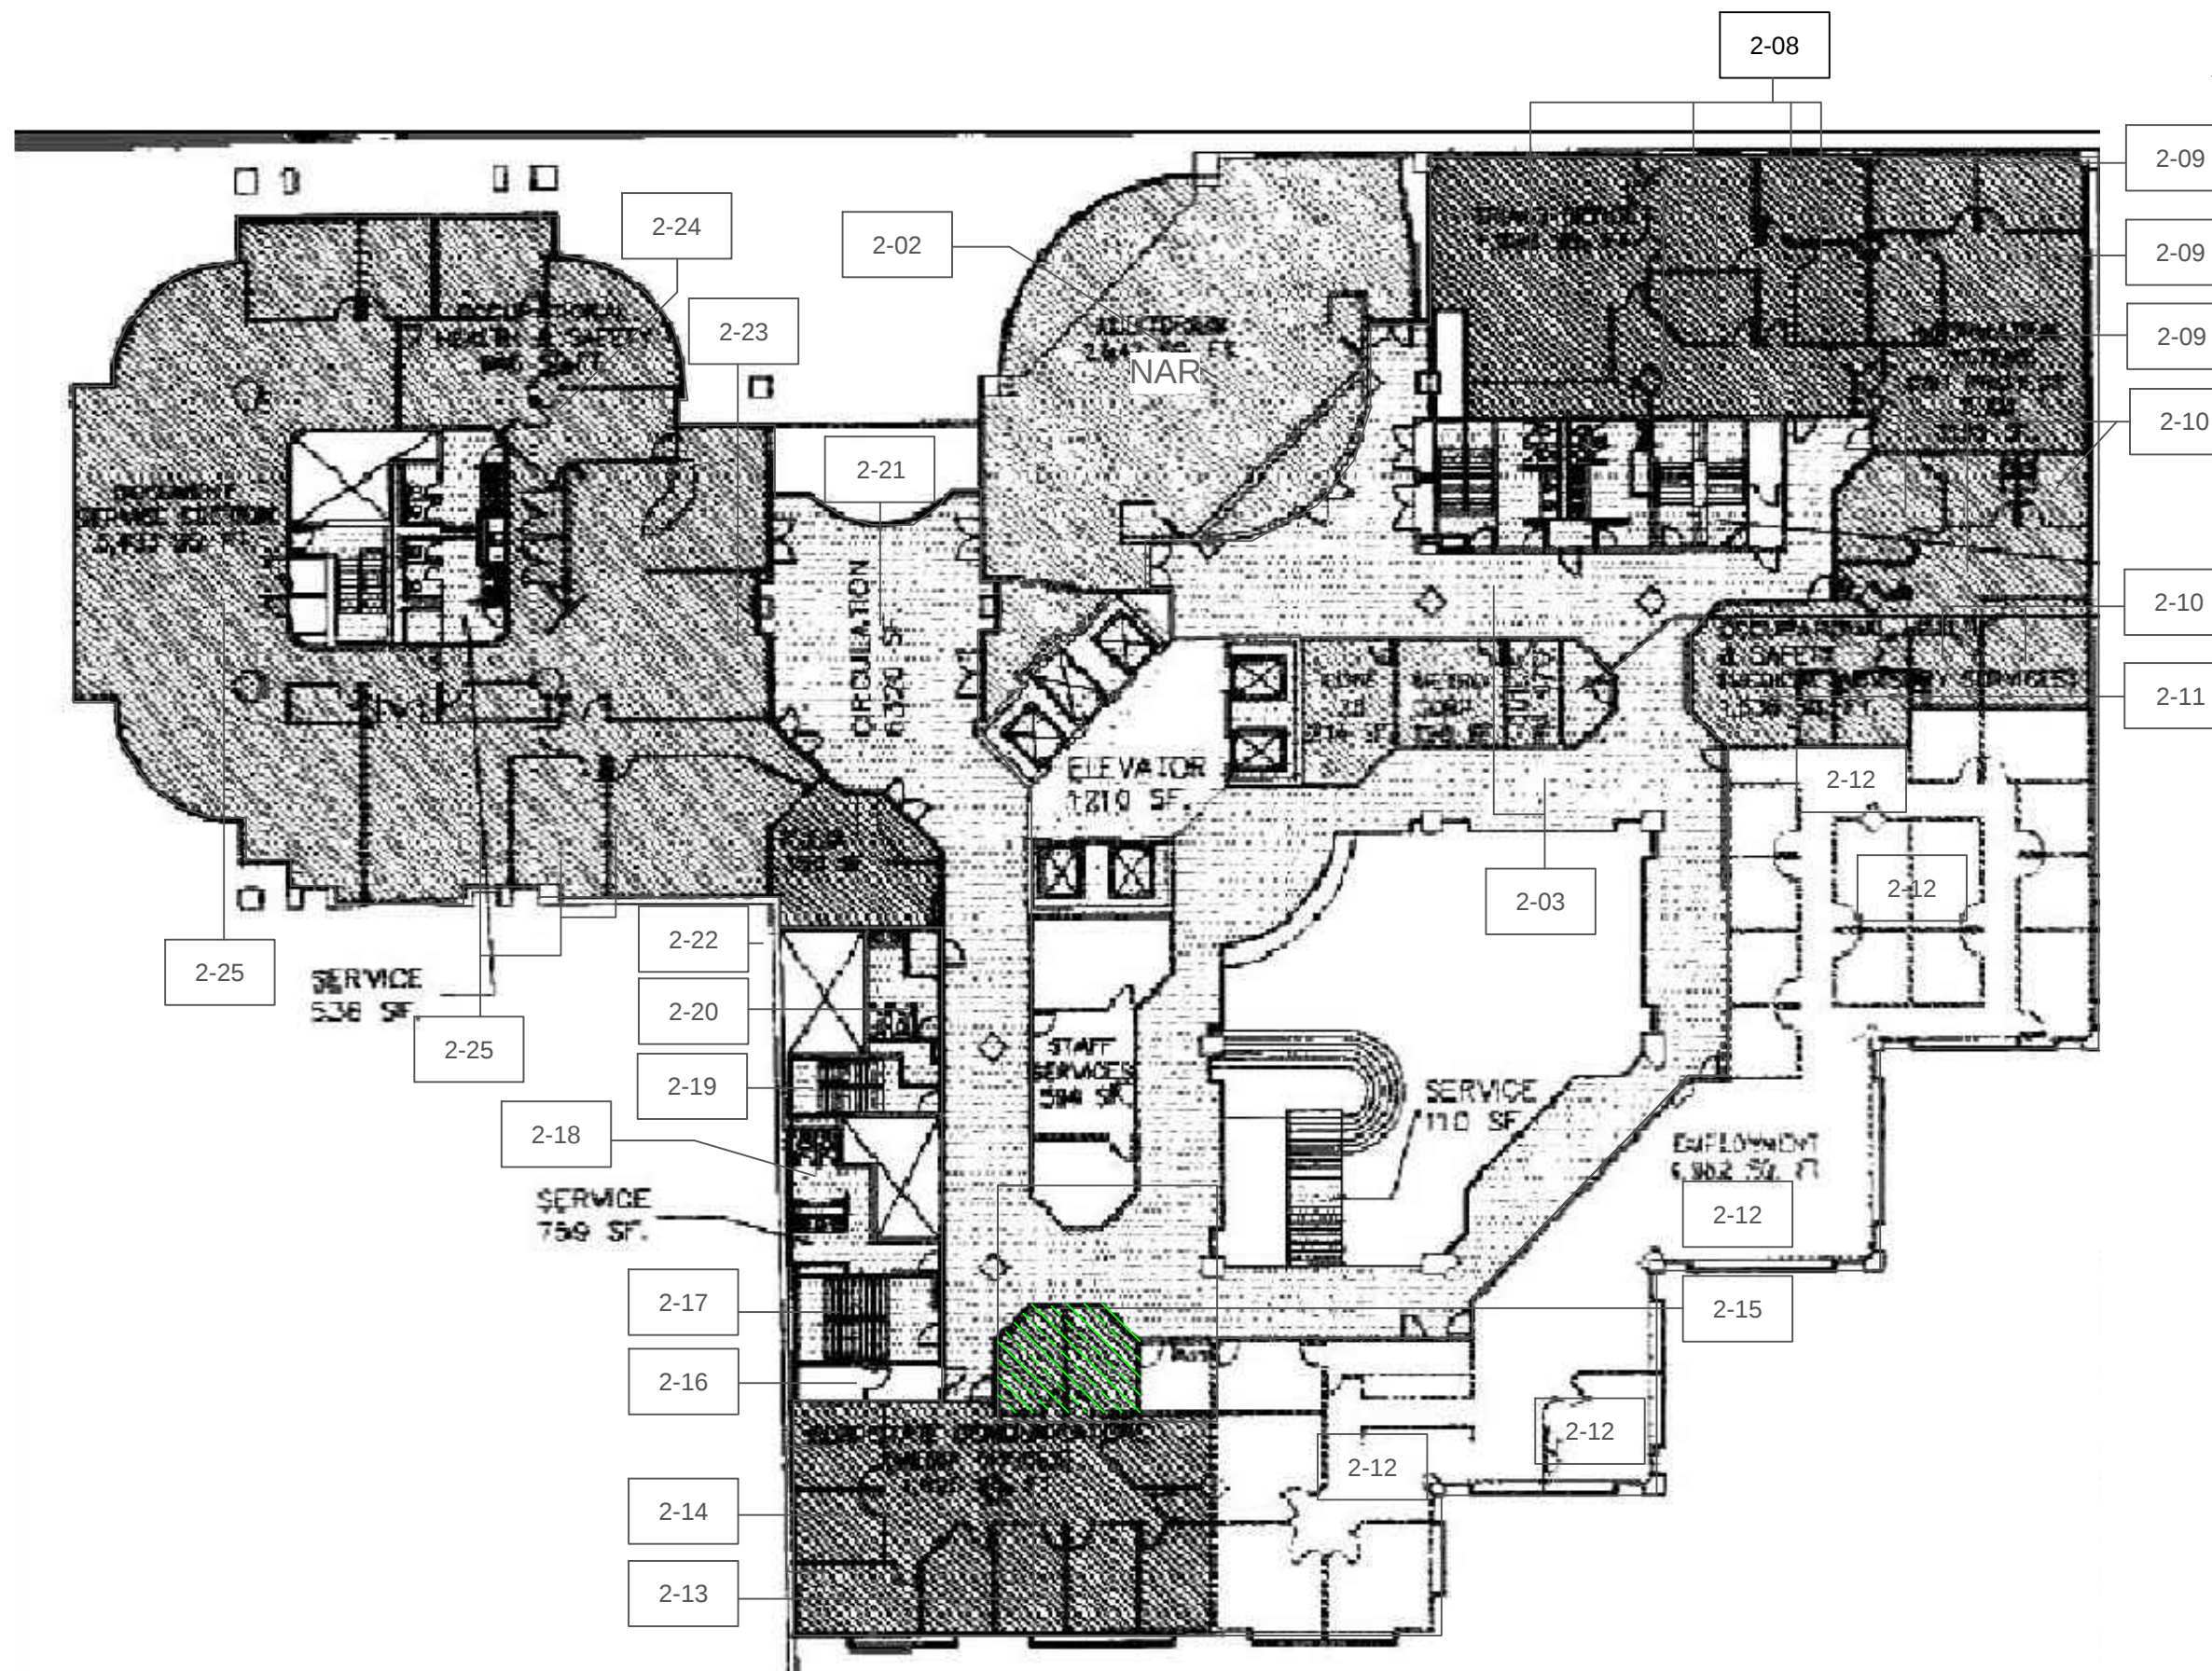

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:
POLICE SERVICES
CITY OF TORONTO

LOCATION:
POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:
HAZARDOUS BUILDING
MATERIALS ASSESSMENT
SECOND FLOOR

DATE:
2015/09/03

PROJECT # :
103037


DRAWN BY:
GH

CHECKED BY:
JM

SCALE:
NTS

DRAWING:

7 OF 18

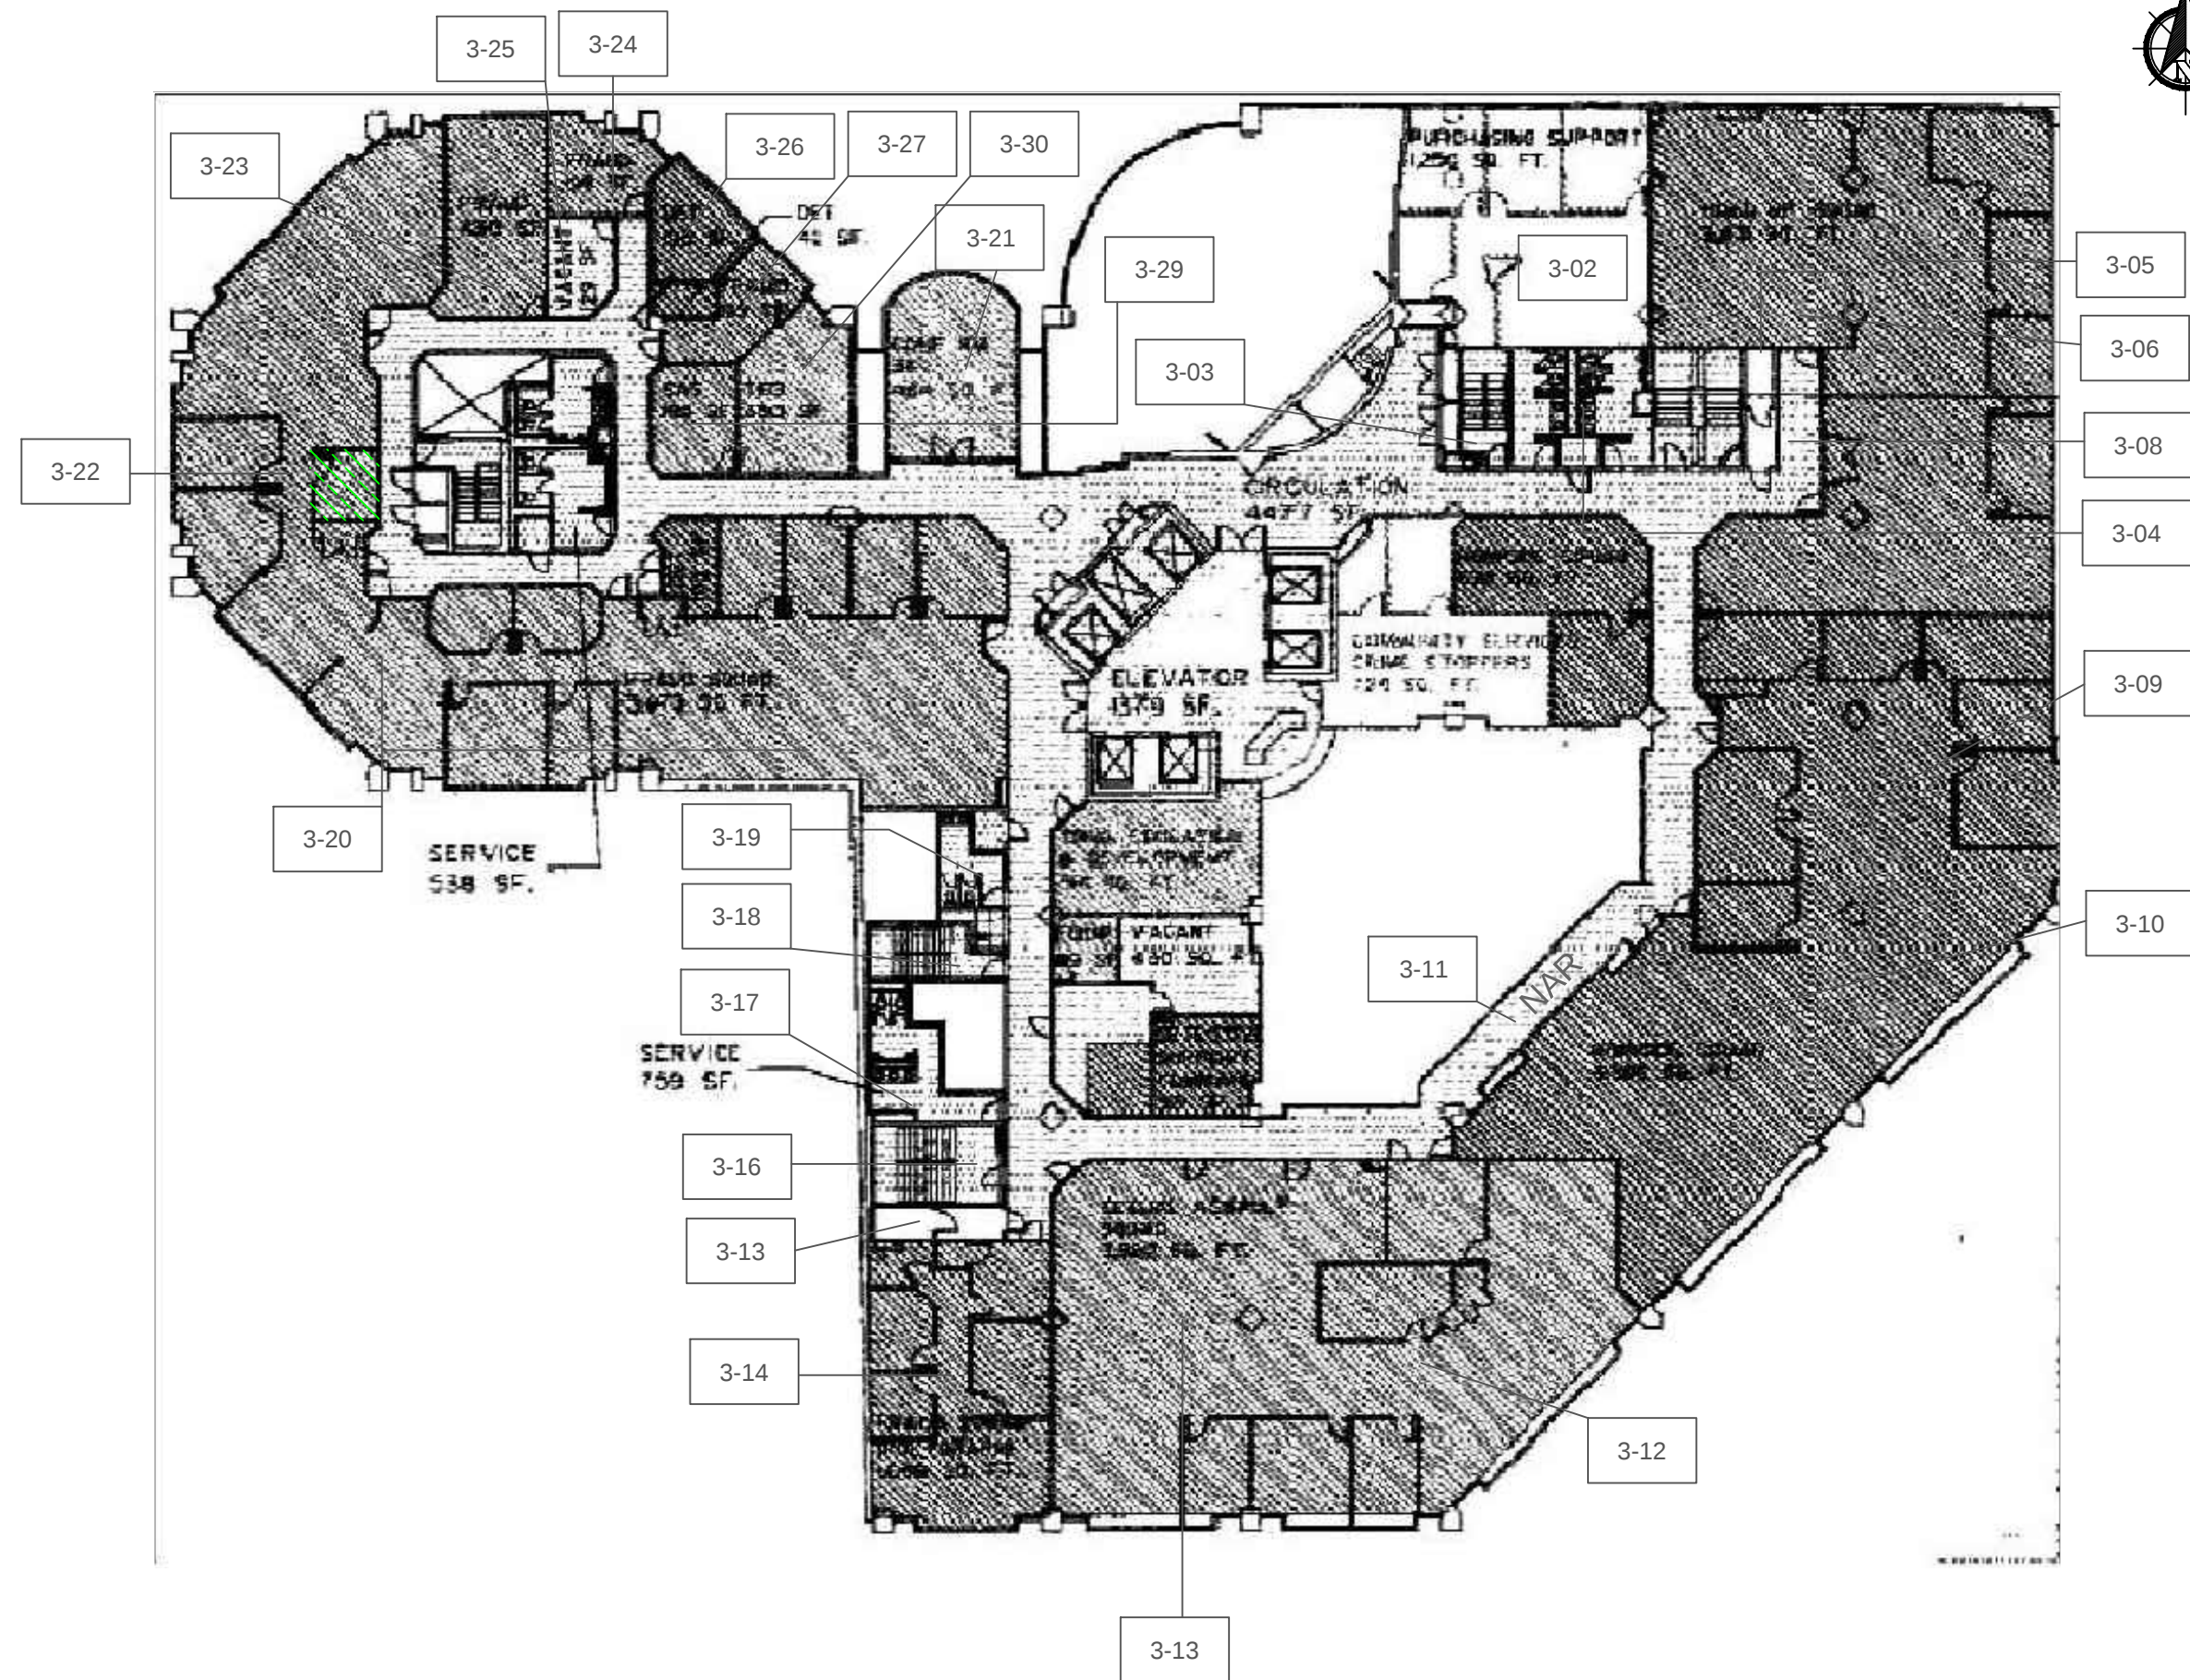

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:


CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:		POLICE SERVICES CITY OF TORONTO
LOCATION:		POLICE HEADQUARTERS 40 COLLEGE STREET TORONTO, ONTARIO
TITLE:		HAZARDOUS BUILDING MATERIALS ASSESSMENT THIRD FLOOR
DATE:	2015/09/03	PROJECT # : 103037
DRAWN BY:	GH	8 OF 18
CHECKED BY:	JM	
SCALE:	NTS	

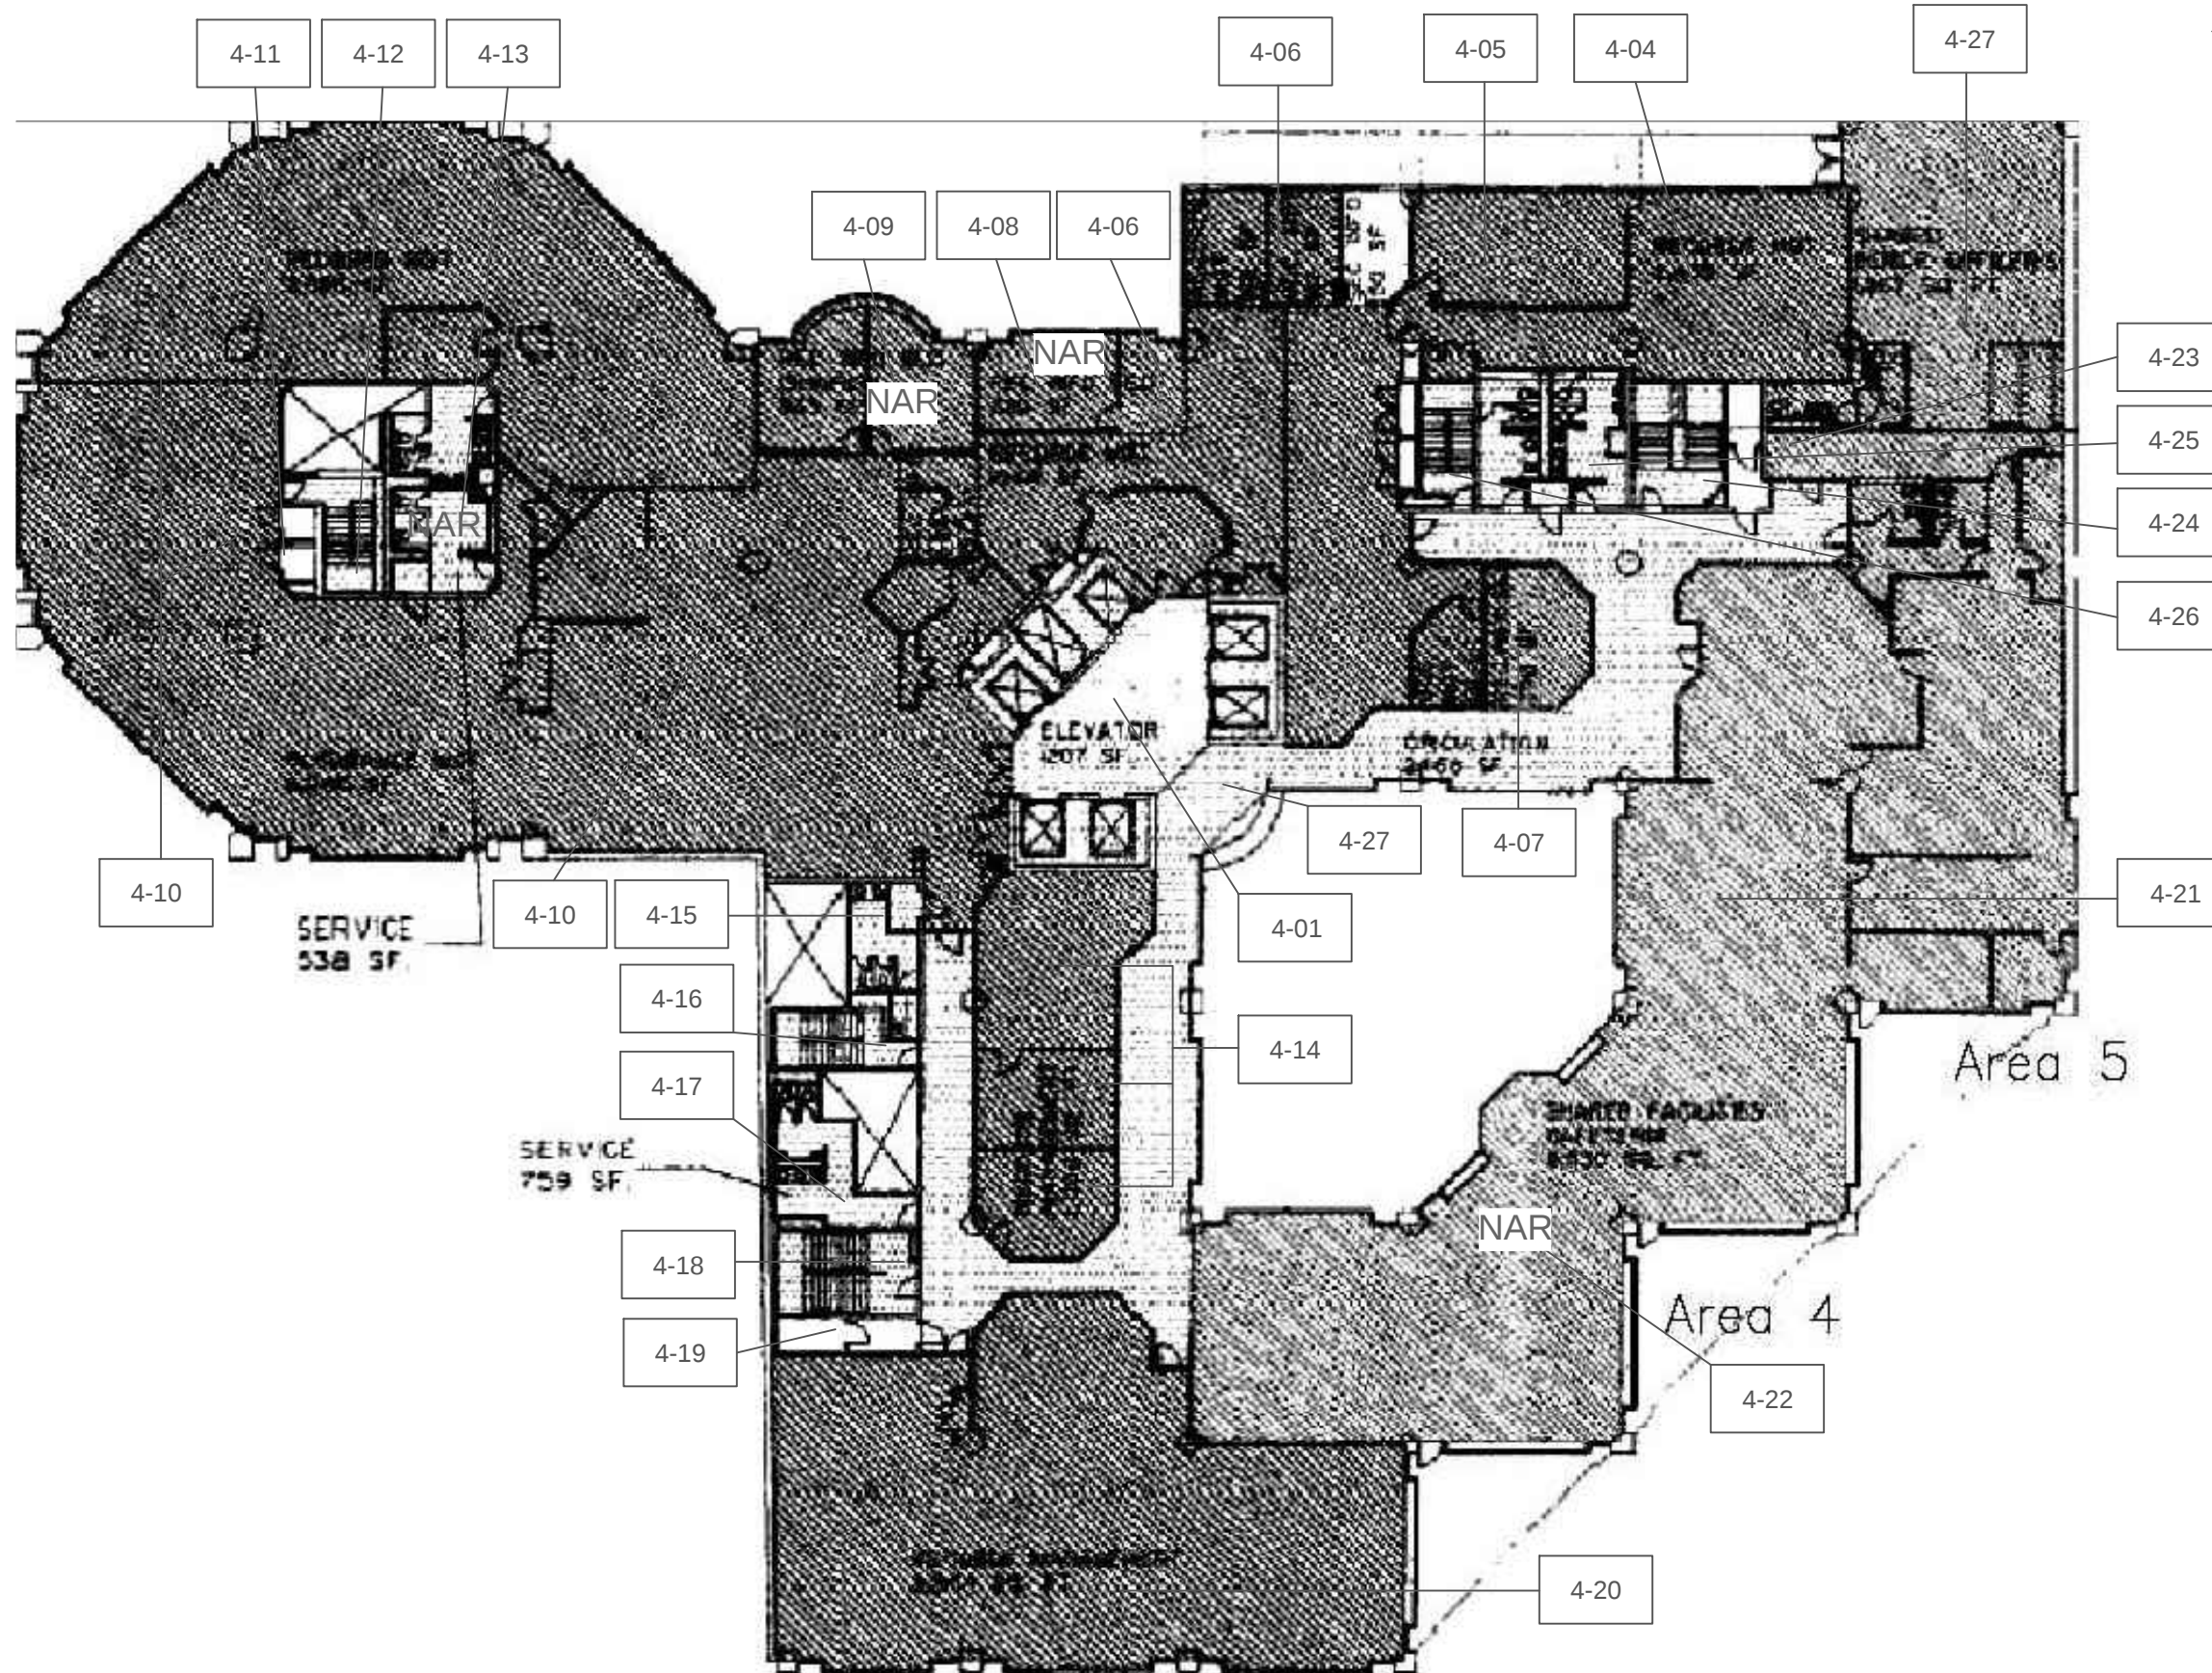

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:
POLICE SERVICES
CITY OF TORONTO

LOCATION:
POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:
HAZARDOUS BUILDING
MATERIALS ASSESSMENT
FOURTH FLOOR

DATE:
2015/09/03

PROJECT # :
103037


DRAWN BY:
GH

CHECKED BY:
JM

SCALE:
NTS

DRAWING:

9 OF 18

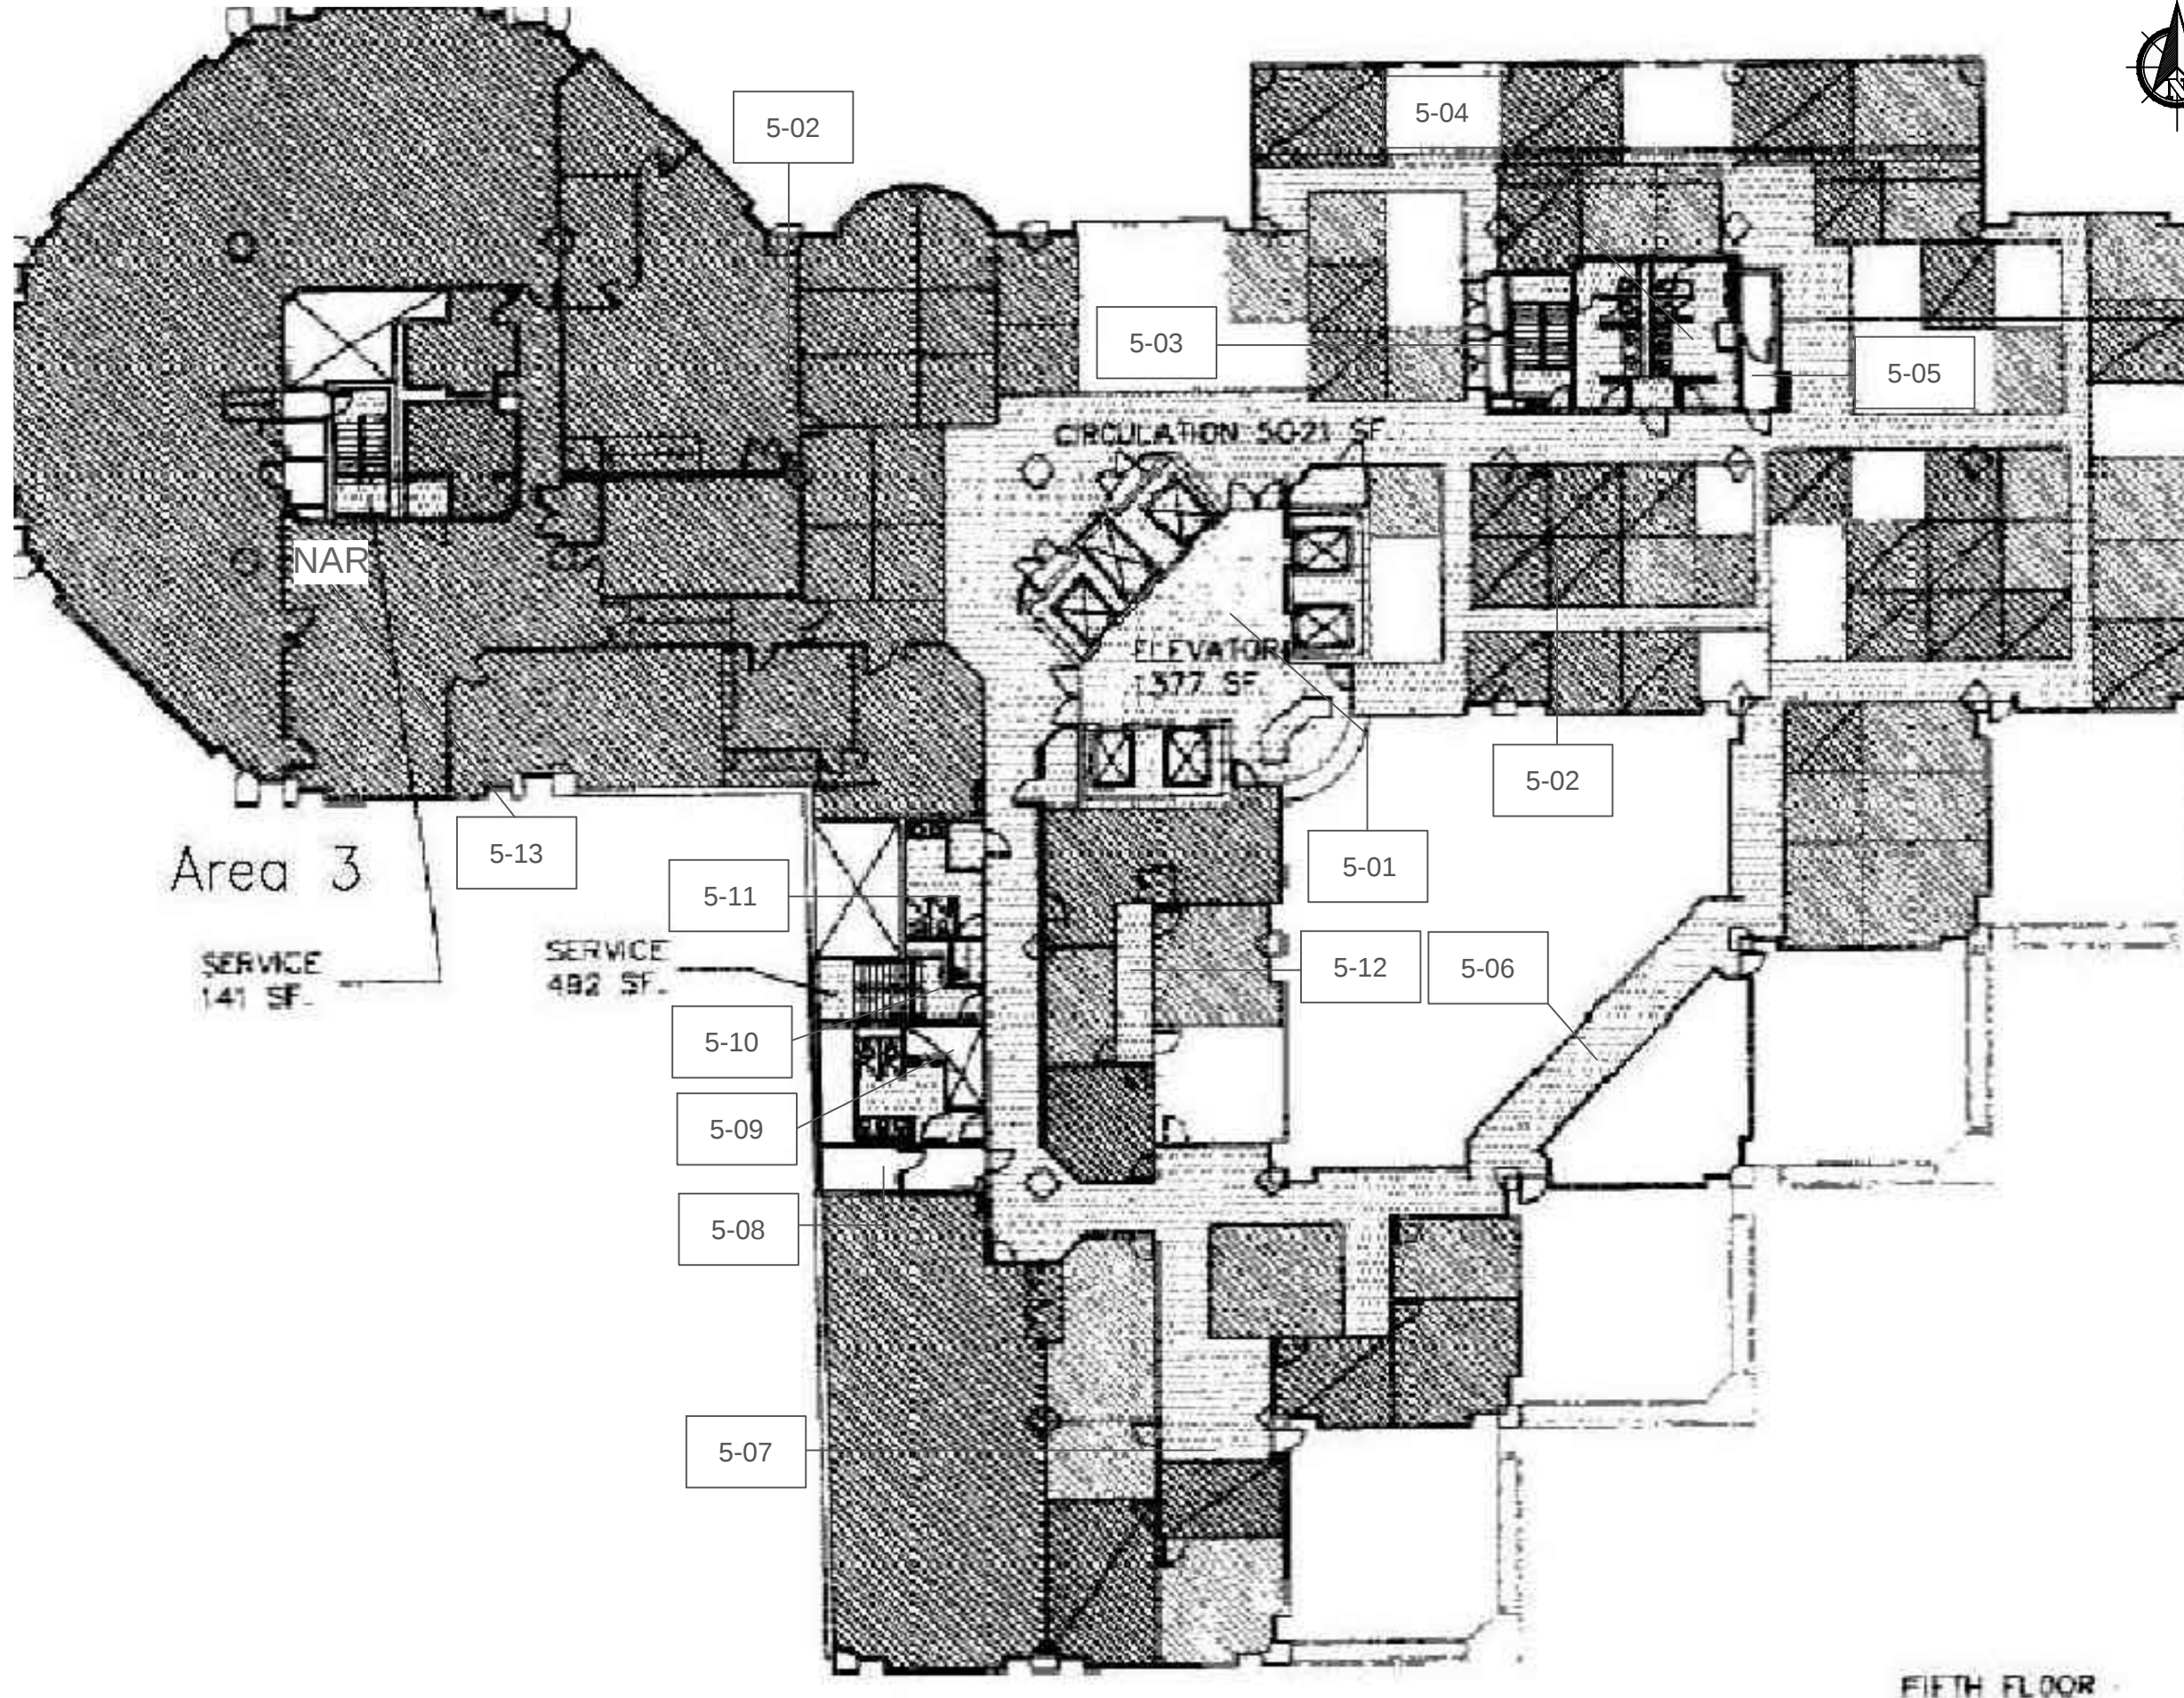

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
FIFTH FLOOR

DATE:

2015/09/03

PROJECT #:

103037

DRAWN BY:

GH

DRAWING:

CHECKED BY:


JM

SCALE:

NTS

10 OF 18

FIFTH FLOOR

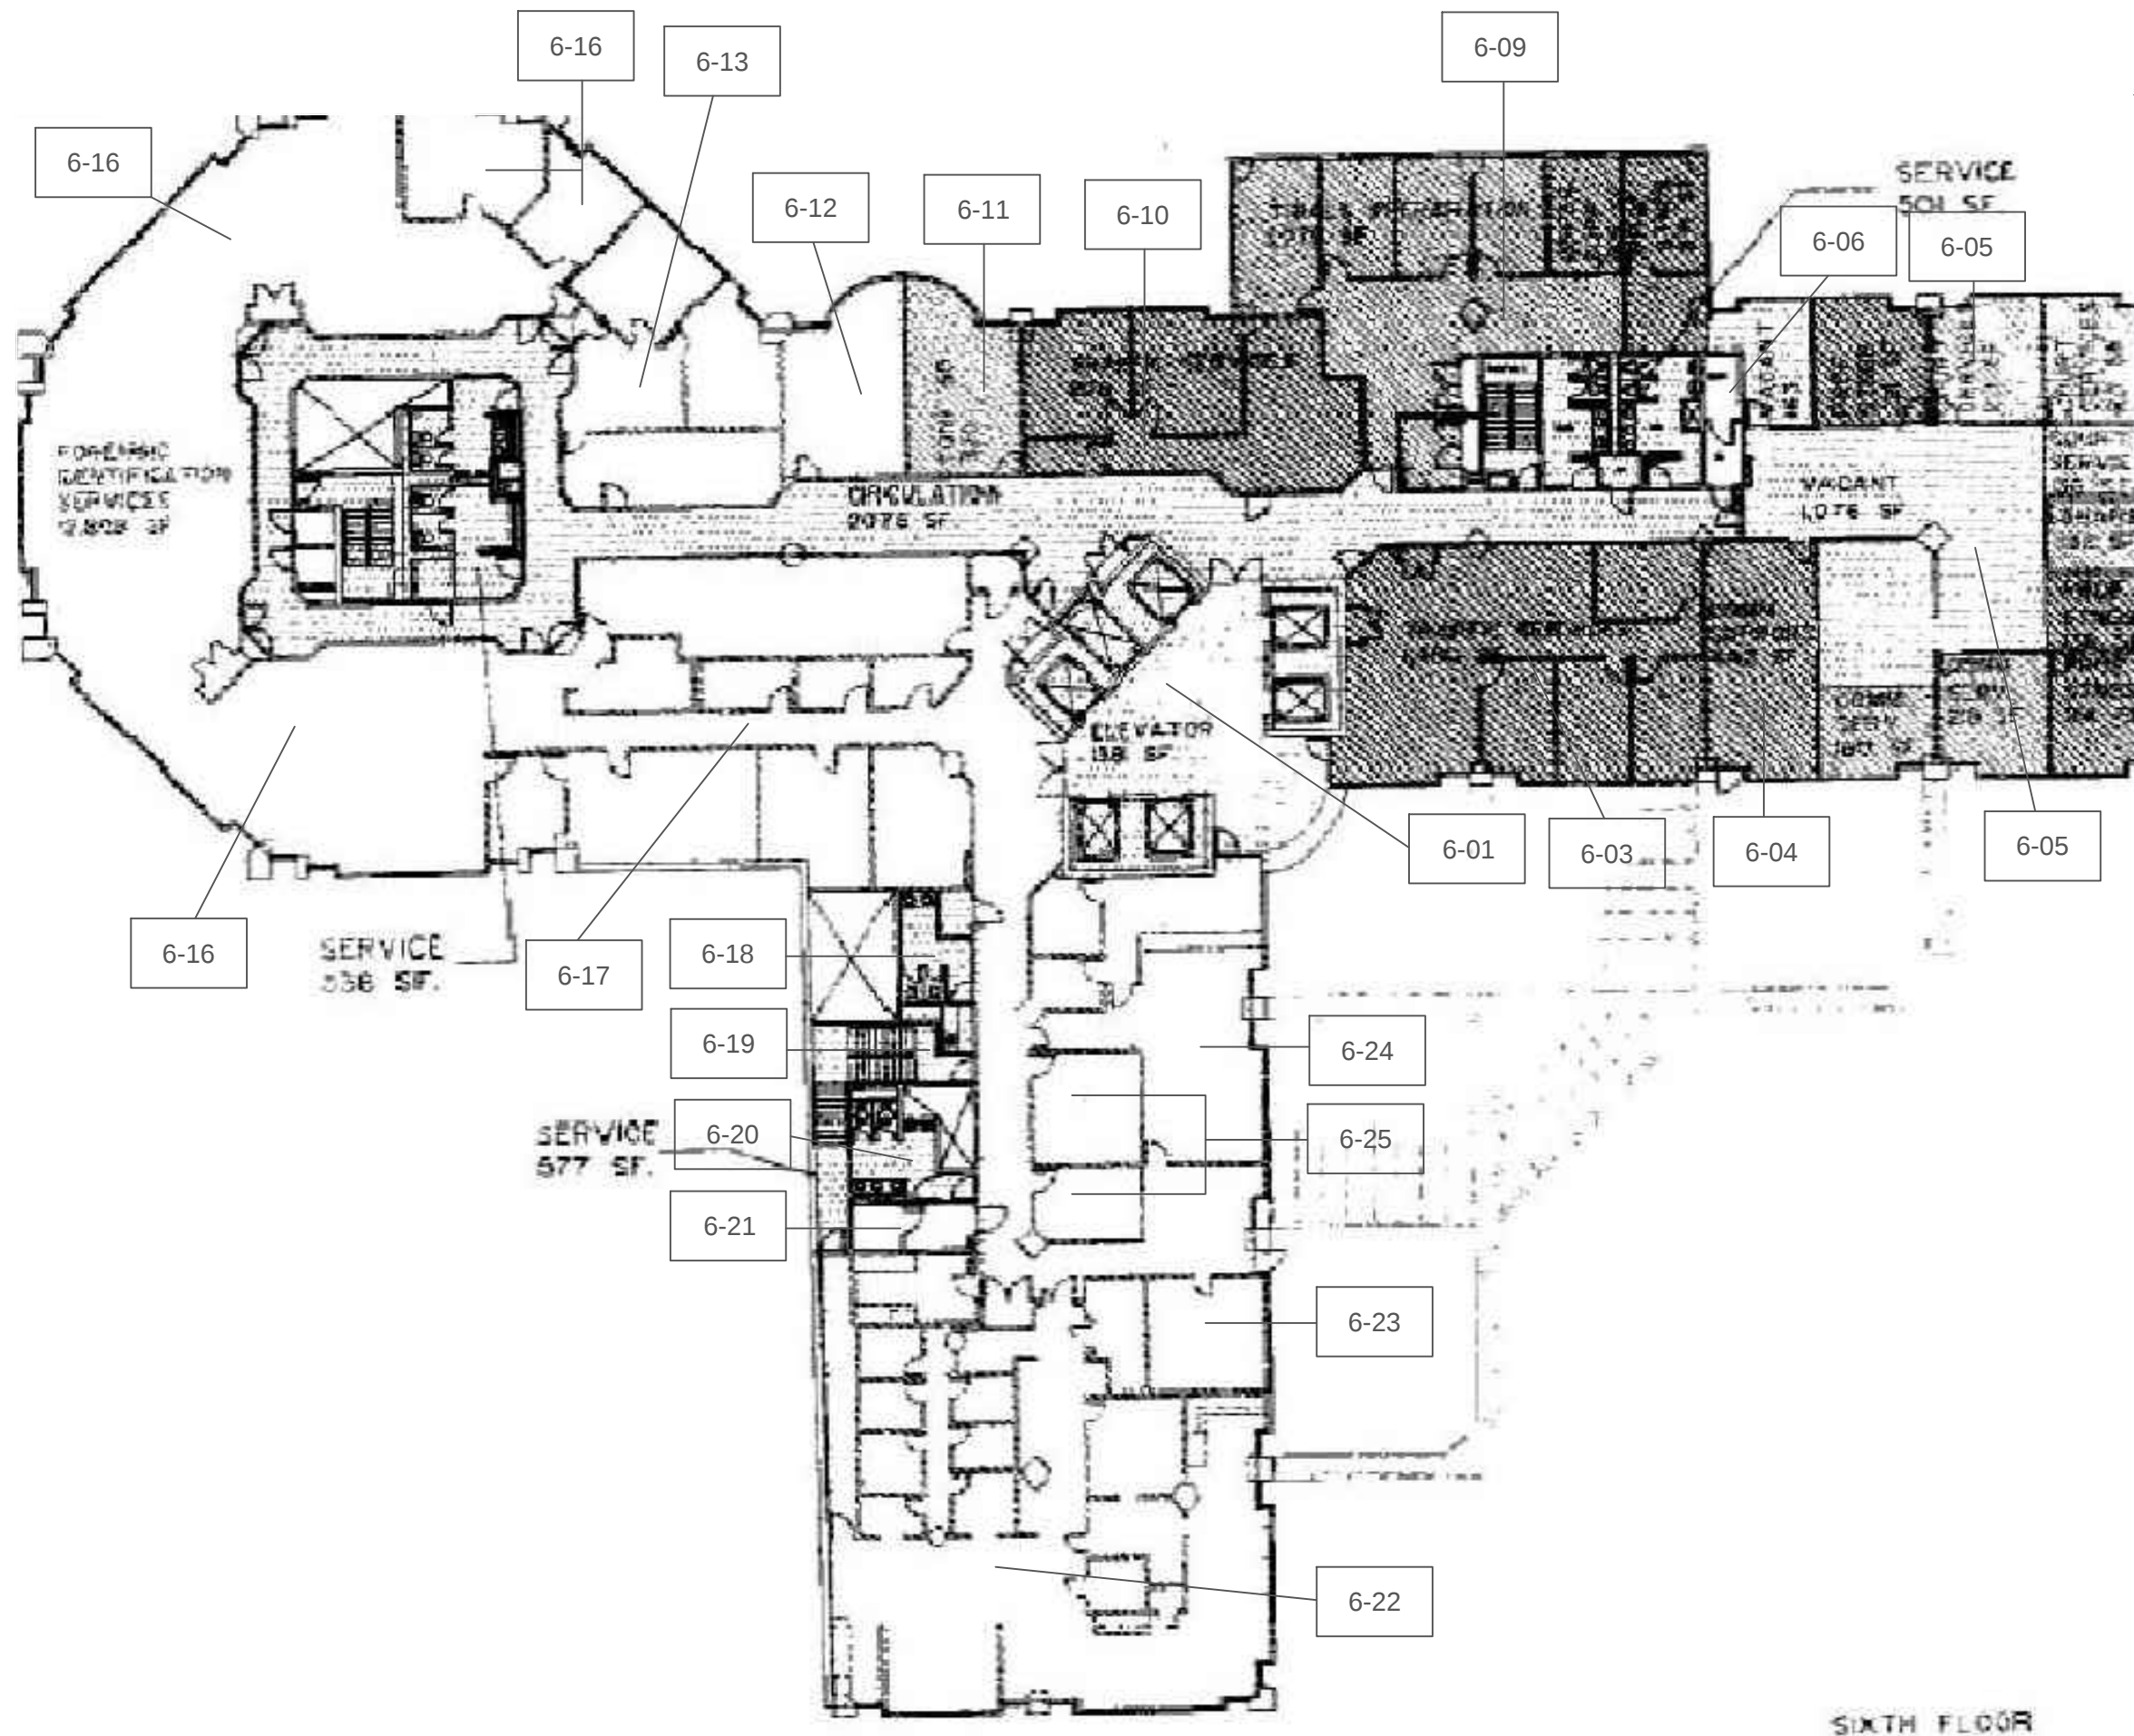

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:
POLICE SERVICES
CITY OF TORONTO

LOCATION:
POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:
HAZARDOUS BUILDING
MATERIALS ASSESSMENT
SIXTH FLOOR

DATE:
2015/09/03

PROJECT # :
103037


DRAWN BY:
GH

CHECKED BY:
JM

SCALE:
NTS

DRAWING:

11 OF 18

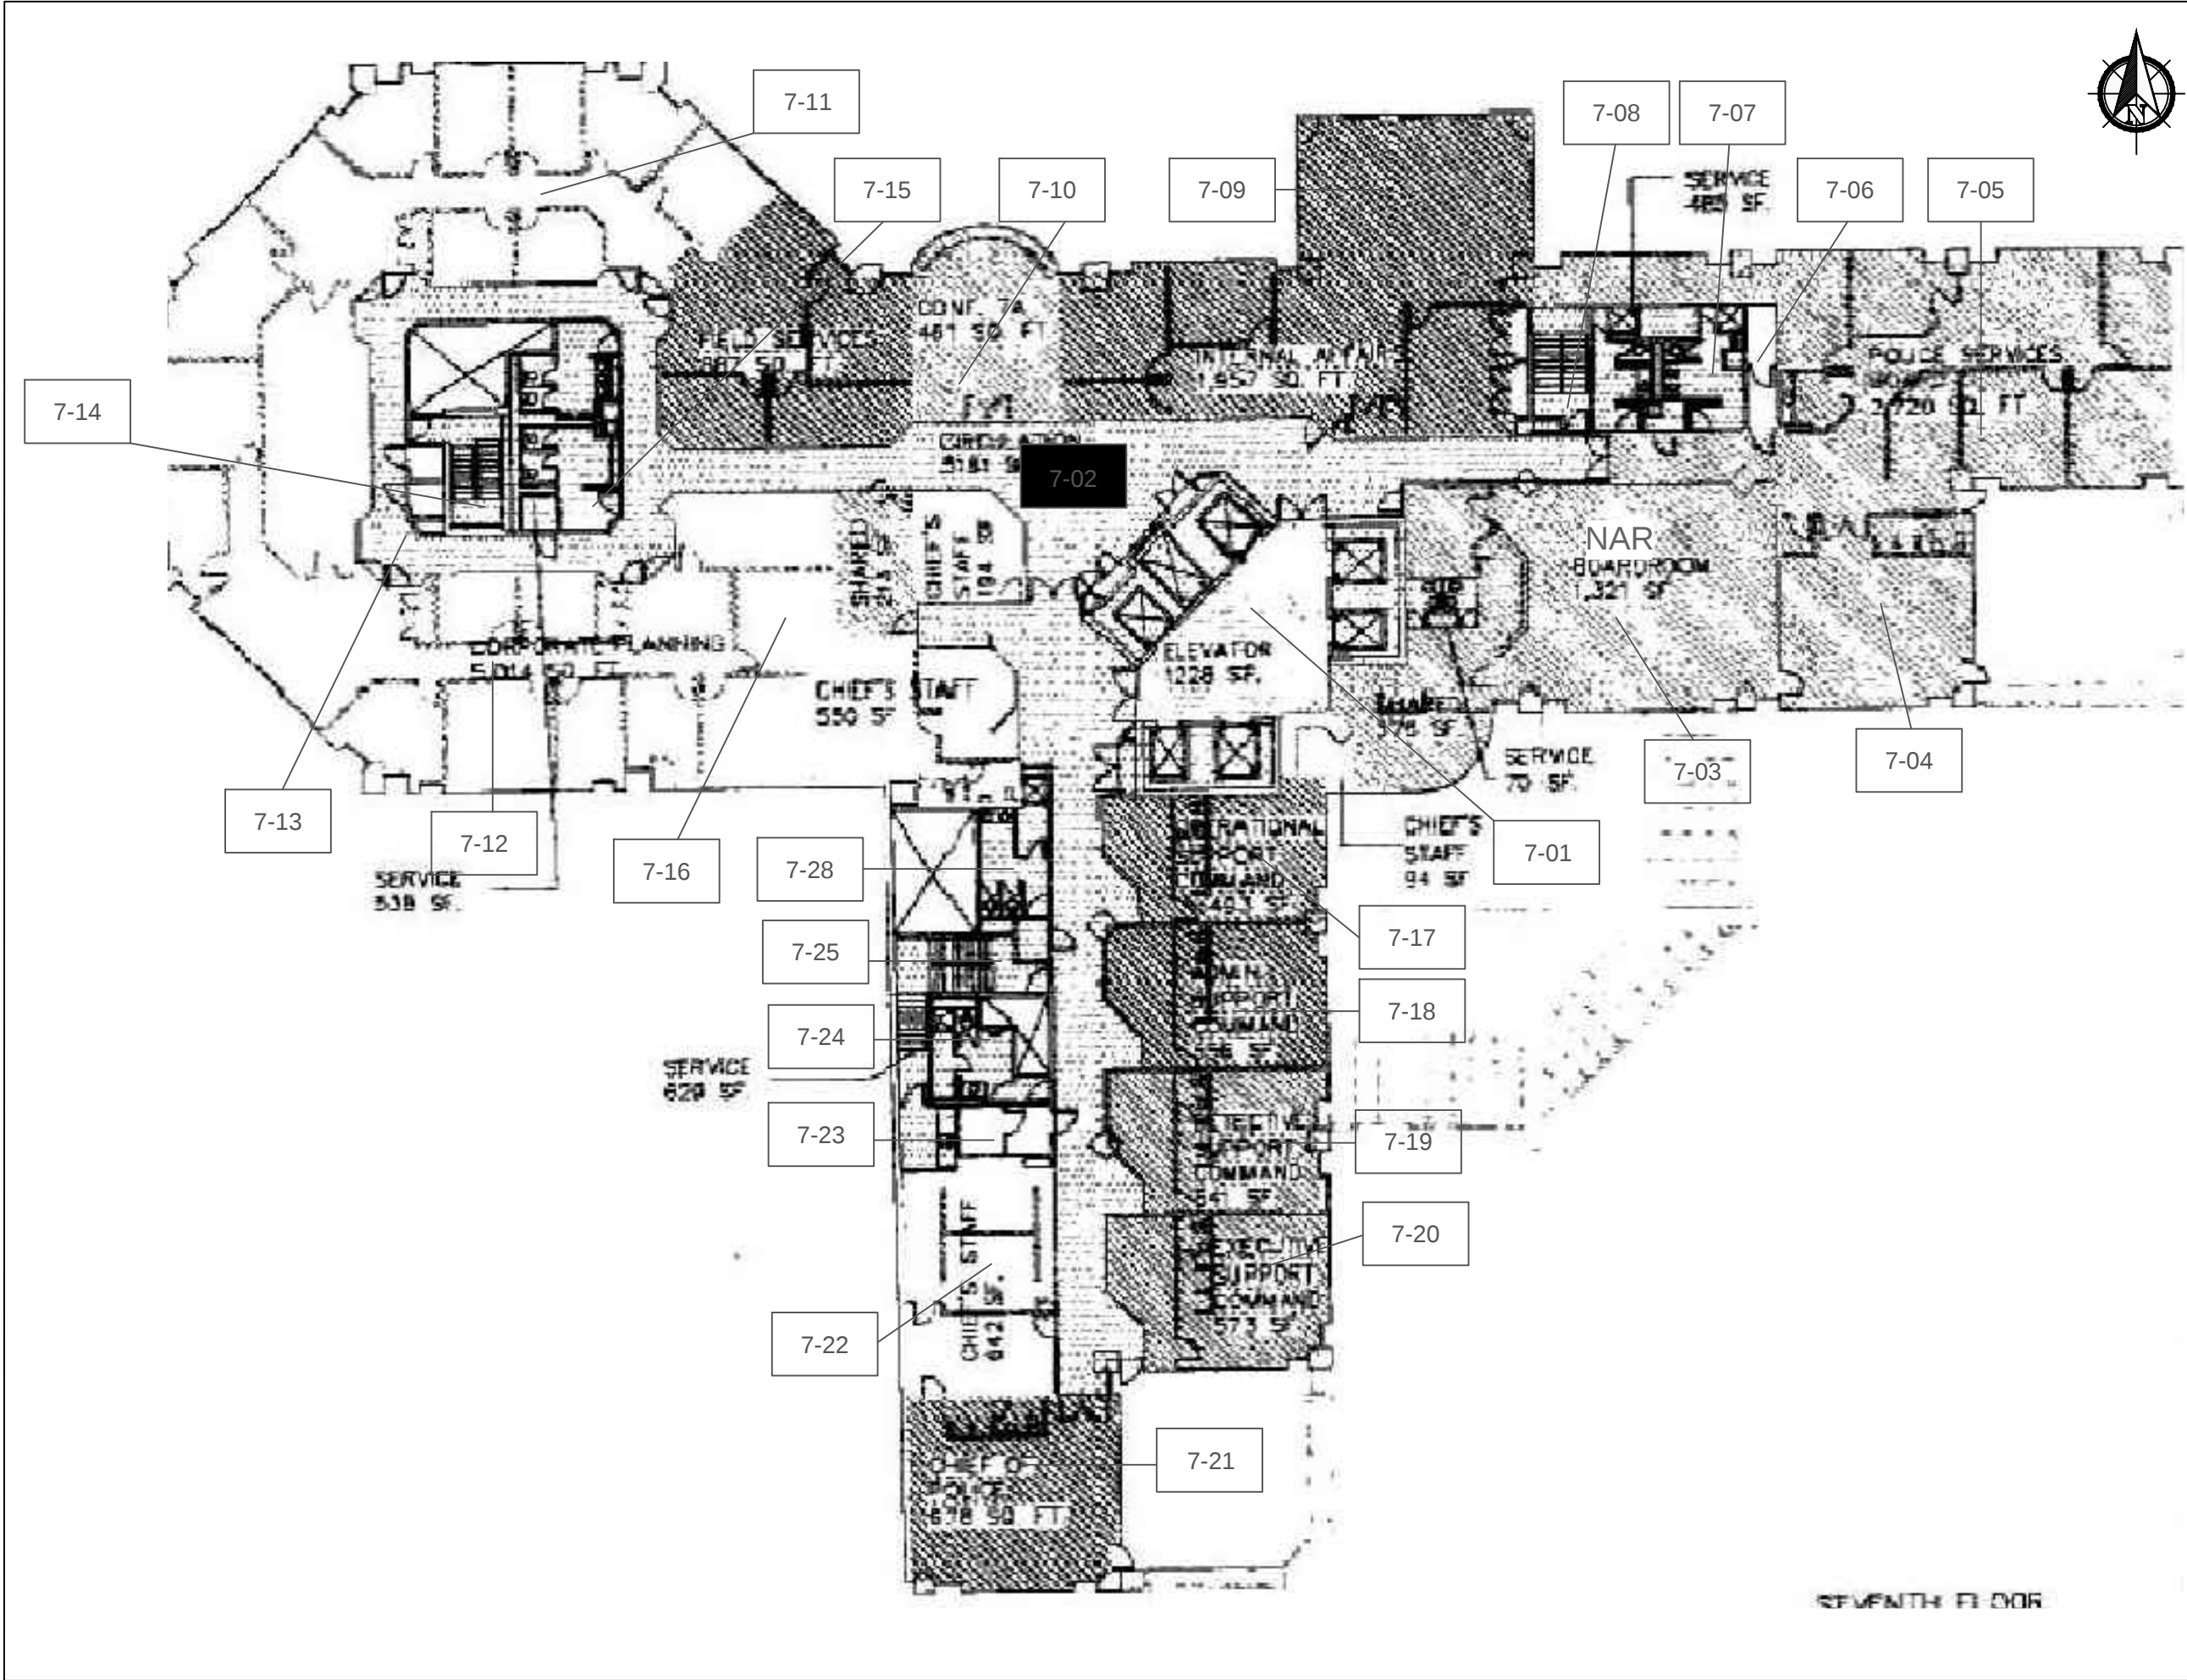

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT: POLICE SERVICES
CITY OF TORONTO

LOCATION: POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO


TITLE: HAZARDOUS BUILDING
MATERIALS ASSESSMENT
SEVENTH FLOOR

DATE: 2015/09/03 PROJECT #: 103037

DRAWN BY: GH DRAWING:

CHECKED BY: JM 12 OF 18

SCALE: NTS

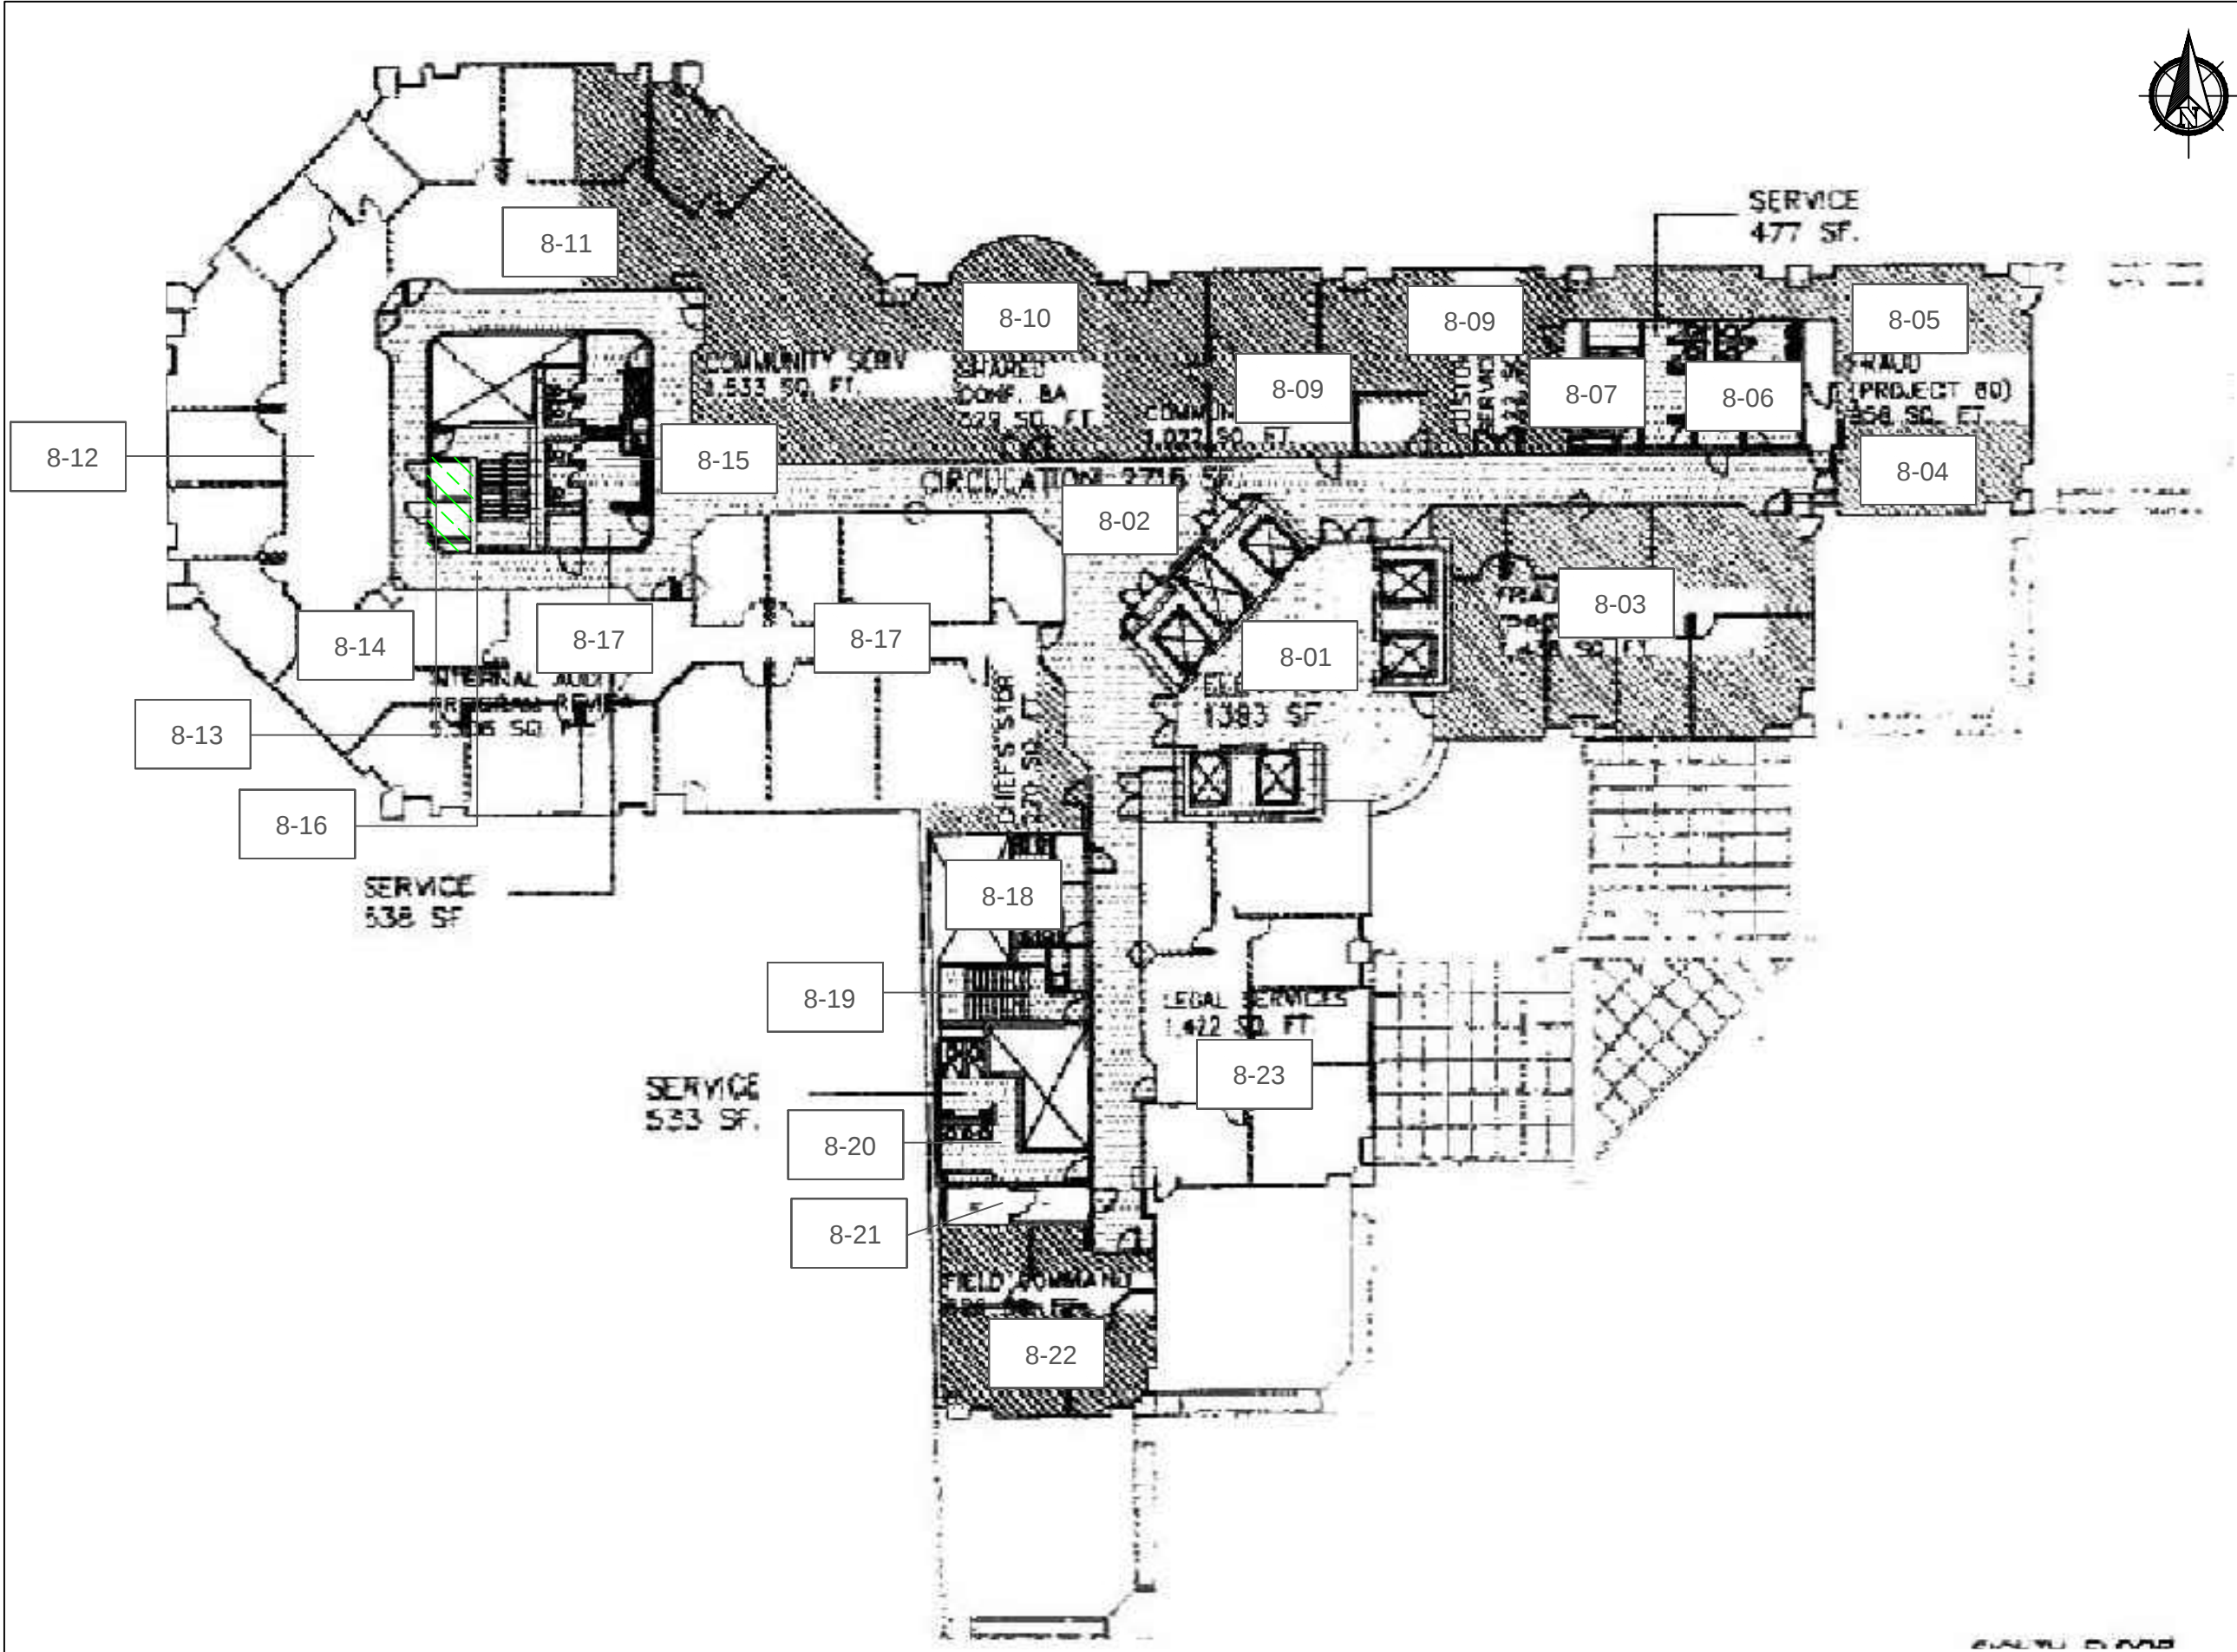

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:


CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:		POLICE SERVICES CITY OF TORONTO
LOCATION:		POLICE HEADQUARTERS 40 COLLEGE STREET TORONTO, ONTARIO
TITLE:		HAZARDOUS BUILDING MATERIALS ASSESSMENT EIGHTH FLOOR
DATE:	2015/09/03	PROJECT # : 103037
DRAWN BY:	GH	13 OF 18
CHECKED BY:	JM	
SCALE:	NTS	

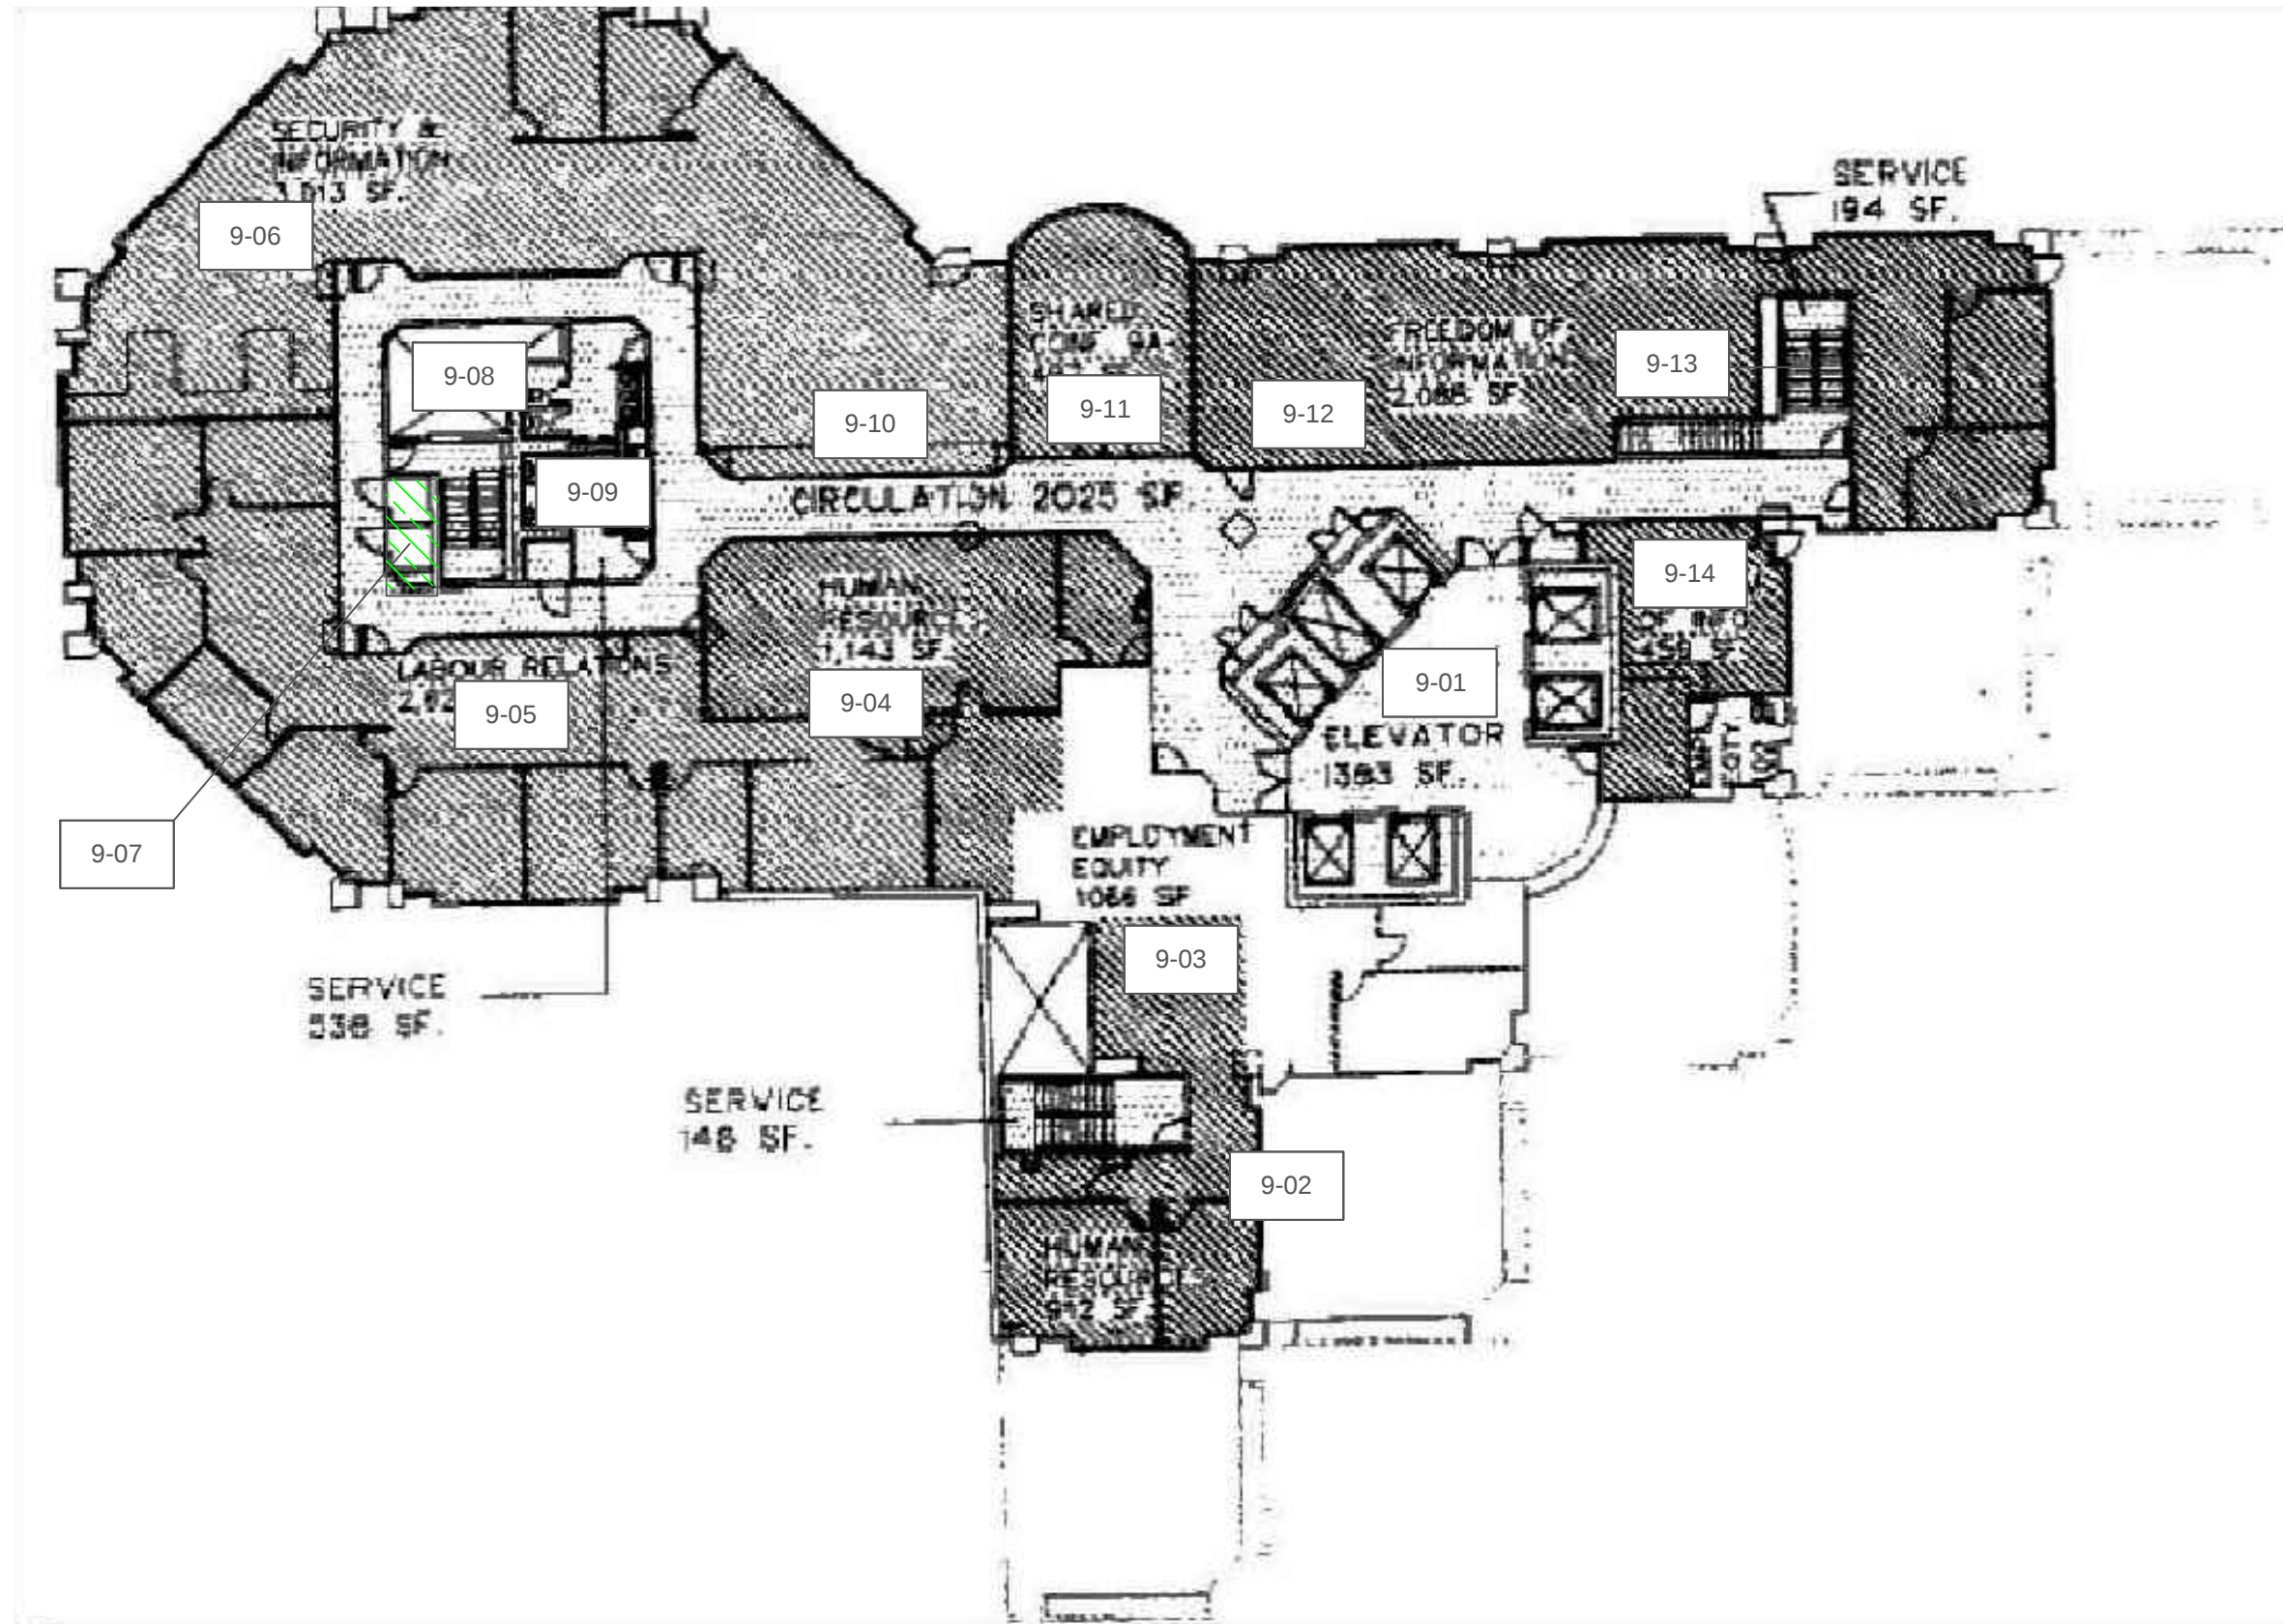

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
NINETH FLOOR

DATE:

2015/09/03

PROJECT # :

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM

SCALE:

NTS

14 OF 18

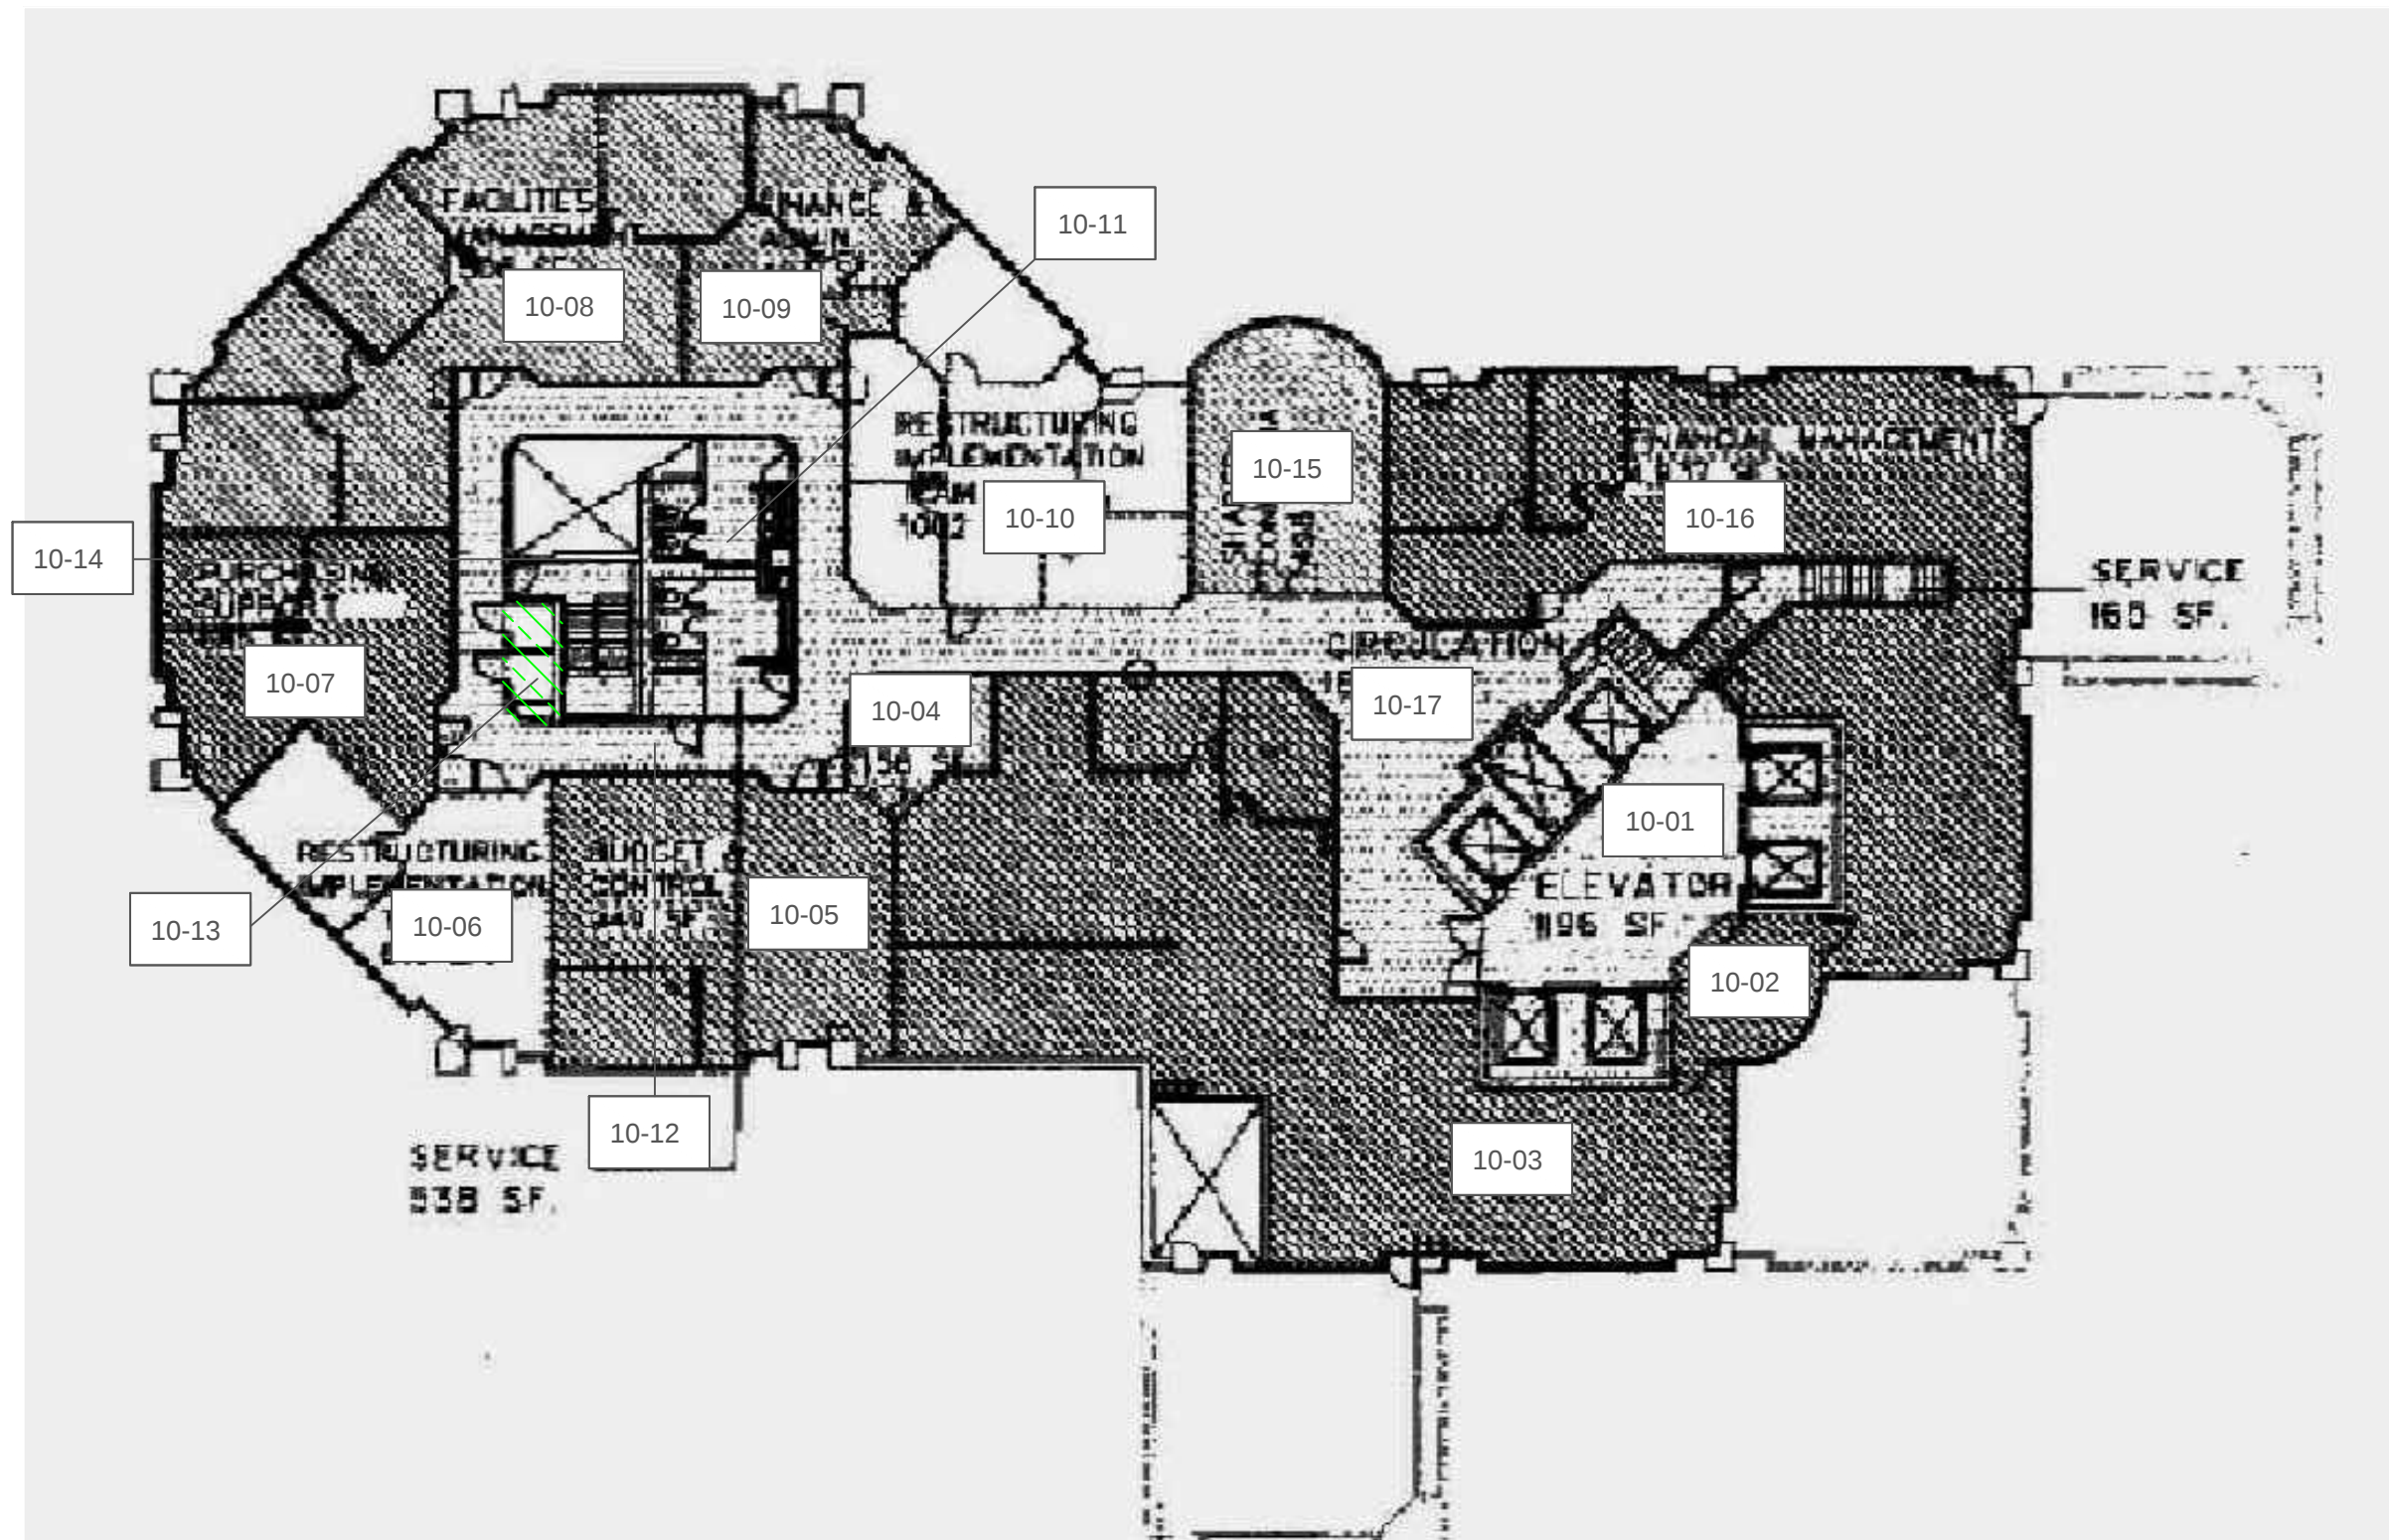

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
TENTH FLOOR

DATE:

2015/09/03

PROJECT # :

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM


SCALE:

NTS

15 OF 18

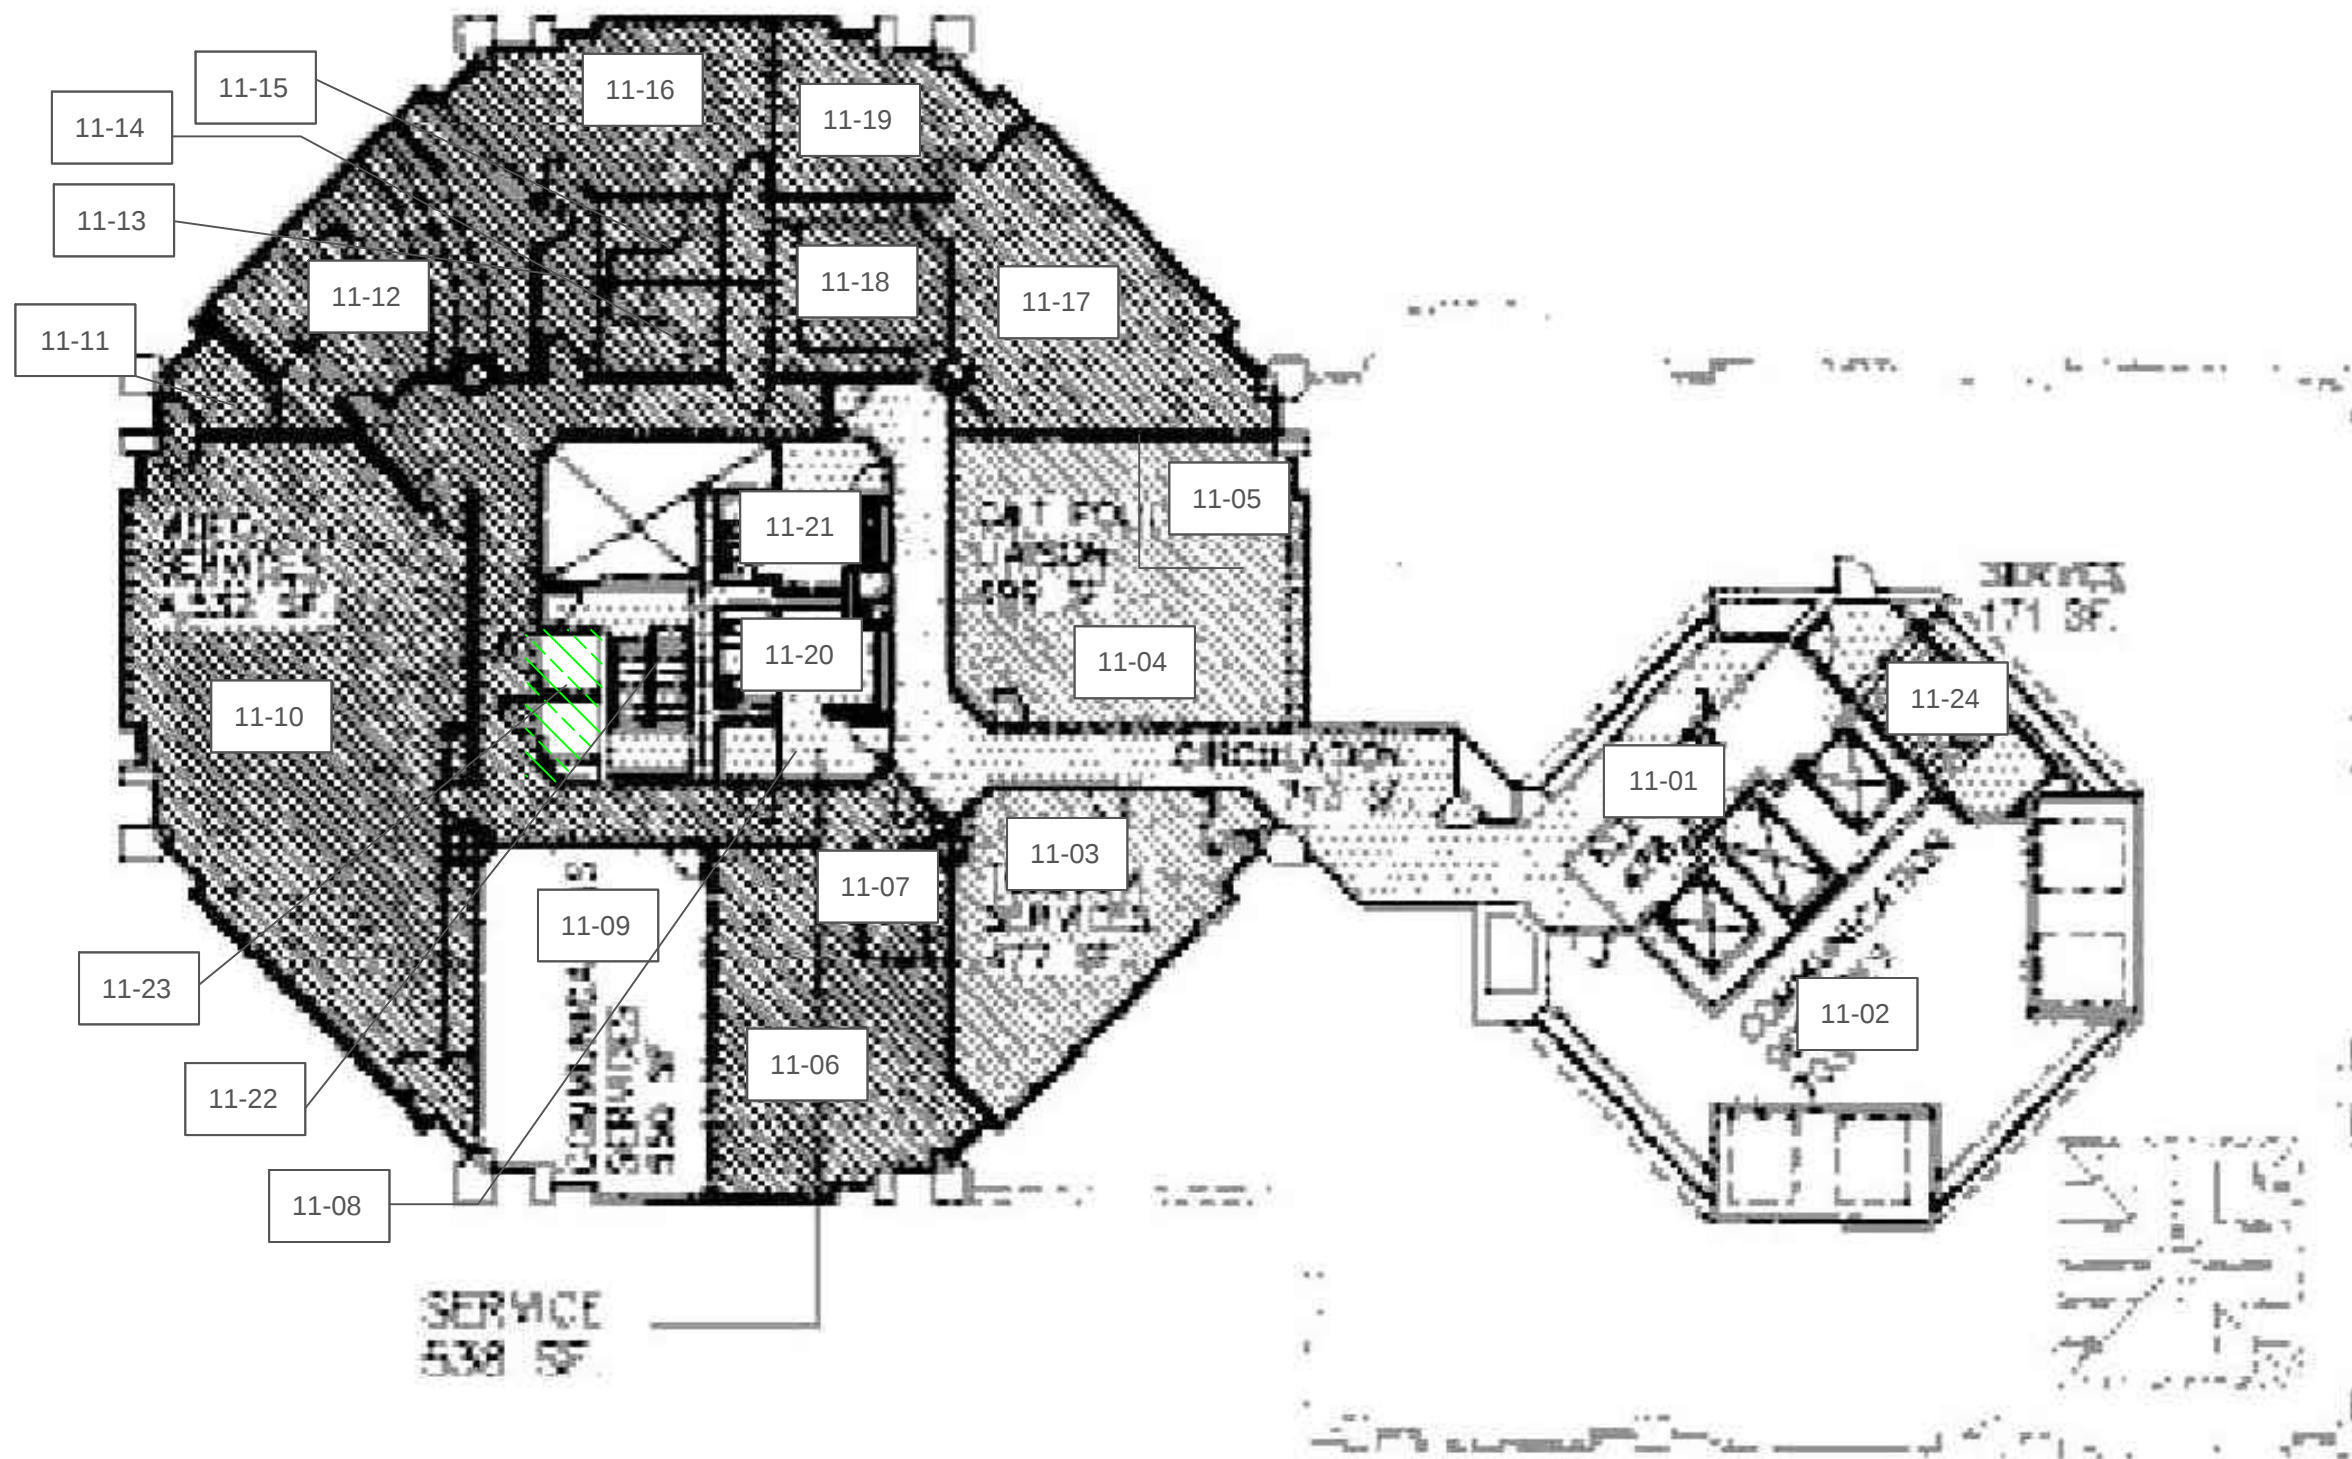

LEGEND:	
XX-XX LOCATION NUMBER	
NAR NO ACCESS TO ROOM/AREA	
ASBESTOS-CONTAINING MATERIALS:	
CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL	
NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.	
LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.	
BASE PLAN PROVIDED BY CLIENT.	
CLIENT: POLICE SERVICES CITY OF TORONTO	
LOCATION: POLICE HEADQUARTERS 40 COLLEGE STREET TORONTO, ONTARIO	
TITLE: HAZARDOUS BUILDING MATERIALS ASSESSMENT ELEVENTH FLOOR	
DATE: 2015/09/03	PROJECT # : 103037
DRAWN BY: GH	DRAWING: 16 OF 18
CHECKED BY: JM	
SCALE: NTS	

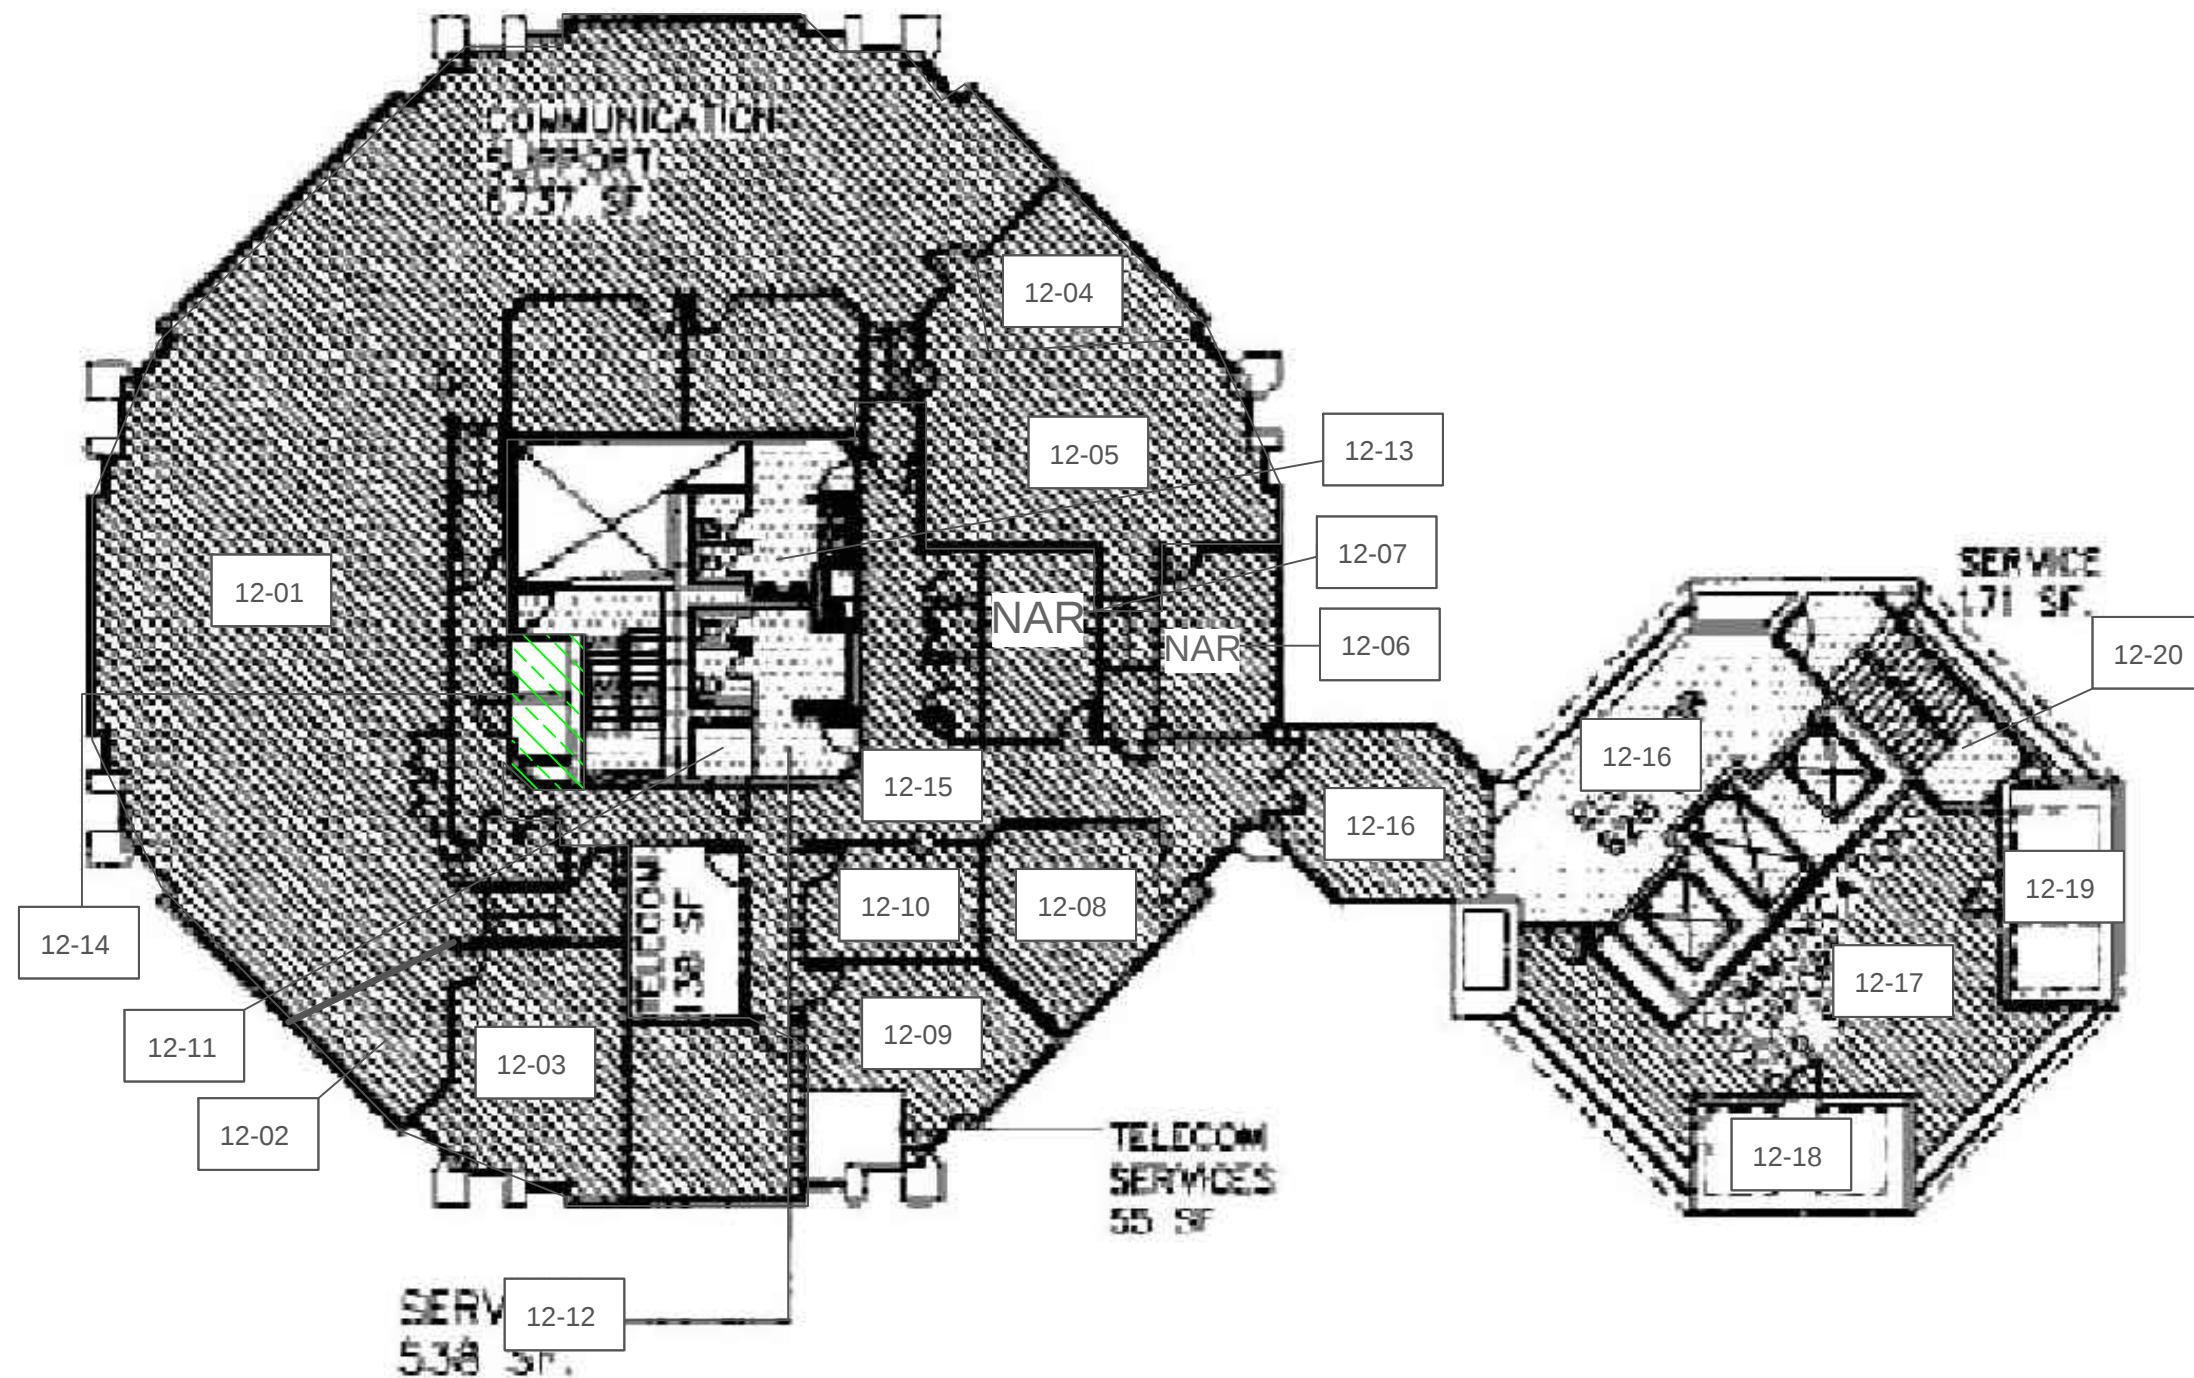

LEGEND:

XX-XX LOCATION NUMBER

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

CONFIRMED AND/OR PRESUMED
ASBESTOS-CONTAINING MATERIAL

NOT ALL KNOWN OR SUSPECTED
HAZARDOUS BUILDING MATERIALS MAY BE
DEPICTED ON THE DRAWING. REFER TO THE
HAZARDOUS BUILDING MATERIALS
ASSESSMENT REPORT FOR A COMPLETE
LIST OF KNOWN AND SUSPECTED
HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER
INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

CLIENT:

POLICE SERVICES
CITY OF TORONTO

LOCATION:

POLICE HEADQUARTERS
40 COLLEGE STREET
TORONTO, ONTARIO

TITLE:

HAZARDOUS BUILDING
MATERIALS ASSESSMENT
TWELFTH FLOOR

DATE:

2015/09/03

PROJECT # :

103037

DRAWN BY:

GH

DRAWING:


CHECKED BY:

JM

SCALE:

NTS

17 OF 18

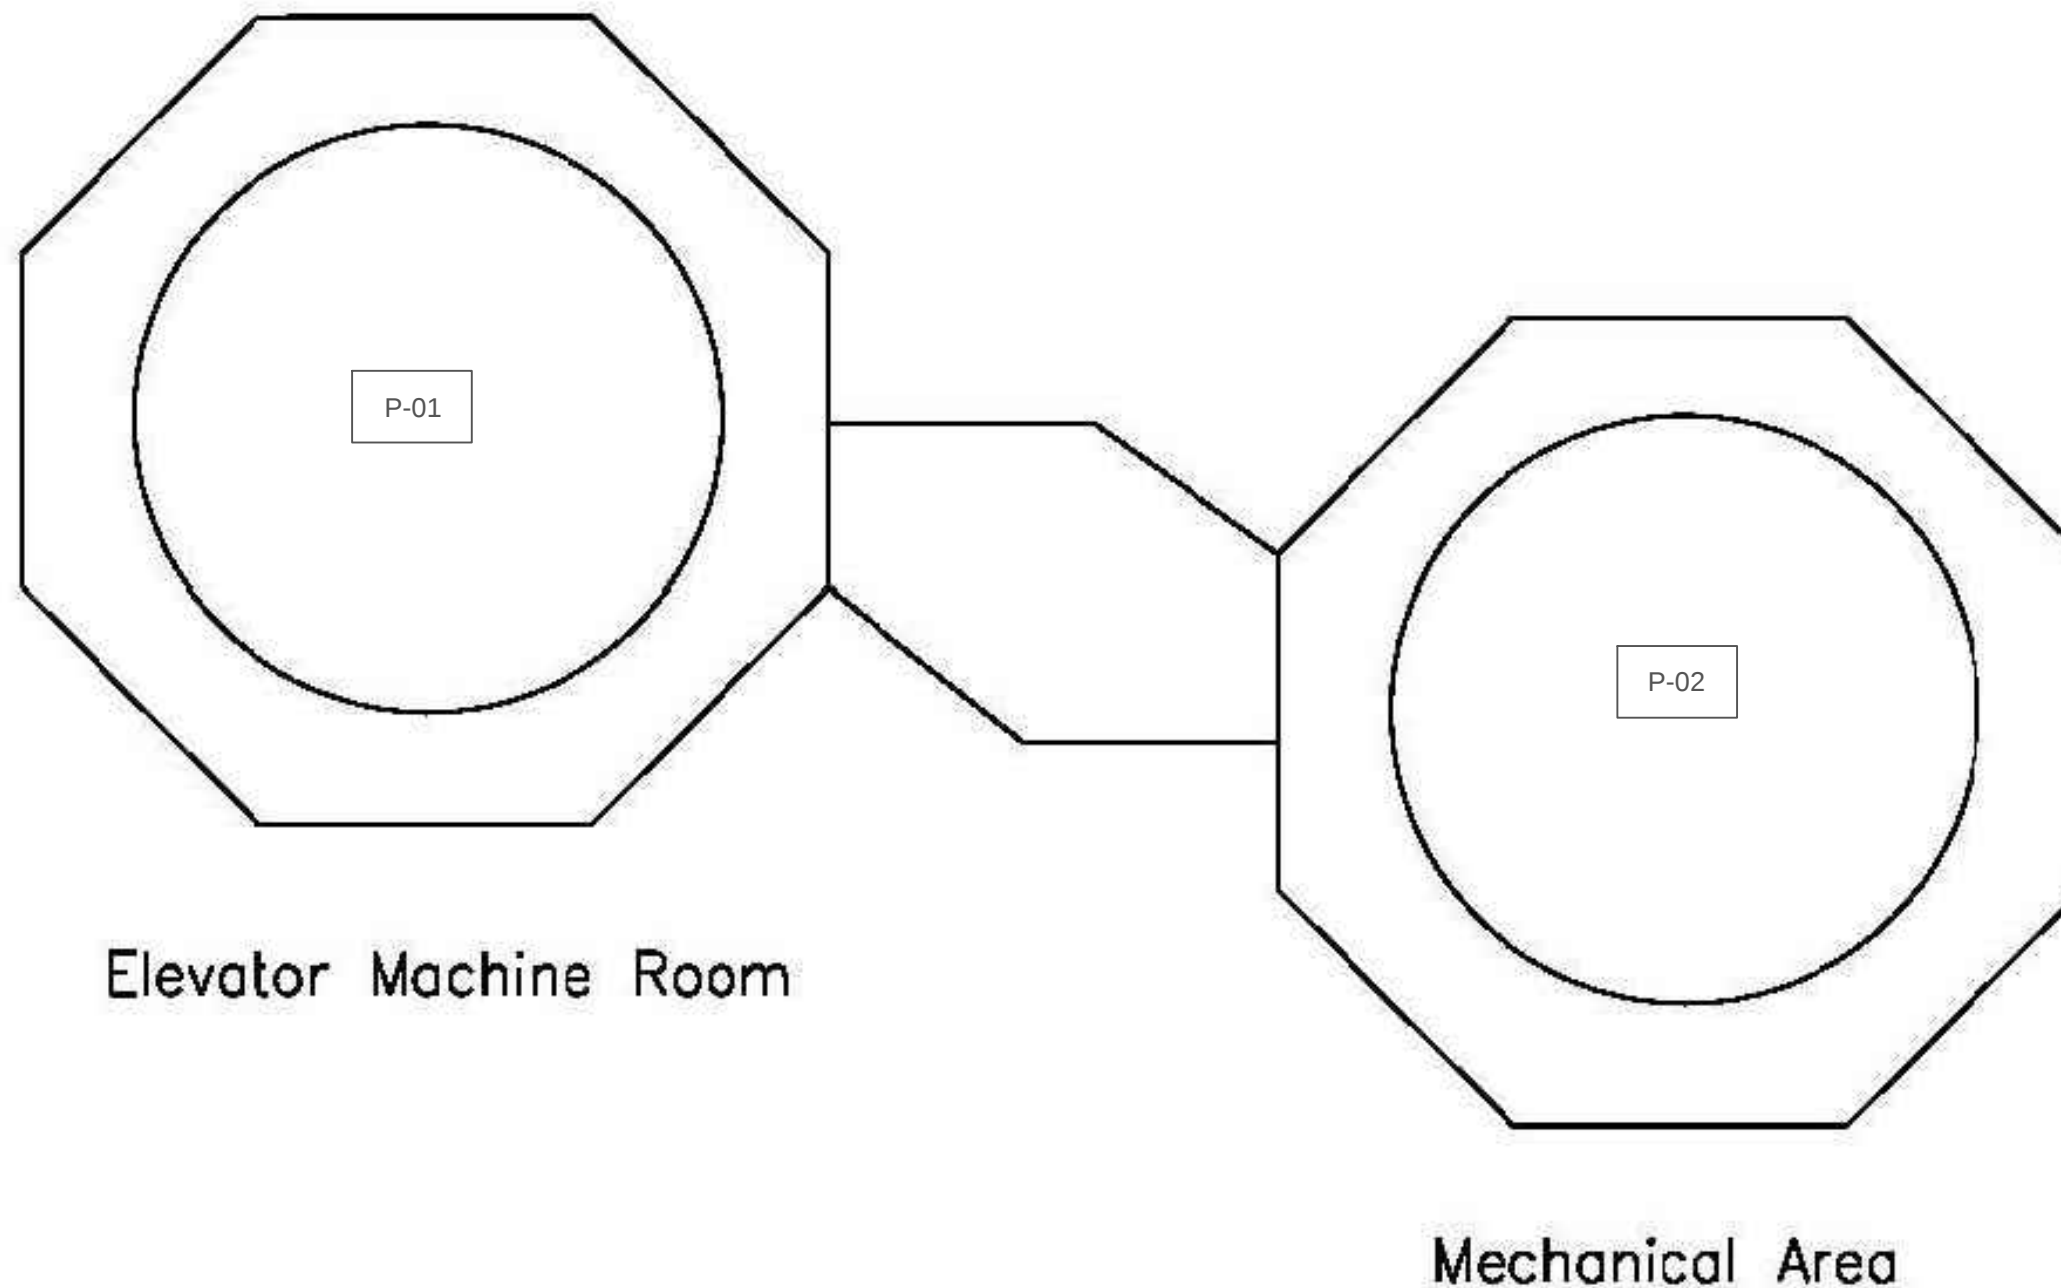

LEGEND:	
XX-XX LOCATION NUMBER	
NAR NO ACCESS TO ROOM/AREA	
ASBESTOS-CONTAINING MATERIALS:	
CONFIRMED AND/OR PRESUMED ASBESTOS-CONTAINING MATERIAL	
NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.	
LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.	
BASE PLAN PROVIDED BY CLIENT.	
CLIENT: POLICE SERVICES CITY OF TORONTO	
LOCATION: POLICE HEADQUARTERS 40 COLLEGE STREET TORONTO, ONTARIO	
TITLE: HAZARDOUS BUILDING MATERIALS ASSESSMENT MECHANICAL PENTHOUSE	
DATE: 2015/09/03	PROJECT # : 103037
DRAWN BY: GH	DRAWING: 18 OF 18
CHECKED BY: JM	
SCALE: NTS	

APPENDIX II-A
Asbestos Analytical Certificates



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP[®]
NVLAP Lab Code: 200664-0

Customer: Pinchin Ltd.
50 Wellington Street East
Suite 200
Toronto ON M5E 1C8

Attn: Joseph Mainwaring
Juliette McIntyre

Project: City of Toronto, Police Headquarters, 40 College Street, Toronto, ON

Lab Order ID: 1517405
Analysis ID: 1517405_PLM
Date Received: 9/9/2015
Date Reported: 9/14/2015

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
2015-A0023D	Texture Finish from the B2 Parking Garage	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_1					Crushed
2015-A0023E	Texture Finish from the B2 Parking Garage	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_2					Crushed
2015-A0023F	Texture Finish from the B3 Parking Garage	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_3					Crushed
2015-A0023G	Texture Finish from the B3 Parking Garage	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_4					Crushed
2015-A0031A	Roofing Materials from the Roof - 12th Floor **Do not analyze burlap phase	None Detected	10% Synthetic Fibers	90% Other	Black Fibrous Heterogeneous
1517405PLM_5					Dissolved
2015-A0031B	Roofing Materials from the Roof - 11th Floor **Do not analyze burlap phase	None Detected	10% Synthetic Fibers	90% Other	Black Fibrous Heterogeneous
1517405PLM_6					Dissolved
2015-A0031C	Roofing Materials from the Roof - 12th Floor **Do not analyze burlap phase	None Detected	10% Synthetic Fibers	90% Other	Black Fibrous Heterogeneous
1517405PLM_7					Dissolved
2015-A0032A	White Firestop from the 11th Floor Mechanical Closet	None Detected	30% Mineral Wool	70% Other	White Non Fibrous Heterogeneous
1517405PLM_8					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Estimated MDL is 0.1%.

Charmel Dozier (22)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
50 Wellington Street East
Suite 200
Toronto ON M5E 1C8

Attn: Joseph Mainwaring
Juliette McIntyre

Project: City of Toronto, Police Headquarters, 40 College Street, Toronto, ON

Lab Order ID: 1517405
Analysis ID: 1517405_PLM
Date Received: 9/9/2015
Date Reported: 9/14/2015

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
2015-A0032B	White Firestop from the 10th Floor Mechanical Closet	None Detected	20% Mineral Wool	80% Other	White Non Fibrous Heterogeneous
1517405PLM_9					Crushed
2015-A0032C	White Firestop from the 10h Floor Mechanical Closet	None Detected	20% Mineral Wool	80% Other	White Non Fibrous Heterogeneous
1517405PLM_10					Crushed
2015-A0033A	Black caulking from the 11th floor roof structure (parapet)	None Detected		100% Other	Black Non Fibrous Heterogeneous
1517405PLM_11					Dissolved
2015-A0033B	Black caulking from the 11th floor roof structure (parapet)	None Detected		100% Other	Black Non Fibrous Heterogeneous
1517405PLM_12					Dissolved
2015-A0033C	Black caulking from the 11th floor roof structure (parapet)	None Detected		100% Other	Black Non Fibrous Heterogeneous
1517405PLM_13					Dissolved
2015-A0034A	Light brown caulking from the exterior of the building (Exterior windows and claddin	None Detected		100% Other	Tan Non Fibrous Heterogeneous
1517405PLM_14					Dissolved
2015-A0034B	Light brown caulking from the exterior of the building (Exterior windows and claddin	None Detected		100% Other	Tan Non Fibrous Heterogeneous
1517405PLM_15					Dissolved
2015-A0034C	Light brown caulking from the exterior of the building (Exterior windows and claddin	None Detected		100% Other	Tan Non Fibrous Heterogeneous
1517405PLM_16					Dissolved

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Estimated MDL is 0.1%.

Charmel Dozier (22)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP[®]
NVLAP Lab Code: 200664-0

Customer: Pinchin Ltd.
50 Wellington Street East
Suite 200
Toronto ON M5E 1C8

Attn: Joseph Mainwaring
Juliette McIntyre

Project: City of Toronto, Police Headquarters, 40 College Street, Toronto, ON

Lab Order ID: 1517405
Analysis ID: 1517405_PLM
Date Received: 9/9/2015
Date Reported: 9/14/2015

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
2015-A0035A	Grey caulking from the Air Cooling Unit on the 12 th floor	None Detected		100% Other	Tan Non Fibrous Heterogeneous
1517405PLM_17					Dissolved
2015-A0035B	Grey caulking from the Air Cooling Unit on the 12 th floor	None Detected		100% Other	Tan Non Fibrous Heterogeneous
1517405PLM_18					Dissolved
2015-A0035C	Grey caulking from the Air Cooling Unit on the 12 th floor	None Detected		100% Other	Gray Non Fibrous Heterogeneous
1517405PLM_19					Dissolved
2015-A0036A	White caulking from the Air Cilling Unit on the 12th floor	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_20					Dissolved
2015-A0036B	White caulking from the Air Cilling Unit on the 12th floor	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_21					Dissolved
2015-A0036C	White caulking from the Air Cilling Unit on the 12th floor	None Detected		100% Other	White Non Fibrous Heterogeneous
1517405PLM_22					Dissolved

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Estimated MDL is 0.1%.

Charmel Dozier (22)

Analyst

Approved Signatory

Version 1-15-2012

1517405

Invoice to:

Contact name here

Email address here

Scientific
Analytical
Institute4604 Dundas Dr.
Greensboro, NC 27407

Phone: 336.292.3888

Fax: 336.292.3313

Email: lab@sailab.com

Client: Pinchin Ltd.
Contact: Joseph Mainwaring / Juliette McIntyre
 50 Wellington Street East, Suite 200,
 Toronto, ON M5E 1C8
Address: 416-368-6555
Phone: 416-368-4120
Fax: jmainwaring@pinchin.com
Email: jcmintyre@pinchin.com
 City of Toronto, Police Headquarters,
 40 College Street, Toronto, ON
Project:
Client Notes:
P.O. #. 103037
Date Submitted: September 8th 2015
Analysis: PLM - Stop Positive
TurnAroundTime: 4 days

***Instructions:**

Use Column "B" for your contact info

To See an Example Click the
bottom Example Tab.

Enter samples between "<<" and ">>"

Begin Samples with a "<<" above the first sample
 and end with a ">>" below the last sample.
 Only Enter your data on the first sheet "Sheet1"

Note: Data 1 and Data 2 are optional
 fields that do not show up on the official
 report, however they will be included
 in the electronic data returned to you
 to facilitate your reintegration of the report data.

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
---------------	-----------------------	--------------------	-----------------------

<<

2015-A0023D

2015-A0023E

2015-A0023F

2015-A0023G

2015-A0031A

2015-A0031B

2015-A0031C

2015-A0032A

2015-A0032B

2015-A0032C

2015-A0033A

2015-A0033B

2015-A0033C

2015-A0034A

2015-A0034B

2015-A0034C

2015-A0035A

2015-A0035B

2015-A0035C

2015-A0036A

2015-A0036B

2015-A0036C

>>

Texture Finish from the B2 Parking Garage
 Texture Finish from the B2 Parking Garage
 Texture Finish from the B3 Parking Garage
 Texture Finish from the B3 Parking Garage
 Roofing Materials from the Roof - 12th Floor ****Do not analyze burlap phase**
 Roofing Materials from the Roof - 11th Floor ****Do not analyze burlap phase**
 Roofing Materials from the Roof - 12th Floor ****Do not analyze burlap phase**
 White Firestop from the 11th Floor Mechanical Closet
 White Firestop from the 10th Floor Mechanical Closet
 White Firestop from the 10th Floor Mechanical Closet
 Black caulking from the 11th floor roof structure (parapet)
 Black caulking from the 11th floor roof structure (parapet)
 Black caulking from the 11th floor roof structure (parapet)
 Light brown caulking from the exterior of the building (Exterior windows and cladding)
 Light brown caulking from the exterior of the building (Exterior windows and cladding)
 Light brown caulking from the exterior of the building (Exterior windows and cladding)
 Grey caulking from the Air Cooling Unit on the 12 th floor
 Grey caulking from the Air Cooling Unit on the 12 th floor
 Grey caulking from the Air Cooling Unit on the 12 th floor
 White caulking from the Air Cilling Unit on the 12th floor
 White caulking from the Air Cilling Unit on the 12th floor
 White caulking from the Air Cilling Unit on the 12th floor

Accepted



Rejected



MC 9/9 10AM

APPENDIX II-B
Lead Analytical Certificates



Analysis for Lead Concentration in Paint Chips

by Flame Atomic Absorption Spectroscopy
EPA SW-846 3050B/6010C/7420



Customer: Pinchin Ltd.
2470 Milltower Court
Mississauga ON L5N 7W5

Attn: Joseph Mainwaring

Lab Order ID: 1517399

Analysis ID: 1517399_PBP

Date Received: 9/9/2015

Date Reported: 9/15/2015

Project: City of Toronto DSS; 40 College Street, Toronto, ON

Sample ID	Description	Mass (g)	Concentration (ppm)	Concentration (% by weight)
Lab Sample ID	Lab Notes			
L0001	Blue paint off metal beams near the air cooling unit on the 12th floor roof	0.0542	480	0.048%
1517399PBP_1				

Unless otherwise noted blank sample correction was not performed on analytical results. Scientific Analytical Institute participates in the AIHA IHPAT program. IHPAT Laboratory ID: 173190. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. Analytical uncertainty available upon request. The quality control samples run with the samples in this report have passed all EPA required specifications unless otherwise noted. RL: (Report Limit for an undiluted 50ml sample is 4µg Total Pb).

Daniel Olson (1)

Analyst

Scientific Analytical Institute, Inc. 4604 Dundas Dr. Greensboro, NC 27407 (336) 292-3888

Laboratory Director

1517399

Version 1-15-2012

Client: Pinchin Ltd.
Contact: Joseph Mainwaring
Address: 2470 Milltower court
Phone: 905-363-0678
Fax: 905-363-0681
Email: jmainwaring@pinchin.com

Project: City of Toronto DSS
Client Notes: 40 College Street, Toronto ON

P.O. #. 103037
Date Submitted: 9/4/2015 0:00

Analysis: Lead by Flame AA
TurnAroundTime: 5day Regular - September 11, 2015

***Instructions:**

Use Column "B" for your contact info

To See an Example Click the
bottom Example Tab.

Enter samples between "<<" and ">>"
 Begin Samples with a "<<" above the first sample
 and end with a ">>" below the last sample.
 Only Enter your data on the first sheet "Sheet1"

Note: Data 1 and Data 2 are optional
 fields that do not show up on the official
 report, however they will be included
 in the electronic data returned to you
 to facilitate your reintegration of the report data.

Invoice to:

Juliette McIntyre
 jmcintyre@pinchin.com

Scientific
 Analytical
 Institute



4604 Dundas Dr.
 Greensboro, NC 27407
 Phone: 336.292.3888
 Fax: 336.292.3313
 Email: lab@sailab.com

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
---------------	-----------------------	--------------------	-----------------------

<<

L0001

Blue paint off metal beams near the air cooling unit on the 12th floor roof

Accepted ☒Rejected ☐

M. Scriver
 9/9 10pm

APPENDIX II-C
PCB Analytical Certificates

Certificate of Analysis

Joseph Mainwaring - Project Technologist

Pinchin Environmental Ltd. (Mississauga)
2470 Milltower Court, Mississauga, ON L5N 7W5

Printed: Sep 11, 2015

Report Description: 5 solid samples were submitted for the following chemical analysis

Project Name: City of Toronto DSS Reassessments
Project No.: 103037
Site Location: 40 College St., Toronto, ON

Date Sampled: Sep 03, 2015
Date Tested: Sep 11, 2015
Sampled by: Joseph Mainwaring

Report Number: 15-1765

No.	Analyte	Result	Units	MDL	Comments	Technique / Test Method
<u>1</u>	<u>Sample ID.:</u> P0001 - Roofing Materials from the 12th Floor Roof					
	PCBs in Solid	<0.5	mg/kg	0.5		LAB-M06 (EPA 3550C/8082A modified)
<u>2</u>	<u>Sample ID.:</u> P0002 - Grey Caulking form the Air Cooling Unit on 12th Floor Roof					
	PCBs in Solid	<0.5	mg/kg	0.5		LAB-M06 (EPA 3550C/8082A modified)
<u>3</u>	<u>Sample ID.:</u> P0003 - Black Caulking from the 11th Floor Roof Parapet					
	PCBs in Solid	<0.5	mg/kg	0.5		LAB-M06 (EPA 3550C/8082A modified)
<u>4</u>	<u>Sample ID.:</u> P0004 - Light Brown Caulking from the Exterior Windows/Cladding					
	PCBs in Solid	<0.5	mg/kg	0.5		LAB-M06 (EPA 3550C/8082A modified)
<u>5</u>	<u>Sample ID.:</u> P0005 - White Caulking from the 12th Floor Air Cooling Unit					
	PCBs in Solid	<0.5	mg/kg	0.5		LAB-M06 (EPA 3550C/8082A modified)
	Comment(s)	-	N/A	N/A	"mg/kg" is equivalent to "ppm"	N/A

Results relate only to the samples tested above, as received.

Approved By:

Son C.H. Le, B. Eng. (Chem.)
Lab Manager
Phone: (519) 740-1333 Ext.: 230
Fax: (519) 740-2320
Email: SonLe@aevitas.ca

The Analytical Chemistry Laboratory of Aevitas Inc. (Ayr) is accredited for specific tests in accordance with the recognised International Standard ISO/IEC 17025:2005 by the Canadian Association for Laboratory Accreditation (CALA) Inc. This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality management system (refer to joint ISO-ILAC-IAF Communiqué dated 8 January 2009). The laboratory quality management system of Aevitas Inc. (Ayr) meets the principles of ISO 9001:2008.

All Analytical data is subject to uncertainty which, may vary with sample matrices, sample preparation techniques and instrumental parameters. As a general guideline, uncertainty may be expressed as approximately +/- 50% of the reported value at or near the Method Detection Limit (MDL) and +/-10% or less, of the reported result that is greater than 10 times the MDL. Method Detection Limits are defined as approximately 3 times the standard deviation value (at 99% confidence level), which is obtained from replicate analysis of a low-level standard as per the Ontario MOE - MISA Protocol for the Sampling and Analysis of Industrial / Municipal Wastewater (1999). MDL determination is based on undiluted samples with relatively low matrix interferences. Where dilutions are required, the reported MDL value will be scaled proportionally.

All testing procedures follow strict guidelines and quality assurance / quality control (QA/QC) protocols. QA/QC data is available for review at any time upon client's request.

APPENDIX III
Methodology



1.0 GENERAL

The following survey methodology is based on the requirements of the *Standard Operation Procedure for Designated Substance Surveys*, dated April, 2014, provided by the City of Toronto (the "SOP").

Pinchin conducted a room-by-room survey (rooms, corridors, service areas, exterior, etc.) to identify the hazardous building materials as defined in Section 1.1. Information regarding the approximate quantity, location, and condition of hazardous building materials encountered and visually estimated quantities were recorded on the *Survey Form*, provided by the City of Toronto, found in Appendix V. The locations of any samples collected were recorded on small-scale plans, found in Appendix I.

Drawings (i.e., floor plans), previous reports, and Survey Forms, were referenced where provided.

1.1 Limitations on Scope

The survey excludes the following:

- Owner or occupant articles (e.g. stored items, furniture, appliances, etc.);
- Underground materials or equipment (e.g. vessels, drums, underground storage tanks, pipes, etc.);
- Building envelope, structural components, inaccessible or concealed materials or other items where sampling may cause consequential damage to the property.
- Energized systems (e.g. internal boiler components, elevators, mechanical or electrical components);
- Controlled products (e.g. stored chemicals, operational or process-related substances); and
- Materials not typically associated with construction (e.g. settled dust, spills, residual contamination from prior spills, etc.).

The survey was limited to non-intrusive testing. Concealed spaces such as those above solid ceilings and within shafts and pipe chases were accessed via existing access panels only. Pinchin did not conduct demolition of walls, solid ceilings, structural items, interior finishes or exterior building finishes, to determine the presence of concealed materials.

1.2 Asbestos

Pinchin conducted an inspection for the presence of friable and non-friable asbestos-containing materials (ACM). A friable material is a material that when dry can be crumbled, pulverized or powdered by hand pressure.



Pinchin collected samples at a rate that is in compliance with Table 1 of O.Reg. 278/05. A separate set of samples was collected of each of homogenous material sampled. A homogenous material is defined by the US EPA¹ as material that is uniform in texture and appearance, was installed at one time, and is unlikely to consist of more than one type or formulation of material. The homogeneous materials are determined by visual examination, available information on the phases of the construction and prior renovations.

The following materials were sampled:

- All friable materials historically known to contain asbestos, regardless of year of installation, not identified in previous reports;
- Friable materials previously sampled in insufficient quantity to conclude the materials are non-asbestos, in accordance with the requirements of O.Reg. 278/05;
- Friable materials previously reported to contain less than 1% asbestos, if sampled prior to the Ministry of Labour defining an asbestos-containing material as a material containing contains 0.5 percent or more asbestos by weight;
- Non-friable acoustic ceiling tiles;
- Non-friable vinyl floor tiles and mastic.

The following materials were **not** sampled:

- Materials previously identified in previous reports provided as asbestos-containing;
- Materials previously confirmed to be non-asbestos in accordance with O.Reg. 278/05;
- Unless damaged the following materials were not sampled: plaster, drywall joint compound, mastic, window caulking, roofing materials, vinyl sheet flooring. Materials not sampled are assumed to contain asbestos.
- Materials where sampling poses an inherent, imminent danger to the Assessor such as high voltage wiring, materials present at heights greater than 12 feet, or those in confined spaces. These materials are assumed to be asbestos-containing.

In some cases, manufactured products such as asbestos cement pipe are visually identified without sample confirmation.

¹ Environmental Protection Agency



Pinchin submits the bulk samples to a NVLAP² accredited laboratory for analysis. The analysis is performed in accordance with Test Method EPA/600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials, July 1993.

The asbestos analysis is completed using a stop positive approach. Only one result of greater than the regulated criteria (0.5%) is required to determine that a material is asbestos-containing, but all samples must be analyzed to conclusively determine that a material is non-asbestos. The laboratory stops analyzing samples from a homogeneous material once a result greater than the regulated criteria is detected in any of the samples of that material. All samples of a homogeneous material are analyzed if no asbestos is detected. In some cases, all samples are analyzed in the sample set regardless of result. Where building materials are described in the report as non-asbestos, or described as containing no asbestos, this is subject to the limitations of the analytical method used, and should be understood to mean no asbestos was detected.

Asbestos materials are evaluated in order to make recommendations regarding remedial work. The priority for remedial action is based on several factors:

- friability (friable or non-friable).
- condition (good, fair, poor, debris, based on definitions in the SOP).
- accessibility (ranking from accessible to all building users to inaccessible).
- visibility (whether the material is obscured by other building components).
- efficiency of the work (for example, if damaged ACM is being removed in an area, it may be most practical to remove all ACM in the area even if it is in good condition).

This includes friability, condition and efficiency and practicality of the work.

1.3 Lead

Pinchin collected samples of damaged paint not identified in a previous report. Drawings included show sample locations.

Analysis for lead in paints or surface coatings is performed in accordance with EPA Method No. 3050B/Method No. 7420; flame atomic absorption at an accredited laboratory.

For this report, all paints containing lead at a concentration 0.1% or greater are discussed. Paint was evaluated for condition.

² National Voluntary Laboratory Accreditation Program

Lead building products (e.g. batteries, lead sheeting, flashing) are identified by visual observation only.

1.4 Silica

Pinchin identifies building materials suspected of containing crystalline silica (e.g. concrete, cement, tile, brick, masonry, mortar) by knowledge of current and historic applications and visual inspection only. Pinchin does not perform sampling of these materials for laboratory analysis of crystalline silica content.

1.5 Mercury

Building materials/products/equipment (e.g. thermostats, barometers, pressure gauges, light tubes), suspected to contain mercury were identified by visual inspection only. Dismantling of equipment suspected of containing mercury was not performed. Sampling of these materials for laboratory analysis of mercury content was not performed.

Mercury spills or damaged mercury-containing equipment was recorded where observed.

1.6 Polychlorinated Biphenyls

Pinchin determines the potential for light ballast and wet transformers to contain PCBs based on the age of the building, a review of maintenance records and examination of labels or nameplates on equipment, where present and accessible. The information is compared to known ban dates of PCBs and Environment Canada publications.

Dry type transformers are assumed to be free of dielectric fluids and hence non-PCB.

Pinchin records spills or leakage of suspect PCB-containing fluids where observed or identified in historical documents.

Fluids (mineral oil, hydraulic or Askaral) in transformers or other equipment are not sampled for PCB content.

Non-liquid forms of PCBs (i.e. sealants or caulking) are not sampled for PCB content.

1.7 Visible Mould

Pinchin identifies the presence of mould if visibly present in a significant quantity on exposed building surfaces. If any mould growth is concealed within wall cavities it is not addressed in this survey.

APPENDIX IV
Photographs



Designated Substances Survey Report

Police Headquarters, 40 College Street, Toronto, Ontario
The City of Toronto

December 10, 2015

Pinchin File: 103037

Appendix IV



Photo 04 – Non-asbestos VFT-03

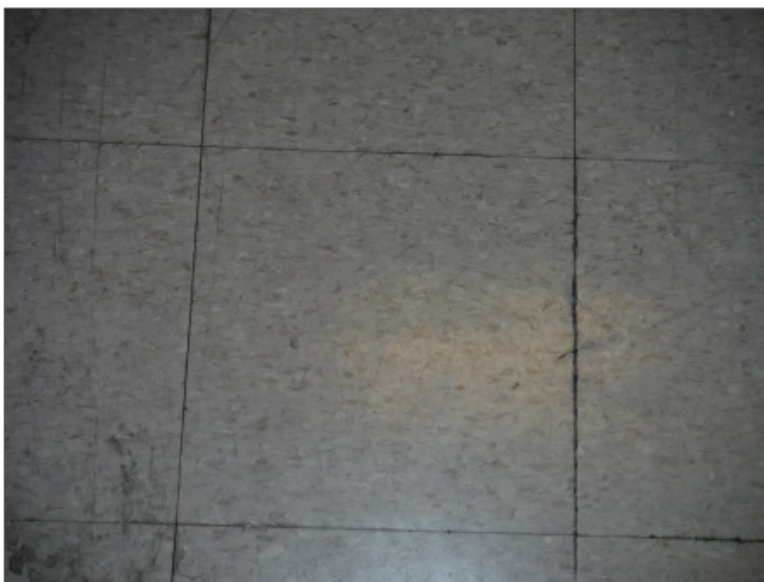


Photo 05 – Non-asbestos VFT-04



Photo 06 – Non-asbestos VFT05



Photo 07 – Non-asbestos VFT-06

APPENDIX V
Survey Form

APPENDIX V - SURVEY FORM

Building Address			40 College Street, Toronto, Ontario		Date(s) of Current Reassessment:		3-Sep-15		
Building Name			Police Headquarters		Organization completing Asbestos Reassessment:			Pinchin Ltd. - JMainwaring	
Summary of Findings									
No Access to Location B4-03, B4-14, B3-11, 1-07, 2-02, 4-08, 4-09, 4-13, 4-22, 5-13, 7-03, 12-06, 12-07									
Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
0-00	Exterior	Roofing Material	Roof	Asbestos	2015-A0031A-C	None Detected	N/A	N/A	
0-00	Exterior	Roofing Material	Roof	PCBs	P0001	<0.5 mg/kg	N/A	N/A	
0-00	Exterior	Window Caulking	Windows	Asbestos	2015-A0034A-C	None Detected	N/A	N/A	Light Brown
0.00	Exterior	Window Caulking	Windows	PCBs	P0004	<0.5 mg/kg	N/A	N/A	
0-00	Exterior	Caulking	Structure	Asbestos	2015-A0033A-C	None Detected	N/A	N/A	Black
0-00	Exterior	Caulking	Structure	PCBs	P0003	<0.5 mg/kg	N/A	N/A	
0-00	Exterior	Caulking	Mechanical	Asbestos	2015-A0035A-C	None Detected	N/A	N/A	Grey - 12th Floor Air Cooling Unit
0-00	Exterior	Caulking	Mechanical	PCBs	P0002	<0.5 mg/kg	N/A	N/A	
0-00	Exterior	Caulking	Mechanical	Asbestos	2015-A0036A-C	None Detected	N/A	N/A	White - 12th Floor Air Cooling Unit
0-00	Exterior	Caulking	Mechanical	PCBs	P0005	<0.5 mg/kg	N/A	N/A	
B5-01	5th Basement Parking Garage.	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B5-01	5th Basement Parking Garage.	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B5-01	5th Basement Parking Garage.	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-01	West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-01	West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-01	West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-02	Corridor	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B4-02	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-02	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-03	Storage Room	None							NAR
B4-04	Men's Locker Room Entrance	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B4-04	Men's Locker Room Entrance	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-04	Men's Locker Room Entrance	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-05	Men's Locker Room	Vinyl Sheet Flooring (VSF)	Floor	Asbestos	2013-A0026A-C	None Detected	N/A	N/A	VSF-01, Beige
B4-05	Men's Locker Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

<i>Location Number</i>	<i>Location Name</i>	<i>Potential Hazardous Materials</i>	<i>Building System</i>	<i>Potential Hazard</i>	<i>Sample ID</i>	<i>Analytical Result</i>	<i>Quantity</i>	<i>Condition</i>	<i>Notes/Required Action</i>
B4-05	Men's Locker Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-06	Corridor	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B4-06	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-06	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-07	Mechanical Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-07	Mechanical Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-07	Mechanical Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-08	South West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-08	South West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-08	South West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-09	South East Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-09	South East Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-09	South East Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-10	South East Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-10	South East Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-10	South East Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-11	North East Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-11	North East Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-11	North East Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-12	North Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-12	North Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-12	North Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-13	North Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-13	North Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-13	North Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-14	Forensic Lab	None							NAR
B4-15	North Storage Room 2	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-15	North Storage Room 2	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-15	North Storage Room 2	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-16	North West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B4-16	North West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-16	North West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-17	North West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-17	North West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-17	North West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-18	4th Basement Parking Garage	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-18	4th Basement Parking Garage	Texture Finish	Walls	Asbestos	2013-A0023A-C	None Detected	N/A	N/A	
B4-18	4th Basement Parking Garage	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-19	North stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-19	North stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-19	North stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B4-20	Men's Washroom	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B4-20	Men's Washroom	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B4-20	Men's Washroom	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-01	North Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-01	North Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-01	North Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-02	Exercise Room	Vinyl Sheet Flooring (VSF)	Floor	Asbestos	2013-A0026A-C	None Detected	N/A	N/A	VSF-01, Beige
B3-02	Exercise Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-02	Exercise Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-03	Elevator Lobby	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B3-03	Elevator Lobby	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-03	Elevator Lobby	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-04	Entrance From Parking	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B3-04	Entrance From Parking	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-04	Entrance From Parking	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-05	Corridor	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B3-05	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-05	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-06	West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

<i>Location Number</i>	<i>Location Name</i>	<i>Potential Hazardous Materials</i>	<i>Building System</i>	<i>Potential Hazard</i>	<i>Sample ID</i>	<i>Analytical Result</i>	<i>Quantity</i>	<i>Condition</i>	<i>Notes/Required Action</i>
B3-06	West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-06	West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-07	Corridor	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0024A-C	None Detected	N/A	N/A	VFT-01, 12" x 12" Beige
B3-07	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-07	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-08	Mechanical Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-08	Mechanical Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-08	Mechanical Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-09	Mechanical Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-09	Mechanical Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-09	Mechanical Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-10	South West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-10	South West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-10	South West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-11	South East Storage Room	None							NAR
B3-12	South East Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-12	South East Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-12	South East Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-13	North East Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-13	North East Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-13	North East Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-14	North Parking Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-14	North Parking Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-14	North Parking Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-15	North West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-15	North West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-15	North West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B3-16	North West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-16	North West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B3-16	North West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B3-17	3rd Basement Parking Garage	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B3-17	3rd Basement Parking Garage	Texture Finish	Walls	Asbestos	2015-A0023D-G	None Detected	N/A	N/A	
B3-17	3rd Basement Parking Garage	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-01	North Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-01	North Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-01	North Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-02	Women's Washroom	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-02	Women's Washroom	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-02	Women's Washroom	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-03	Women's Locker Room	Vinyl Sheet Flooring (VSF)	Floor	Asbestos	2013-A0026A-C	None Detected	N/A	N/A	VSF-01, Beige
B2-03	Women's Locker Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-03	Women's Locker Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-04	Corridor	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0027A-C	None Detected	N/A	N/A	VFT-02, 12" x 12" blue shades
B2-04	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-04	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0018A-C	None Detected	N/A	N/A	
B2-05	Maintenance Offices	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0027A-C	None Detected	N/A	N/A	VFT-02, 12" x 12" blue shades
B2-05	Maintenance Offices	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-05	Maintenance Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0022A-C	None Detected	N/A	N/A	ACT 02, 2' x 4' Random dimples and pinholes.
B2-06	West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-06	West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-06	West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-07	South West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-07	South West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-07	South West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-07	South West Storage Room	Transite Pipe	Piping	Asbestos	Not Sampled	ACM Assumed	12 M	Good	Transite Piping is present as a rain water leader.
B2-08	South East Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-08	South East Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-08	South East Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-08	South East Storage Room	Transite Pipe	Piping	Asbestos	Not Sampled	ACM Assumed	12 M	Good	Transite Piping is present as a rain water leader.
B2-09	South East Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B2-09	South East Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-09	South East Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-10	North East Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-10	North East Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-10	North East Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-11	North Parking Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-11	North Parking Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-11	North Parking Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-12	North Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-12	North Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-12	North Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-12	North Storage Room	Transite Pipe	Piping	Asbestos	Not Sampled	ACM Assumed	3 M	Good	Transite Piping is present as a rain water leader.
B2-13	North West Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-13	North West Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-13	North West Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-14	North West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-14	North West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-14	North West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-15	2nd Basement Parking Garage	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-15	2nd Basement Parking Garage	Texture Finish	Walls	Asbestos	2015-A0023D-G	None Detected	N/A	N/A	
B2-15	2nd Basement Parking Garage	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-16	Corridor	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-16	Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-16	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B2-17	Parking Garage Entrance	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B2-17	Parking Garage Entrance	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B2-17	Parking Garage Entrance	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-01	Parking Elevator Lobby	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-01	Parking Elevator Lobby	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-01	Parking Elevator Lobby	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B-02	Corridor	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-02	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-02	Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-03	Print Shop	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-03	Print Shop	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-03	Print Shop	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	Visually identified as fibreglass	Non Asbestos	N/A	N/A	ACT 04 - 2'x4' fibreglass
B-03	Print Shop	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
B-04	North East Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-04	North East Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-04	North East Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-05	North Corridor	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-05	North Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-05	North Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-06	Facilities Management Loading dock	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-06	Facilities Management Loading dock	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-06	Facilities Management Loading dock	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-06	Facilities Management Loading dock	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
B-07	Generator Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-07	Generator Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-07	Generator Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-07	Generator Room	Transite Pipe	Piping	Asbestos	Not Sampled	ACM Assumed	3 M	Good	Transite Piping is present as a rain water leader.
B-08	West Corridor	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-08	West Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-08	West Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-09	Mechanical Room 1	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-09	Mechanical Room 1	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-09	Mechanical Room 1	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-10	Mechanical Room 2	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-10	Mechanical Room 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-10	Mechanical Room 2	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B-11	Mechanical Room 3	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-11	Mechanical Room 3	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-11	Mechanical Room 3	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-12	Mechanical Room 4	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-12	Mechanical Room 4	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-12	Mechanical Room 4	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-12	Mechanical Room 4	Transite Pipe	Piping	Asbestos	Not Sampled	ACM Assumed	8 M	Good	Transite Piping is present as a rain water leader.
B-13	Mechanical Room 5	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-13	Mechanical Room 5	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-13	Mechanical Room 5	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-14	West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-14	West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-14	West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-15	Bell Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-15	Bell Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-15	Bell Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-15	Bell Room	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
B-16	Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-16	Storage Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-16	Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-17	Mail Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-17	Mail Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-17	Mail Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-18	Lunch Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-18	Lunch Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-18	Lunch Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-19	South Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-19	South Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-19	South Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-20	Elevator Lobby	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
B-20	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
B-20	Elevator Lobby	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
B-21	Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-21	Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-22	Parking Area	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-22	Parking Area	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-22	Parking Area	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-22	Parking Area	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
B-23	Mechanical Room 6	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
B-23	Mechanical Room 6	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
B-23	Mechanical Room 6	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
B-23	Mechanical Room 6	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
1-01	Main Lobby and Corridors	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-01	Main Lobby and Corridors	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
1-01	Main Lobby and Corridors	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0017A-C	None Detected	N/A	N/A	
1-01	Main Lobby and Corridors	Sprayed Fireproofing	Structure	Asbestos	2012-0001A-G	None Detected	N/A	N/A	
1-02	Community Services offices	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-02	Community Services offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-02	Community Services offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
1-03	Exit Corridor	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-03	Exit Corridor	Granite	Walls	N/A	N/A	N/A	N/A	N/A	
1-03	Exit Corridor	Steel	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-04	North West Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
1-04	North West Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
1-04	North West Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
1-05	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-05	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-05	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-06	Corporate Communications Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
1-06	Corporate Communications Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-06	Corporate Communications Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
1-07	CHF Offices	None							NAR
1-08	North Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
1-08	North Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
1-08	North Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-09	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-09	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-09	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-10	Emergency Exit	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
1-10	Emergency Exit	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
1-10	Emergency Exit	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-11	Storage Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
1-11	Storage Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-11	Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-12	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-12	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-12	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-13	Entrance Corridor	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-13	Entrance Corridor	Granite	Walls	N/A	N/A	N/A	N/A	N/A	
1-13	Entrance Corridor	Steel	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-14	Front Desk and Front Offices	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-14	Front Desk and Front Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-14	Front Desk and Front Offices	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-15	Elevator Lobby	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
1-15	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
1-15	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-16	Museum Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
1-16	Museum Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-16	Museum Area	Steel	Ceiling	N/A	N/A	N/A	N/A	N/A	
1-16	Museum Area	Sprayed Fireproofing	Structure	Asbestos	Sampled 2012 - 0001A-G	None Detected			
1-17	Museum Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
1-17	Museum Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0015A-C	None Detected	N/A	N/A	
1-17	Museum Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
1-18	South Exit Corridor	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
1-18	South Exit Corridor	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
1-18	South Exit Corridor	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-02	Auditorium	None							NAR
2-03	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-03	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-03	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-03	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	*No Access above Ceiling
2-04	Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
2-04	Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-04	Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-05	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
2-05	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-05	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-06	Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
2-06	Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-06	Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-07	Janitors Closets	None	Floor	N/A	N/A	N/A	N/A	N/A	
2-07	Janitors Closets	None	Walls	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
2-07	Janitors Closets	None	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-08	Trials Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-08	Trials Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-08	Trials Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-08	Trials Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-08	Trials Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-09	C&T Project Team Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-09	C&T Project Team Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-09	C&T Project Team Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-09	C&T Project Team Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-09	C&T Project Team Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-10	Occupational Health and Safety Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-10	Occupational Health and Safety Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-10	Occupational Health and Safety Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-10	Occupational Health and Safety Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-10	Occupational Health and Safety Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-11	Staff Kitchen	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0025A-C	None Detected	N/A	N/A	VFT-03, 12" x 12" White with black streaks
2-11	Staff Kitchen	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-11	Staff Kitchen	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0022A-C	None Detected	N/A	N/A	ACT 02, 2' x 4' Random dimples and pinholes.
2-11	Staff Kitchen	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-11	Staff Kitchen	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-11	Employment Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-12	Employment Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-12	Employment Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0022A-C	None Detected	N/A	N/A	ACT 02, 2' x 4' Random dimples and pinholes.
2-12	Employment Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-12	Employment Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-12	Employment Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-13	Corporate Communication Office Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-13	Corporate Communication Office Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-13	Corporate Communication Office Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0022A-C	None Detected	N/A	N/A	ACT 02, 2' x 4' Random dimples and pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
2-13	Corporate Communication Office Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-13	Corporate Communication Office Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-14	Corporate Communication Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-14	Corporate Communication Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-14	Corporate Communication Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
2-14	Corporate Communication Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-14	Corporate Communication Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-14	Corporate Communication Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-15	Corporate Communication Office Area 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-15	Corporate Communication Office Area 2	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	Dated 2010	ACM Assumed	100 sf	Good	ACT 03 - 2" x 4" Deep random flecks and pinholes.
2-15	Corporate Communication Office Area 2	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-15	Corporate Communication Office Area 2	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-16	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
2-16	Janitor Closets	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-16	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-17	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
2-17	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-17	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-18	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
2-18	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-18	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-19	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
2-19	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-19	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-20	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
2-20	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-20	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-21	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-21	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-21	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
2-21	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	*No Access above Ceiling
2-22	P.E.O Office	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0025A-C	None Detected	N/A	N/A	VFT-03, 12" x 12" White with black streaks
2-22	P.E.O Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-22	P.E.O Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-22	P.E.O Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-22	P.E.O Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-23	Staff Room	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0029A-C	None Detected	N/A	N/A	VFT-04, 12" x 12" beige white and grey
2-23	Staff Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-23	Staff Room	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-23	Staff Room	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-23	Staff Room	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-24	Occupational Health and Safety Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-24	Occupational Health and Safety Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-24	Occupational Health and Safety Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-24	Occupational Health and Safety Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-24	Occupational Health and Safety Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-25	Document Services Section	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
2-25	Document Services Section	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-25	Document Services Section	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
2-25	Document Services Section	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
2-25	Document Services Section	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
2-26	Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
2-26	Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
2-26	Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
2-27	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
2-27	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
2-27	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
3-01	Elevator Lobby	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0014A-C	None Detected	N/A	N/A	
3-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
3-02	Purchasing Support	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-02	Purchasing Support	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-02	Purchasing Support	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-02	Purchasing Support	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-02	Purchasing Support	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-03	Stairwell	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
3-03	Stairwell	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
3-03	Stairwell	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-04	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-04	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-04	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
3-05	Office Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-05	Office Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-05	Office Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-05	Office Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-05	Office Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-06	Staff Area	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0029A-C	None Detected	N/A	N/A	VFT-04, 12" x 12" beige white and grey
3-06	Staff Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-06	Staff Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-06	Staff Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-06	Staff Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-07	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
3-07	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
3-07	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-08	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-08	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
3-08	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-09	Squad Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-09	Squad Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-09	Squad Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
3-09	Squad Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-09	Squad Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-10	Staff Area	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0028A-C	None Detected	N/A	N/A	VFT-05, 12" x 12" grey with white and black smears
3-10	Staff Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-10	Staff Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-10	Staff Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-10	Staff Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-11	Central Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-11	Central Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-11	Central Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-11	Central Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
3-12	Sexual Assault Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-12	Sexual Assault Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-12	Sexual Assault Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-12	Sexual Assault Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-12	Sexual Assault Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-13	Sexual Assault Squad Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-13	Sexual Assault Squad Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-13	Sexual Assault Squad Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-13	Sexual Assault Squad Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-13	Sexual Assault Squad Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-14	Office Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-14	Office Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-14	Office Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-14	Office Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-14	Office Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-15	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-15	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
3-15	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-16	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
3-16	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
3-16	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-17	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-17	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-17	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
3-18	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
3-18	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
3-18	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-19	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-19	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-19	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
3-20	Fraud Squad Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-20	Fraud Squad Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-20	Fraud Squad Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-20	Fraud Squad Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-20	Fraud Squad Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-21	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
3-21	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
3-21	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-22	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
3-22	Mechanical Closets	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
3-22	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
3-22	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
3-22	Mechanical Closets	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-22	Mechanical Closets	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-23	Fraud Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-23	Fraud Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-23	Fraud Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-23	Fraud Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-23	Fraud Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
3-24	Fraud Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-24	Fraud Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-24	Fraud Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-24	Fraud Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-24	Fraud Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-25	Vacant Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-25	Vacant Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-25	Vacant Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-25	Vacant Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-25	Vacant Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-26	D.E.T Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-26	D.E.T Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-26	D.E.T Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-26	D.E.T Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-26	D.E.T Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-27	Fraud Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-27	Fraud Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-27	Fraud Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-27	Fraud Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-27	Fraud Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-28	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
3-28	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-28	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
3-29	S.A.S. Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-29	S.A.S. Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-29	S.A.S. Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-29	S.A.S. Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-29	S.A.S. Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-30	T.E.D. Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-30	T.E.D. Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
3-30	T.E.D. Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
3-30	T.E.D. Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
3-30	T.E.D. Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
3-31	Conference Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
3-31	Conference Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	
3-31	Conference Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0013A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-02	Records Entrance	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-02	Records Entrance	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-02	Records Entrance	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-02	Records Entrance	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-02	Records Entrance	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-03	Open Office Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-03	Open Office Area	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-03	Open Office Area	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-03	Open Office Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-03	Open Office Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-04	Record Management	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-04	Record Management	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-04	Record Management	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-04	Record Management	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-04	Record Management	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-05	Office 1	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-05	Office 1	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-05	Office 1	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-05	Office 1	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-05	Office 1	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-06	Office 2	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
4-06	Office 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-06	Office 2	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-06	Office 2	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-06	Office 2	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-07	Office 3	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-07	Office 3	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-07	Office 3	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-07	Office 3	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-07	Office 3	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-08	Office 4	None							NAR
4-09	Record Storage 1	None							NAR
4-10	Record storage 2	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-10	Record storage 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-10	Record storage 2	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-10	Record Storage 2	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-10	Record Storage 2	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-11	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-11	Mechanical Closets	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
4-11	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-11	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
4-12	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-12	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
4-12	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-13	Record storage 2								NAR
4-14	Records Storage 3	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-14	Records Storage 3	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-14	Records Storage 3	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-14	Records Storage 3	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-14	Records Storage 3	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-15	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
4-15	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-15	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-16	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-16	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
4-16	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-17	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
4-17	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-17	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-18	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-18	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
4-18	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-19	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
4-19	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
4-19	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-20	Record Management Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
4-20	Record Management Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-20	Record Management Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
4-20	Record Management Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
4-20	Record Management Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
4-21	Cafeteria	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
4-21	Cafeteria	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-21	Cafeteria	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0020A-C	None Detected	N/A	N/A	ACT 05 - 2' x 4' small random fleck and hole.
4-21	Cafeteria	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-21	Cafeteria	Sprayed Fireproofing	Structure	Asbestos	Sampled 2012 - 0001A-G	None Detected	N/A	N/A	
4-22	Shared Senior Officers Office	None							NAR
4-23	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
4-23	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
4-23	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-24	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-24	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
4-24	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
4-25	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
4-25	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	
4-25	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0012A-C	None Detected	N/A	N/A	*No Access above Ceiling
4-26	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
4-26	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
4-26	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
5-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
5-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	*No Access above Ceiling
5-02	Office Area	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
5-02	Office Area	Drywall Joint Compound (DJC)	Walls	N/A	2013-A0011A-C	None Detected	N/A	N/A	
5-02	Office Area	Acoustic Ceiling Tiles (ACT)	Ceiling	N/A	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
5-02	Office Area	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
5-02	Office Area	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
5-03	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
5-03	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
5-03	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
5-04	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
5-04	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-04	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	*No Access above Ceiling
5-05	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
5-05	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
5-05	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
5-06	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
5-06	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-06	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
5-06	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-07	Office Area 2	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
5-07	Office Area 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
5-07	Office Area 2	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
5-07	Office Area 2	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
5-07	Office Area 2	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
5-08	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
5-08	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
5-08	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
5-09	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
5-09	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-09	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	*No Access above Ceiling
5-10	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
5-10	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
5-10	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
5-11	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
5-11	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-11	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	*No Access above Ceiling
5-12	Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
5-12	Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0011A-C	None Detected	N/A	N/A	
5-12	Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
5-12	Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
5-12	Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
5-13	Restricted Area	None							NAR
6-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-02	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-02	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-02	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-02	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-03	Traffic Services Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-03	Traffic Services Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
6-03	Traffic Services Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-03	Traffic Services Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-03	Traffic Services Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-04	Communication Support	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-04	Communication Support	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-04	Communication Support	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-04	Communication Support	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-04	Communication Support	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-05	Comm. Services Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-05	Comm. Services Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-05	Comm. Services Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-05	Comm. Services Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-05	Comm. Services Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-06	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-06	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
6-06	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
6-07	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-07	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-07	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-08	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
6-08	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
6-08	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
6-09	Trial Preparation Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-09	Trial Preparation Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-09	Trial Preparation Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-09	Trial Preparation Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-09	Trial Preparation Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-10	Traffic Services Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-10	Traffic Services Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-10	Traffic Services Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
6-11	Traffic Services Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-11	Traffic Services Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-11	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-11	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-11	Office	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-12	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-12	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-12	Office	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-13	Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-13	Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-13	Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-13	Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-13	Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-14	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-14	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-14	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-14	Corridor	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-14	Corridor	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-15	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-15	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-15	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-16	Forensic Identification Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-16	Forensic Identification Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-16	Forensic Identification Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-16	Forensic Identification Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-16	Forensic Identification Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-17	Forensic Identification Private Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-17	Forensic Identification Private Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-17	Forensic Identification Private Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-17	Forensic Identification Private Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
6-17	Forensic Identification Private Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-18	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-18	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-18	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-19	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
6-19	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
6-19	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
6-20	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-20	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-20	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	*No Access above Ceiling
6-21	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
6-21	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
6-21	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
6-22	Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-22	Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-22	Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-22	Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-22	Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-23	Offices 2	None	Floor	N/A	N/A	N/A	N/A	N/A	
6-23	Offices 2	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-23	Offices 2	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-23	Offices 2	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-23	Offices 2	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-24	Offices 3	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-24	Offices 3	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	
6-24	Offices 3	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-24	Offices 3	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-24	Offices 3	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
6-25	Offices 4	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
6-25	Offices 4	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0010A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
6-25	Offices 4	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
6-25	Offices 4	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
6-25	Offices 4	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-02	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-02	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-02	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-02	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-03	Board Room	None							NAR
7-04	Police Services Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-04	Police Services Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-04	Police Services Office	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-05	Police Services Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-05	Police Services Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-05	Police Services Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-05	Police Services Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
7-05	Police Services Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-06	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-06	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
7-06	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-07	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-07	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-07	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-08	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
7-08	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
7-08	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-09	International Affairs Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-09	International Affairs Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
7-09	International Affairs Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-09	International Affairs Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
7-09	International Affairs Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-10	Conference Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-10	Conference Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-10	Conference Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-11	Corporate Planning Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-11	Corporate Planning Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-11	Corporate Planning Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-11	Corporate Planning Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
7-11	Corporate Planning Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-12	Corporate Planning Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-12	Corporate Planning Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-12	Corporate Planning Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-12	Corporate Planning Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
7-12	Corporate Planning Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-13	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
7-13	Mechanical Closets	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
7-13	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-13	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
7-14	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
7-14	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
7-14	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-15	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-15	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-15	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-16	Chief's Staff	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-16	Chief's Staff	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-16	Chief's Staff	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
7-16	Chief's Staff	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
7-16	Chief's Staff	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
7-17	Operational Support Command	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-17	Operational Support Command	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-17	Operational Support Command	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-18	Admin Support Command	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-18	Admin Support Command	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-18	Admin Support Command	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-19	Detective Support Command	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-19	Detective Support Command	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-19	Detective Support Command	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-20	Executive Support Command	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-20	Executive Support Command	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-20	Executive Support Command	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-21	Chief of Police	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-21	Chief of Police	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-21	Chief of Police	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-22	Chief's Staff Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
7-22	Chief's Staff Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-22	Chief's Staff Office	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-23	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-23	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
7-23	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-24	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-24	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	
7-24	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
7-25	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
7-25	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
7-25	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
7-26	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
7-26	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
7-26	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0009A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-02	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-02	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-02	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-02	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-03	Fraud Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-03	Fraud Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-03	Fraud Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-03	Fraud Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-03	Fraud Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-04	Fraud Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-04	Fraud Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-04	Fraud Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-04	Fraud Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-04	Fraud Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-05	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-05	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
8-05	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-06	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-06	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-06	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-07	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
8-07	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
8-07	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-08	Customer Service	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-08	Customer Service	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-08	Customer Service	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
8-08	Customer Service	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-08	Customer Service	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-09	Community Service	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-09	Community Service	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-09	Community Service	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-09	Community Service	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-09	Community Service	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-10	Conference Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-10	Conference Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-10	Conference Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-11	Community Services offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-11	Community Services offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-11	Community Services offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-11	Community Services offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-11	Community Services offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-12	Community Services offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-12	Community Services offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-12	Community Services offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2" x 4" Textured with pinholes.
8-12	Community Services offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-12	Community Services offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-13	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
8-13	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
8-13	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-14	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
8-14	Mechanical Closets	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
8-14	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-14	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
8-15	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-15	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-15	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
8-16	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-16	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-16	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-17	International Audit	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-17	International Audit	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-17	International Audit	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
8-17	International Audit	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-17	International Audit	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-18	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-18	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-18	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-19	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
8-19	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
8-19	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-20	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-20	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-20	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	*No Access above Ceiling
8-21	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
8-21	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
8-21	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
8-22	Field Commander	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-22	Field Commander	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-22	Field Commander	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
8-22	Field Commander	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-22	Field Commander	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
8-23	Legal Services	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
8-23	Legal Services	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0008A-C	None Detected	N/A	N/A	
8-23	Legal Services	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
8-23	Legal Services	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
8-23	Legal Services	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
9-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	*No Access above Ceiling
9-02	Human Resources Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-02	Human Resources Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-02	Human Resources Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-02	Human Resources Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-02	Human Resources Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-03	Employment Equity	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-03	Employment Equity	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-03	Employment Equity	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-03	Employment Equity	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-03	Employment Equity	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-04	Human Resources Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-04	Human Resources Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-04	Human Resources Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-04	Human Resources Office	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-04	Human Resources Office	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-05	Labour Relations	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-05	Labour Relations	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-05	Labour Relations	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-05	Labour Relations	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-05	Labour Relations	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-06	Security Information	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-06	Security Information	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-06	Security Information	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-06	Security Information	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-06	Security Information	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-07	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
9-07	Mechanical Closets	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
9-07	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
9-07	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
9-08	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
9-08	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
9-08	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
9-09	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
9-09	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-09	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	*No Access above Ceiling
9-10	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-10	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-10	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-10	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	*No Access above Ceiling
9-11	Conference Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-11	Conference Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-11	Conference Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	*No Access above Ceiling
9-12	Freedom of Information	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-12	Freedom of Information	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-12	Freedom of Information	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-12	Freedom of Information	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-12	Freedom of Information	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
9-13	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
9-13	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
9-13	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
9-14	Freedom of Information	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
9-14	Freedom of Information	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0007A-C	None Detected	N/A	N/A	
9-14	Freedom of Information	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
9-14	Freedom of Information	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
9-14	Freedom of Information	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
10-01	Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-01	Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
10-01	Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	*No Access above Ceiling
10-02	Elevator Mechanical Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
10-02	Elevator Mechanical Room	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
10-02	Elevator Mechanical Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
10-03	Offices	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-03	Offices	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-03	Offices	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-03	Offices	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
10-03	Offices	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
10-04	F&A System	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-04	F&A System	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-04	F&A System	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-04	F&A System	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
10-04	F&A System	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
10-05	Budget Control	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-05	Budget Control	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-05	Budget Control	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-05	Budget Control	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
10-05	Budget Control	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
10-06	Restructuring Implementation	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-06	Restructuring Implementation	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-06	Restructuring Implementation	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-06	Restructuring Implementation	Uninsulated	Pipe	N/A	N/A	N/A	N/A	N/A	
10-06	Restructuring Implementation	Uninsulated	Duct	N/A	N/A	N/A	N/A	N/A	
10-07	Purchasing Support	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-07	Purchasing Support	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-07	Purchasing Support	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-08	Facilities Management	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-08	Facilities Management	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-08	Facilities Management	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
10-09	Finance Admin	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-09	Finance Admin	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-09	Finance Admin	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-10	Restructuring Implementation	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-10	Restructuring Implementation	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-10	Restructuring Implementation	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-11	Washrooms	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
10-11	Washrooms	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-11	Washrooms	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-12	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-12	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-12	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	*No Access above Ceiling
10-13	Mechanical Closets	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
10-13	Mechanical Closets	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
10-13	Mechanical Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
10-13	Mechanical Closets	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
10-14	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
10-14	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
10-14	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
10-15	Conference Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-15	Conference Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-15	Conference Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-16	Financial Management	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-16	Financial Management	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-16	Financial Management	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
10-17	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
10-17	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0006A-C	None Detected	N/A	N/A	
10-17	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-01	Elevator Lobby and Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-01	Elevator Lobby and Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
11-01	Elevator Lobby and Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	*No Access above Ceiling
11-02	Storage Room	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0028A-C	None Detected	N/A	N/A	VFT-05, 12" x 12" grey with white and black smears
11-02	Storage Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-02	Storage Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
11-03	Telecom Services	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-03	Telecom Services	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-03	Telecom Services	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-04	Police Liaison	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-04	Police Liaison	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-04	Police Liaison	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-05	Police Liaison office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-05	Police Liaison office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-05	Police Liaison office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-06	Office	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0030A-C	None Detected	N/A	N/A	VFT-06, 12" x 12" Blue with white streaks
11-06	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-06	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-07	Office	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0030A-C	None Detected	N/A	N/A	VFT-06, 12" x 12" Blue with white streaks
11-07	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-07	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-08	Janitor Closets	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
11-08	Janitor Closets	Ceramic Tile	Walls	N/A	N/A	N/A	N/A	N/A	
11-08	Janitor Closets	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
11-09	Communication Services	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0030A-C	None Detected	N/A	N/A	VFT-06, 12" x 12" Blue with white streaks
11-09	Communication Services	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-09	Communication Services	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-10	Video Services	Vinyl Sheet Flooring (VSF)	Floor	Asbestos	2013-A0026A-C	None Detected	N/A	N/A	VSF-01, Beige
11-10	Video Services	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-10	Video Services	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-11	Video Services Storage	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-11	Video Services Storage	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
11-11	Video Services Storage	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-12	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-12	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-12	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-12	Office	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-13	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-13	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-13	Corridor	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-14	Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-14	Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-14	Room	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-15	Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-15	Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-15	Room	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-16	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-16	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-16	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-17	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-17	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-17	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-18	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-18	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-18	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-19	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
11-19	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-19	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
11-20	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
11-20	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-20	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	*No Access above Ceiling
11-21	Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
11-21	Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-21	Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0005A-C	None Detected	N/A	N/A	
11-22	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
11-22	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
11-22	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
11-23	Mechanical Closet	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
11-23	Mechanical Closet	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
11-23	Mechanical Closet	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
11-23	Mechanical Closet	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
11-24	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
11-24	Stairs	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
11-24	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
12-01	Communication Support	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-01	Communication Support	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-01	Communication Support	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-02	Storage	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-02	Storage	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-02	Storage	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-03	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-03	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-03	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-04	Storage	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-04	Storage	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-04	Storage	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-05	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-05	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-05	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-06	Unknown	None							NAR
12-07	Unknown	None							NAR
12-08	Office	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	

APPENDIX V - SURVEY FORM

Location Number	Location Name	Potential Hazardous Materials	Building System	Potential Hazard	Sample ID	Analytical Result	Quantity	Condition	Notes/Required Action
12-08	Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-08	Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-09	Telecom Services	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0030A-C	None Detected	N/A	N/A	VFT-06, 12" x 12" Blue with white streaks
12-09	Telecom Services	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-09	Telecom Services	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-10	Telecom Services Office	Vinyl Floor Tiles (VFT)	Floor	Asbestos	2013-A0030A-C	None Detected	N/A	N/A	VFT-06, 12" x 12" Blue with white streaks
12-10	Telecom Services Office	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-10	Telecom Services Office	Acoustic Ceiling Tiles (ACT)	Ceiling	Asbestos	2013-A0019A-C	None Detected	N/A	N/A	ACT 01 - 2' x 4' Textured with pinholes.
12-11	Janitor Room	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
12-11	Janitor Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-11	Janitor Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-12	Women's Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
12-12	Women's Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-12	Women's Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-13	Men's Washroom	Ceramic Tile	Floor	N/A	N/A	N/A	N/A	N/A	
12-13	Men's Washroom	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-13	Men's Washroom	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-14	Mechanical Closet	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
12-14	Mechanical Closet	Concrete Block	Walls	N/A	N/A	N/A	N/A	N/A	
12-14	Mechanical Closet	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
12-14	Mechanical Closet	Firestopping	Other	Asbestos	2015-A0032A-C	None Detected	N/A	N/A	
12-15	Corridor	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-15	Corridor	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-15	Corridor	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-16	Corridor and Elevator Lobby	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-16	Corridor and Elevator Lobby	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-16	Corridor and Elevator Lobby	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-17	Meeting Room	Carpet	Floor	N/A	N/A	N/A	N/A	N/A	
12-17	Meeting Room	Drywall Joint Compound (DJC)	Walls	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	
12-17	Meeting Room	Drywall Joint Compound (DJC)	Ceiling	Asbestos	2013-A0004A-C	None Detected	N/A	N/A	

APPENDIX V - SURVEY FORM

<i>Location Number</i>	<i>Location Name</i>	<i>Potential Hazardous Materials</i>	<i>Building System</i>	<i>Potential Hazard</i>	<i>Sample ID</i>	<i>Analytical Result</i>	<i>Quantity</i>	<i>Condition</i>	<i>Notes/Required Action</i>
12-18	Freight Elevator	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
12-18	Freight Elevator	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
12-18	Freight Elevator	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
12-19	Elevator Mechanical Room	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
12-19	Elevator Mechanical Room	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
12-19	Elevator Mechanical Room	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
12-20	Stairs	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
12-20	Stairs	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
12-20	Stairs	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
P-01	Penthouse West Side	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
P-01	Penthouse West Side	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
P-01	Penthouse West Side	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
P-01	Penthouse West Side	Parging Cement Pipe Insulation	Piping	Asbestos	2007 Assessment (Samples 10- 12)	None Detected	N/A	N/A	
P-02	Penthouse East Side	Concrete	Floor	N/A	N/A	N/A	N/A	N/A	
P-02	Penthouse East Side	Concrete	Walls	N/A	N/A	N/A	N/A	N/A	
P-02	Penthouse East Side	Concrete	Ceiling	N/A	N/A	N/A	N/A	N/A	
P-02	Penthouse East Side	Parging Cement Pipe Insulation	Piping	Asbestos	2007 Assessment (Samples 10- 12)	None Detected	N/A	N/A	