



MARK	DATE	DESCRIPTION
1	2026-03-31	ISSUED FOR 100% CD
2	2026-04-15	RE-ISSUED FOR 100% CD
3	2026-08-20	ISSUED FOR PERMIT & TENDER




The image shows two professional engineering credentials. The top one is a circular seal for a Licensed Professional Engineer (P. Eng.) in Ontario, Canada. It includes the text "LICENSED PROFESSIONAL ENGINEER", "P. ENG.", "R. I. THIBBS", and "PROVINCE OF ONTARIO" with the number "2250227". The bottom one is an octagonal seal for a Certified Engineering Technician (C. Eng. Tech.) in Ontario, Canada. It includes the text "CERTIFIED ENGINEERING TECHNICIAN", "C. ENG. TECH.", "R. I. THIBBS", and "PROVINCE OF ONTARIO" with the number "51200000".

PART PLAN GROUND FLOOR DEMOLITION PLAN ELECTRICAL

En

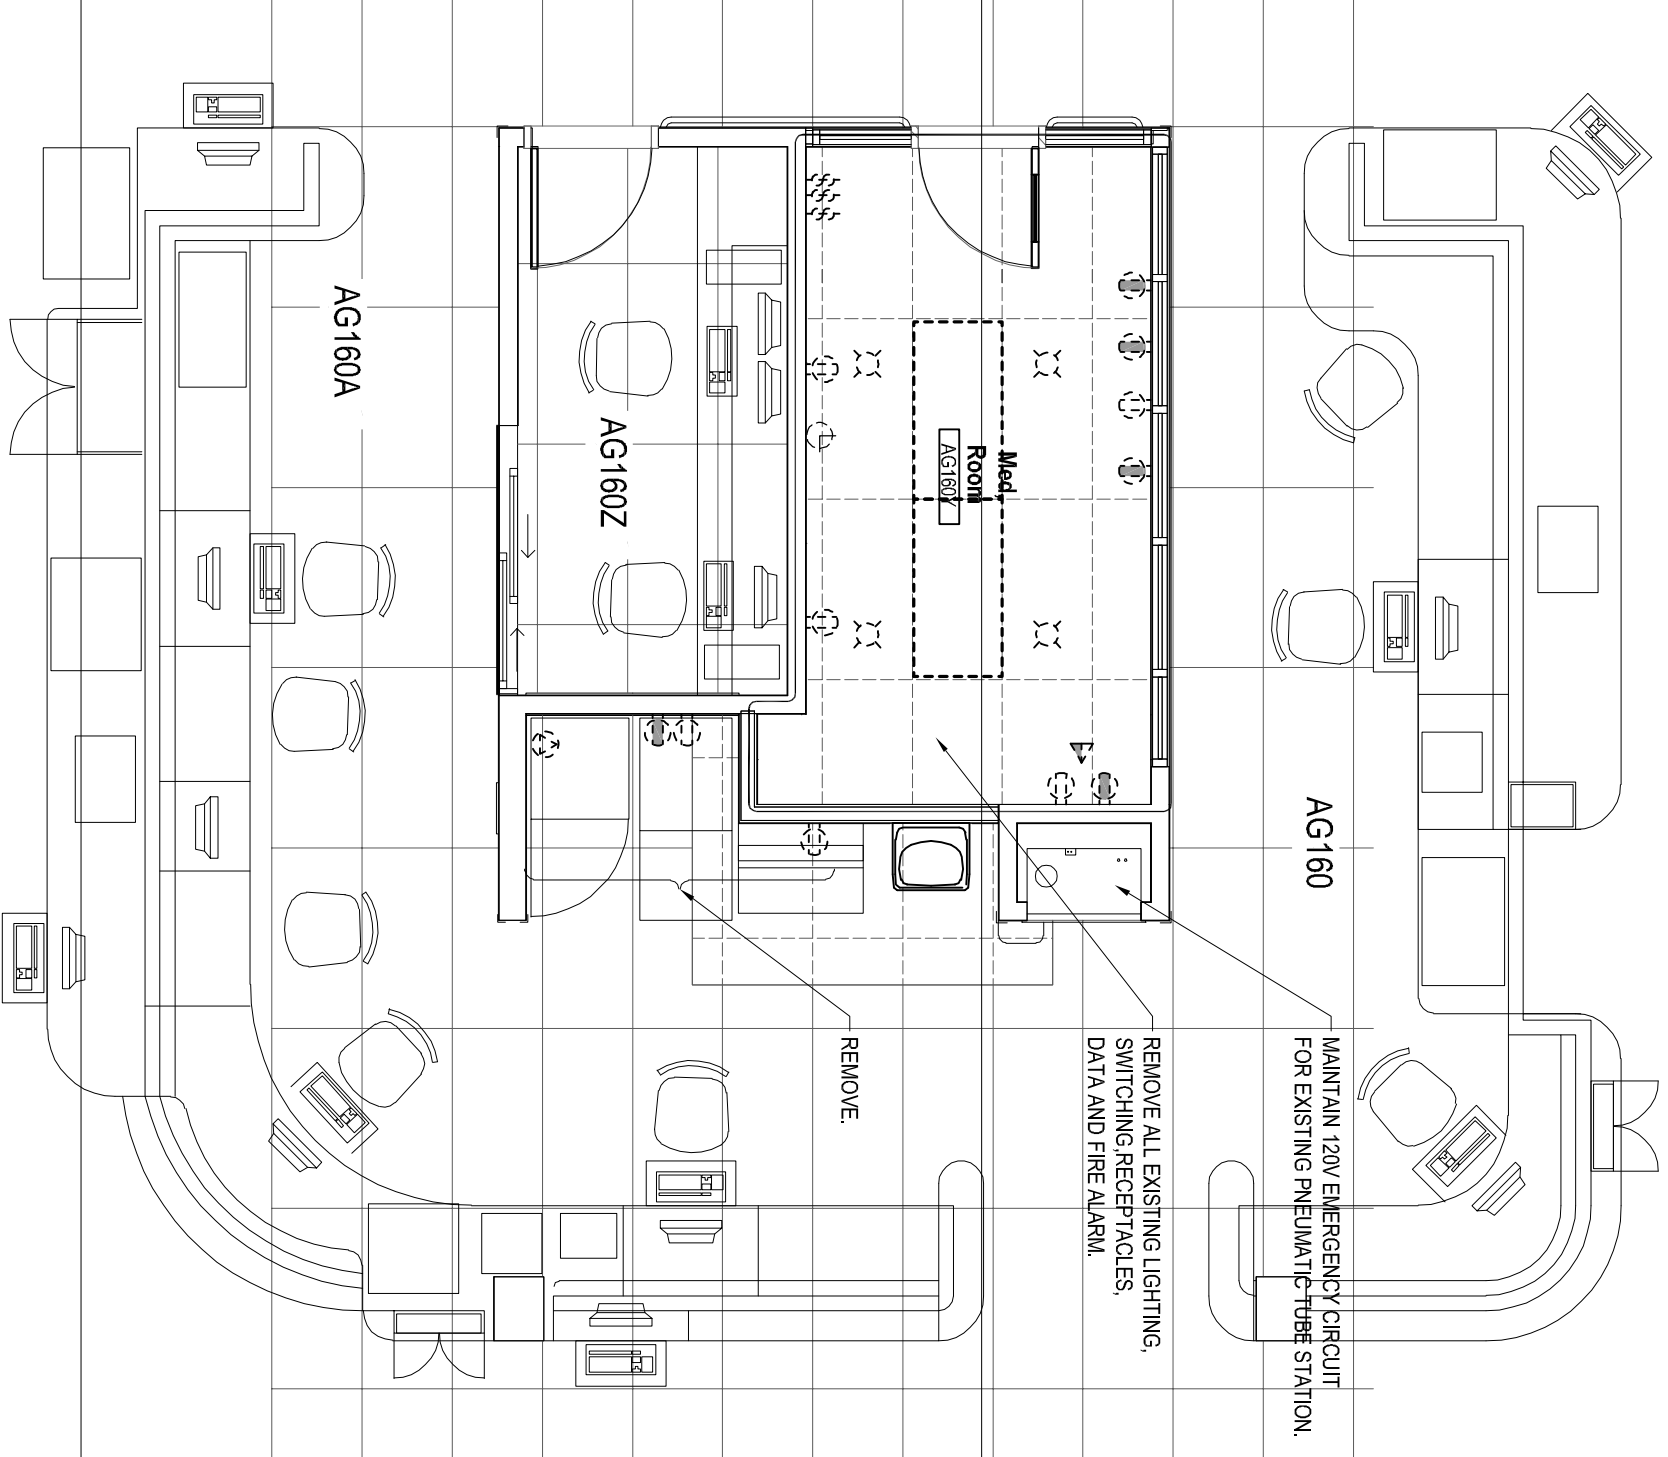

3 SECURITY AREA DEMOLITION PLAN

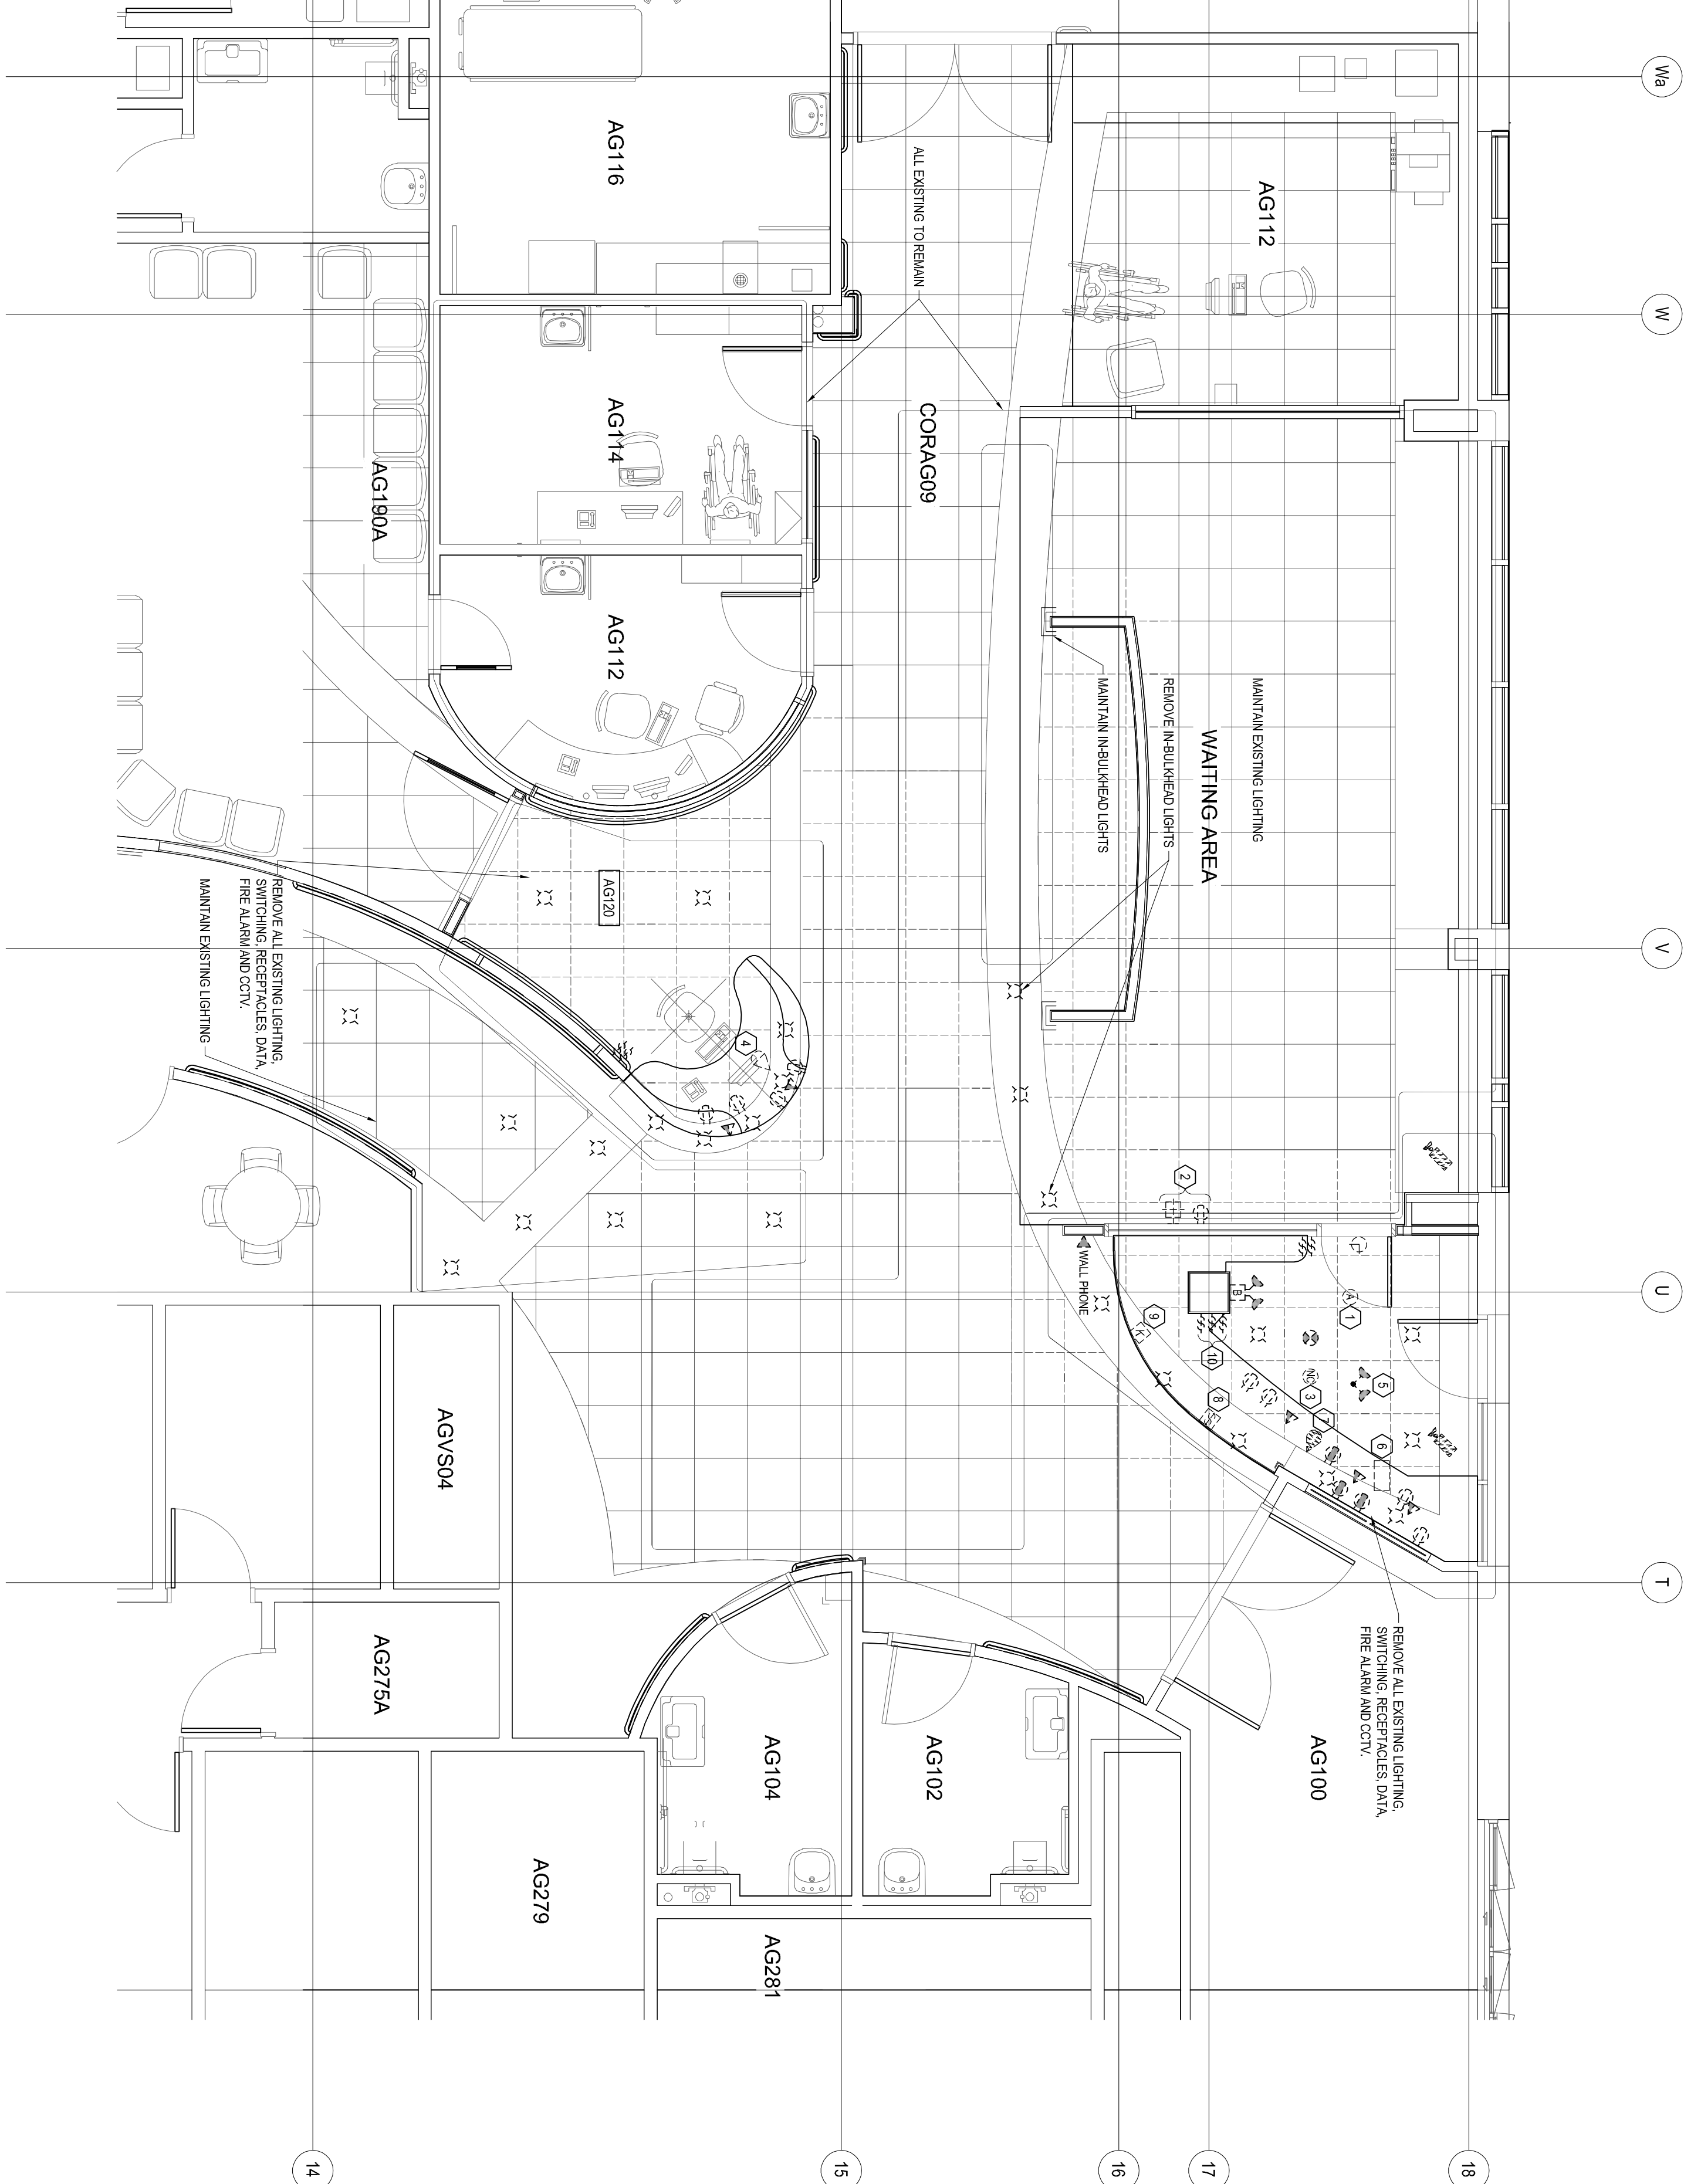

- ① EXISTING "VALANCE ROOM IS OPEN" ALARM LIGHT IS TO BE RELOCATED TO NEW SECURITY OFFICE INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW LOCATION. (SEE DWG 6-9.)
- ② EXISTING TELEVISION RECEPTACLE AND CABLE OUTLET TO BE RELOCATED. (SEE DWG 6-1, 6-9.) INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT.
- ③ EXISTING NINE-ONE-ONE SYSTEMS SERVICE TO BE RELOCATED TO NEW SECURITY OFFICE. INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW LOCATION. (SEE DWG 6-9.)
- ④ THERE IS AN EXISTING "RESTRAINTATION INTERCOM" AT THIS DESK. THAT IS TO BE RELOCATED TO NEW SECURITY DESK. (SEE DWG 6-9.) INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW LOCATION. RELOCATE EXISTING EMERGENCY LIGHT TO NEW CEILING.
- ⑤ EXISTING CIVIL MONITORS AND ZOOM PAN, TILT, CONTROLS TO BE RELOCATED TO NEW SECURITY OFFICE. INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW LOCATION. (SEE DWG 6-9.)
- ⑥ EXISTING EMERGENCY DEPARTMENT ENTRY INTERCOM STATION TO BE RELOCATED TO NEW SECURITY OFFICE. INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW SECURITY OFFICE. (SEE DWG 6-9.)
- ⑦ THERE IS AN EXISTING SWITCH AT SECURITY THAT PROVIDES MANUAL, ONE-PRESS OF THE EXTERIOR CANOPY EMERGENCY LIGHTING. SWITCH IS TO BE RELOCATED TO THE NEW SECURITY OFFICE. INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW SWITCH LOCATION. (SEE DWG 6-9.)
- ⑧ THERE IS A KEY SWITCH IN THE EXISTING SECURITY OFFICE THAT CONTROLS ALL EXISTING EMERGENCY DEPARTMENT MAGNETIC LOCKS. THIS KEY SWITCH NEEDS TO BE RELOCATED TO THE NEW SECURITY OFFICE. (SEE DWG 6-9.) INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT.
- ⑨ THERE ARE THREE EXISTING LIGHT SWITCHES CONTROLLING THE RESTROOM, CORRIDOR AND GYM HALL LIGHTS. RELOCATE SWITCHES TO NEW SECURITY OFFICE. INTERCEPT REQUIRUE. EXTEND EXISTING WIRING. IN CONDUIT. TO NEW LOCATION. (SEE DWG 6-9.)

CONTRACT OF THE SUBMITTER(S) AS SHOWN ON THE PLANS
MUST BE INCLUDED IN THE BID.
HOWEVER, RECOGNIZING THERE ARE ADDITIONAL DEMANDS REQUIRED BY THE
OWNER ON THE PLANS, THE CONTRACTOR MUST INCLUDE AN ADDITIONAL METHODS
ALLOWANCE MUST BE APPROVED/ISSUED OFF BY THE BHA CONTRACT ADMINSTRATOR

DEMOLITION OF EXISTING ELECTRICAL INSTALLATION

[illegible]

HDR ARCHITECTURE ASSOCIATES INC.
70 UNIVERSITY AVENUE,
SUITE 600

HHangus


HHangus and Associates Limited
Consulting Engineers
1175 Eglinton Avenue East, Suite 800, Toronto,
ON M3C 0P1 | hh@hagus.com | 416-463-8200

SUNNYBROOK HEALTH
SCIENCE CENTRE
EMERGENCY
DEPARTMENT
RENOVATIONS

Project Manager HDR
Project Designer HDR
Project Architect HDR
Mechanical Engineer HHA
Electrical Engineer HHA
Interior Designer HDR
Equipment Planner HDR
Wayfinding —
Drawn By Author

MARK	DATE	DESCRIPTION
1	2026-03-31	ISSUED FOR 100% CD
2	2026-04-15	RE-ISSUED FOR 100% CD
3	2026-08-20	ISSUED FOR PERMIT & TENDER




Project Number 10428557 (2250227)
Original Issue 12/19/18 -

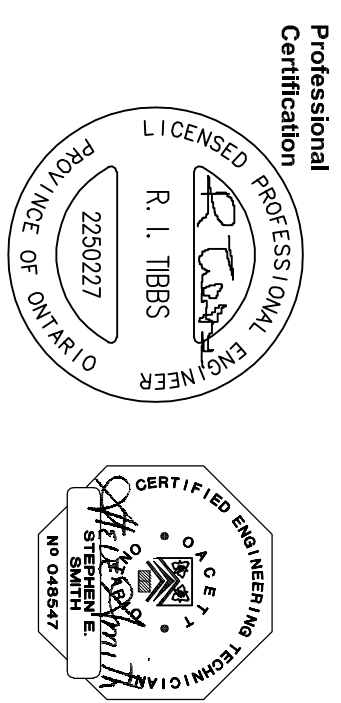

SHEET NAME
PART PLAN GROUND
FLOOR LIGHTING
PLAN
ELECTRICAL

Scale AS NOTED
Sheet Number

E-3

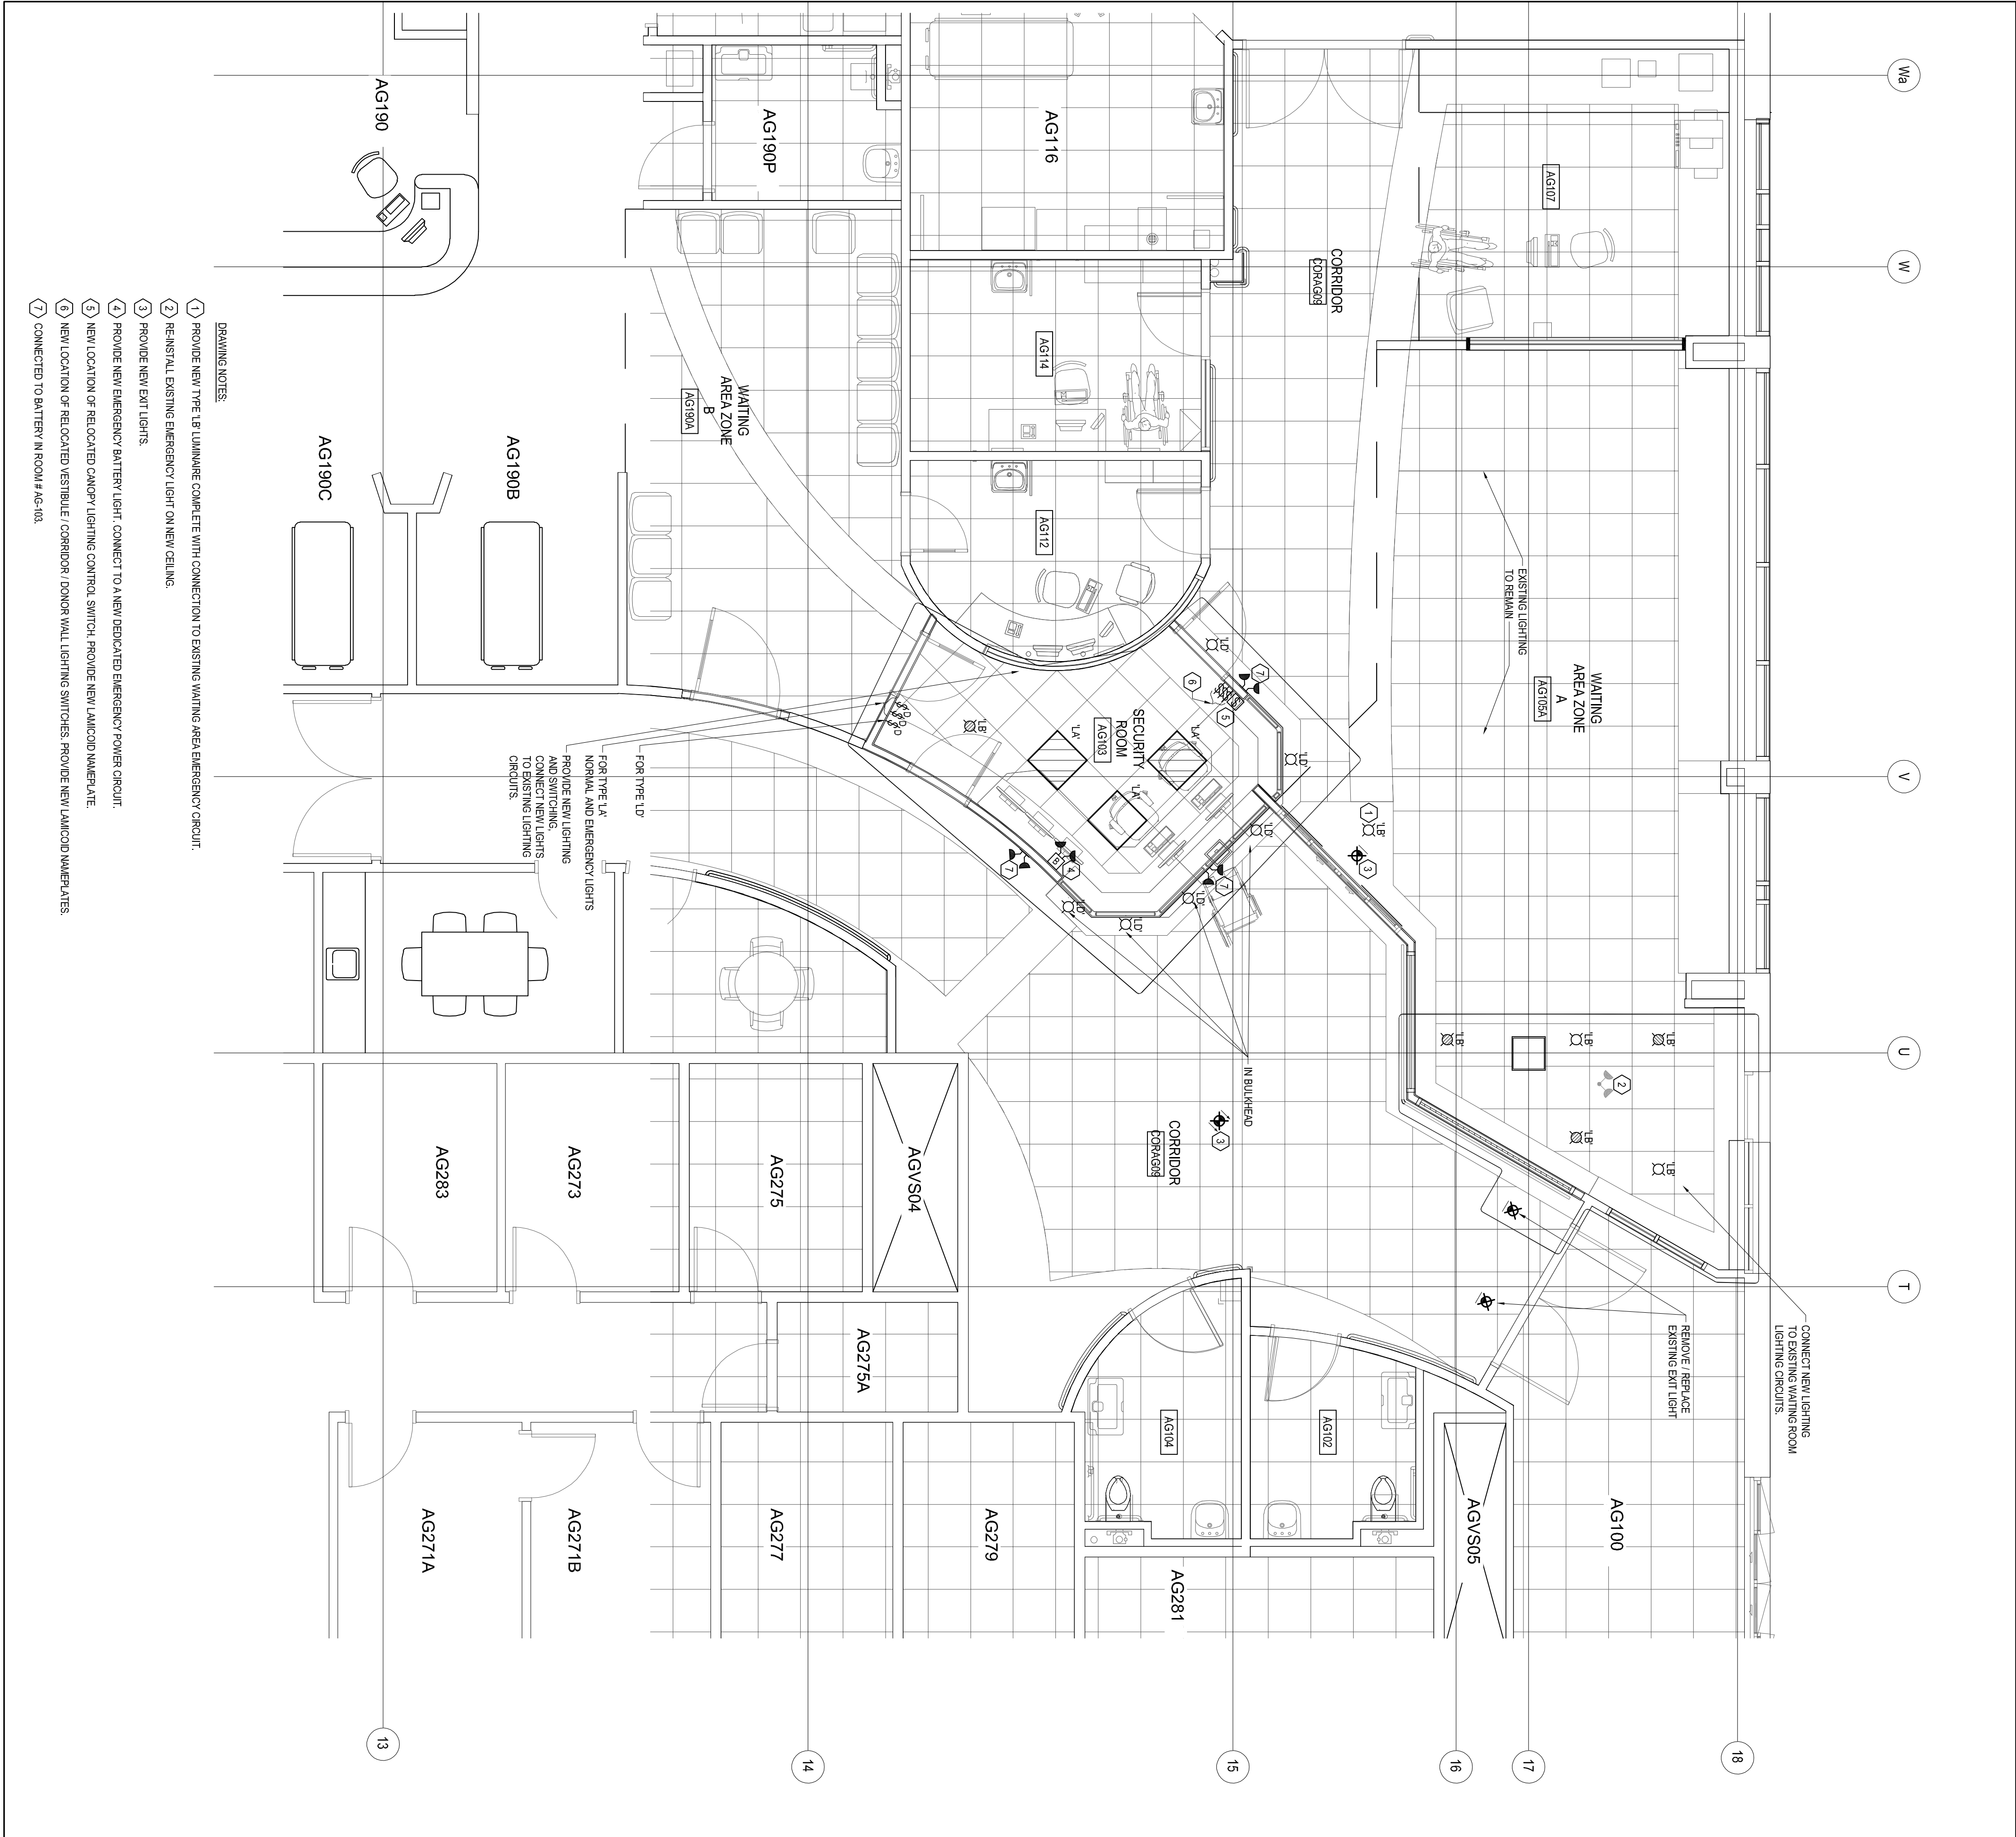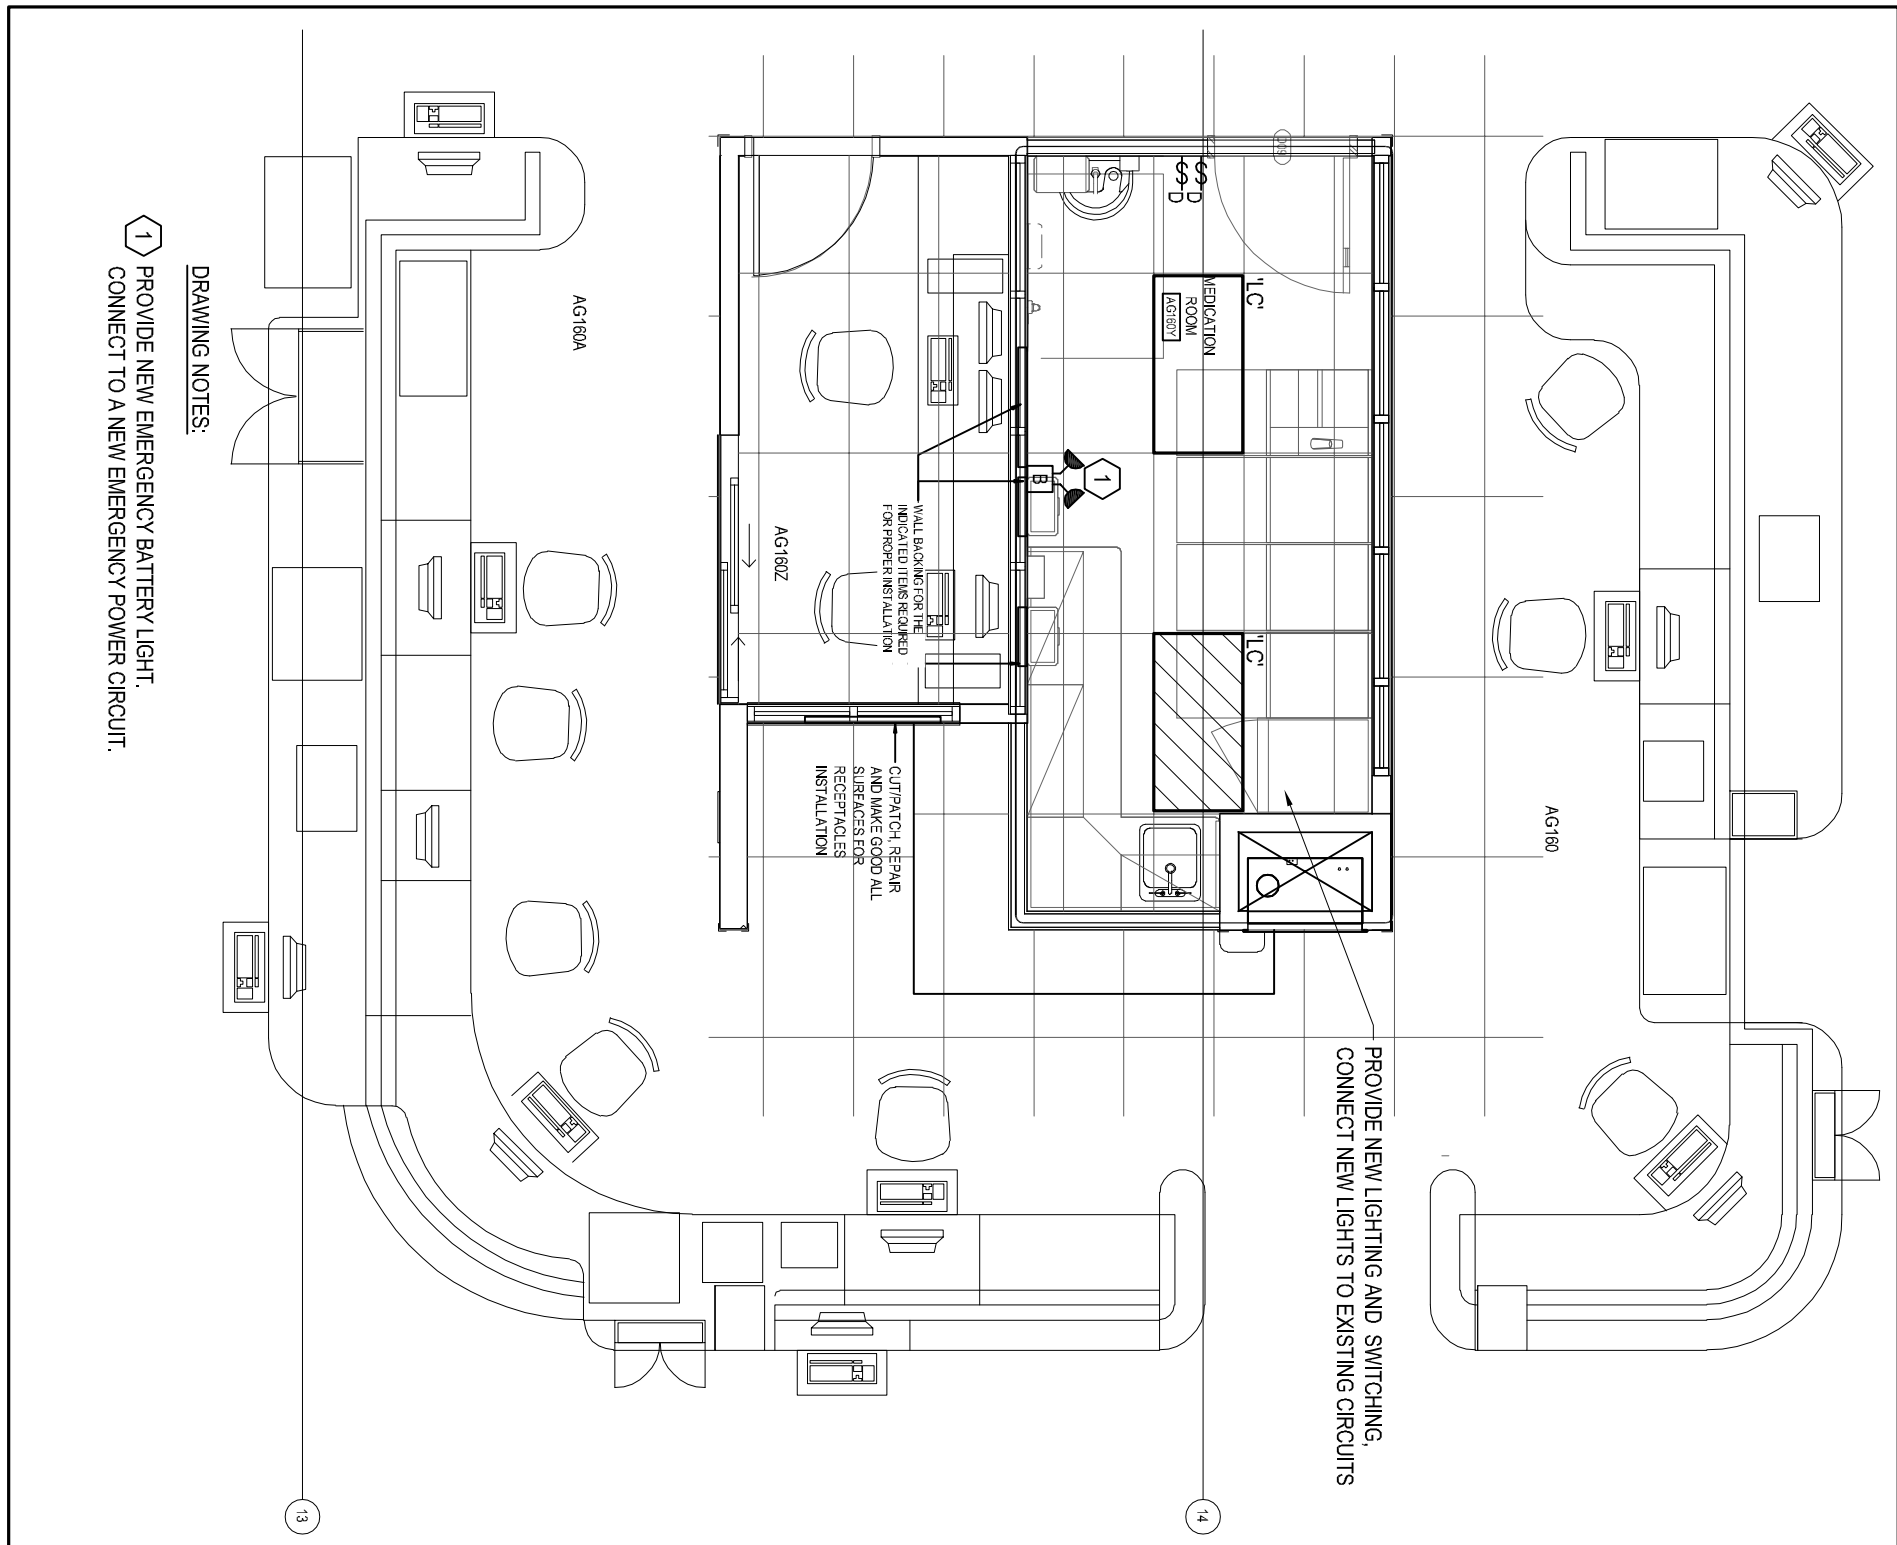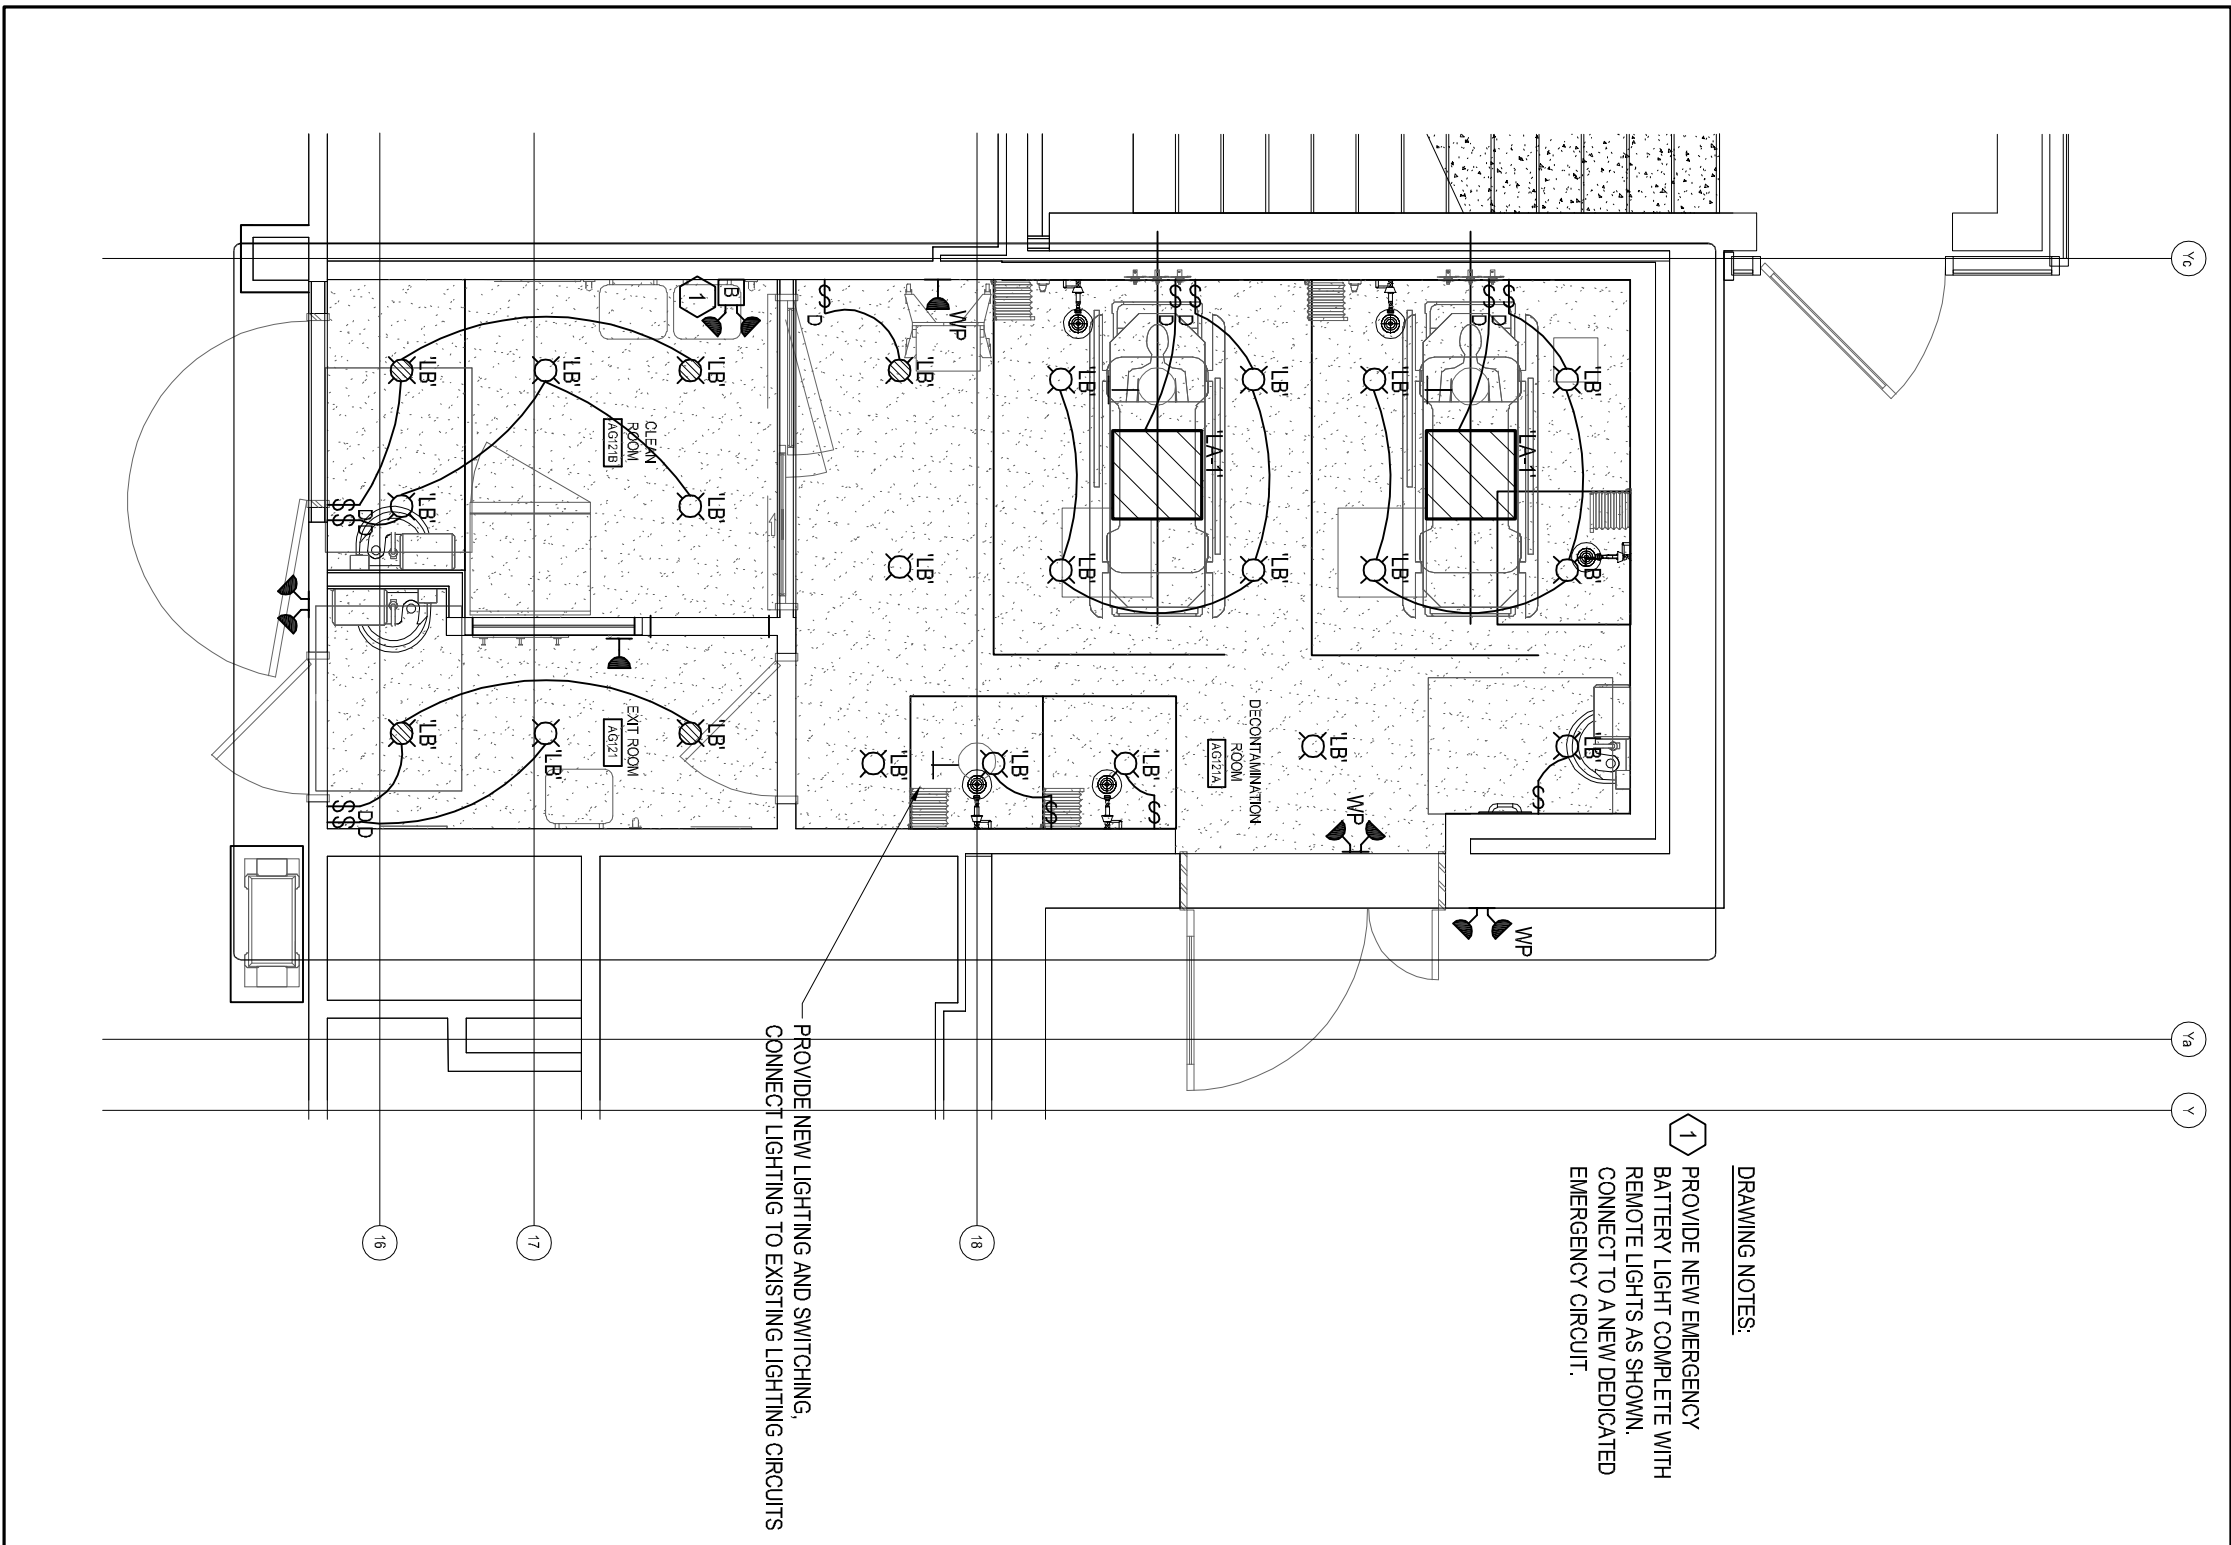

HDR ARCHITECTURE ASSOCIATES INC.
70 UNIVERSITY AVENUE,
SUITE 600

HHAngus

HH Angus and Associates Limited
Consulting Engineers
1175 Eglinton Avenue East, Suite 800, Toronto,
ON M3C 0P1 | hh@h Angus.com | 416-463-8200

SUNNYBROOK HEALTH
SCIENCE CENTRE
EMERGENCY
DEPARTMENT
RENOVATIONS


Project Manager

JDR
JDR
Project Designer
Project Architect
Mechanical Engineer
Electrical Engineer
Interior Designer
Equipment Planner
Wayfinding
Drawn By
Author

MARK	DATE	DESCRIPTION
1	2026-03-31	ISSUED FOR 100% CD
2	2026-04-15	RE-ISSUED FOR 100% CD
3	2026-08-20	ISSUED FOR PERMIT & TENDER

Project Number 10428557 (2250227)
Original Issue 12/19/18 -

Professional Certification



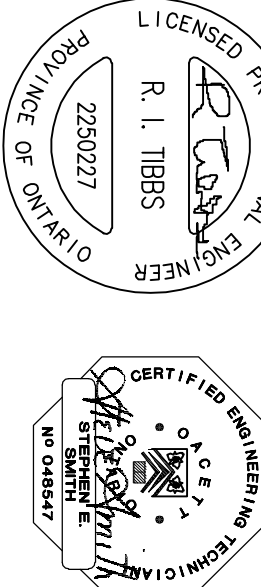


Sheet Name
PART PLAN GROUND
FLOOR SYSTEMS
PLAN
ELECTRICAL

Scale AS NOTED

Sheet Number

E-5

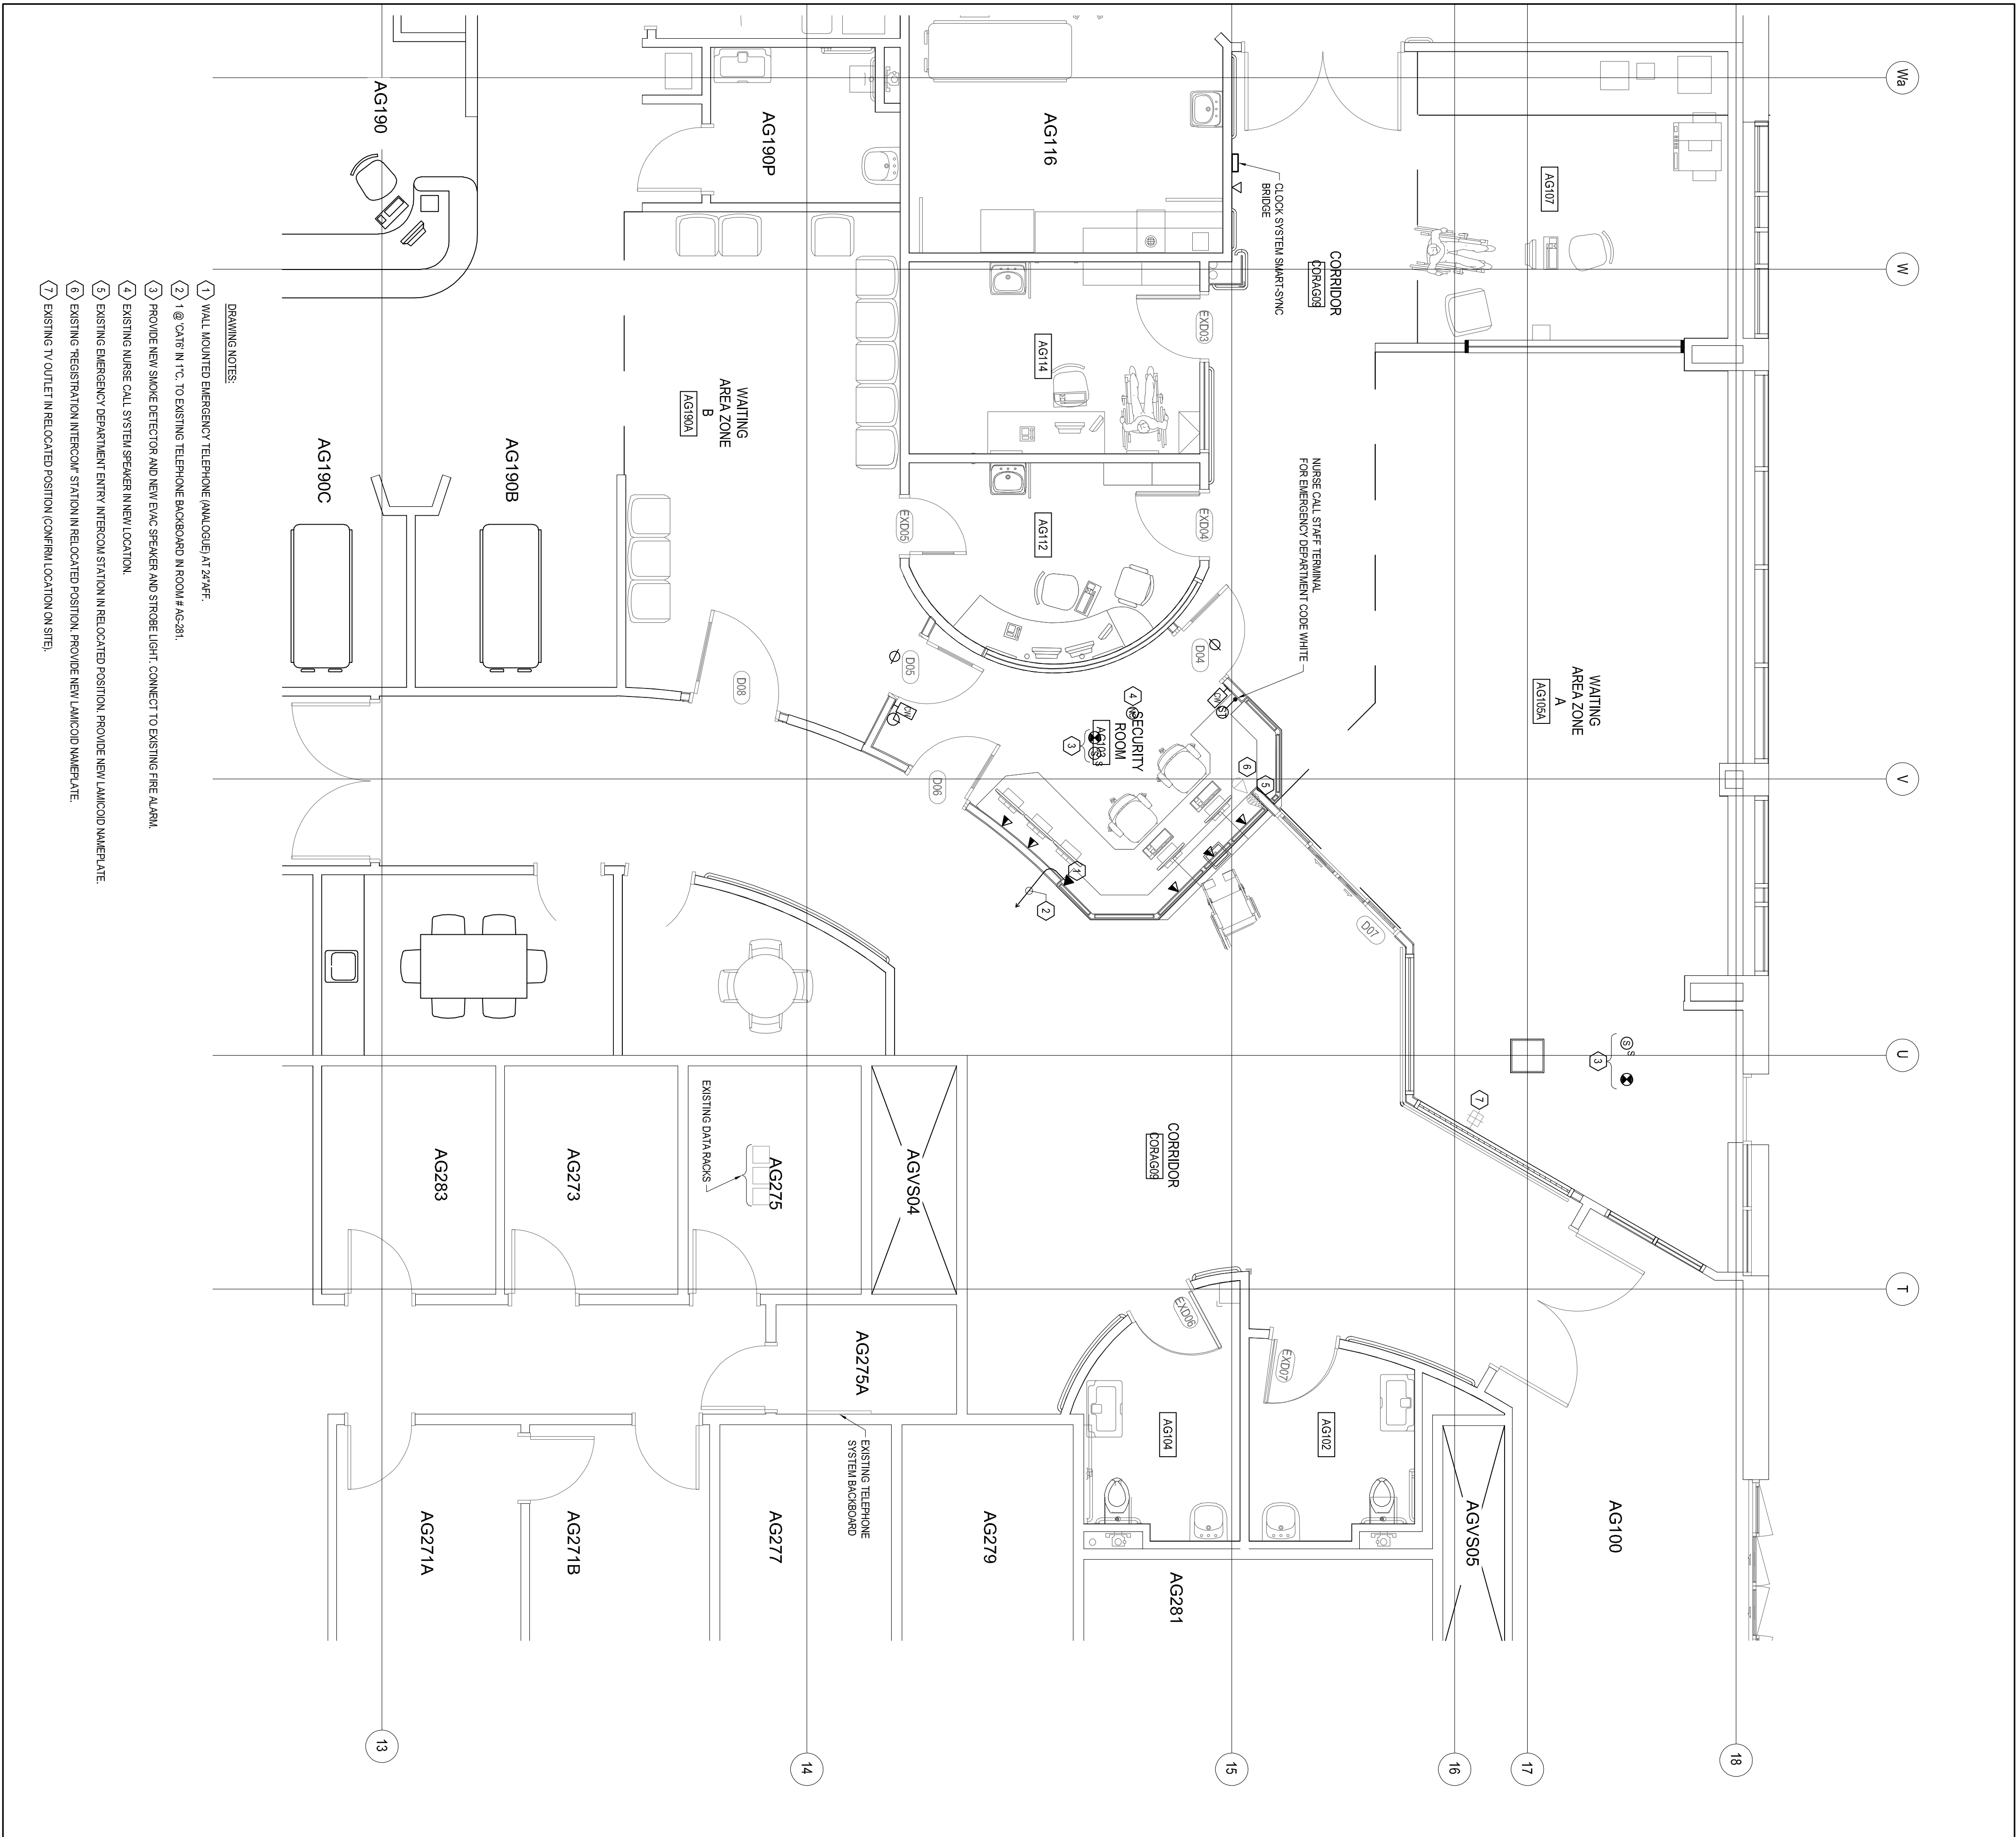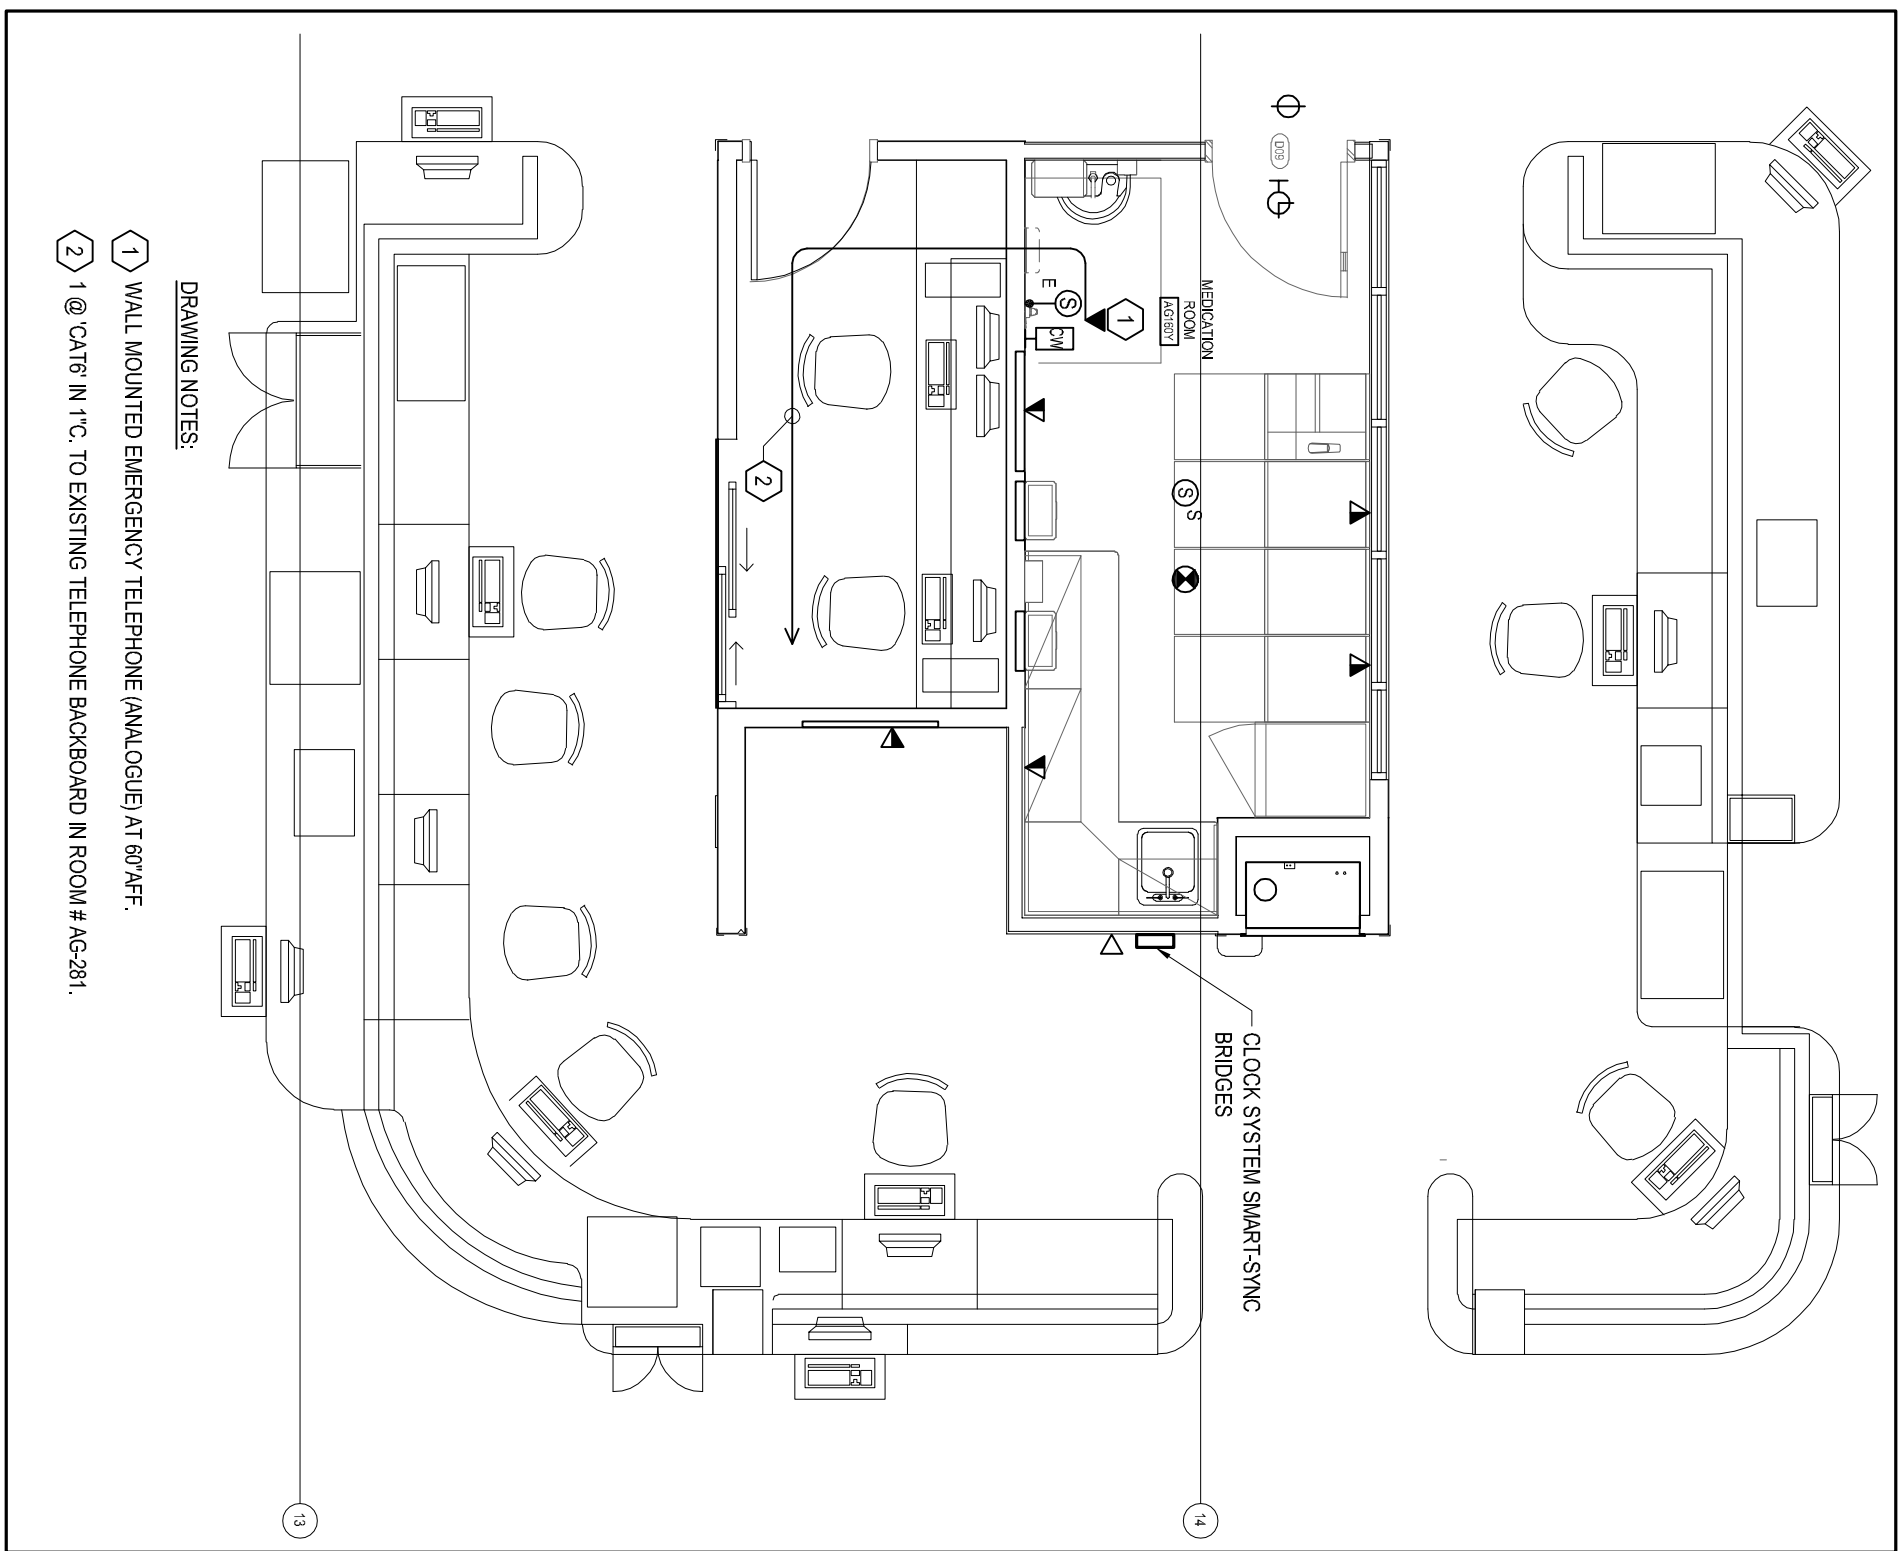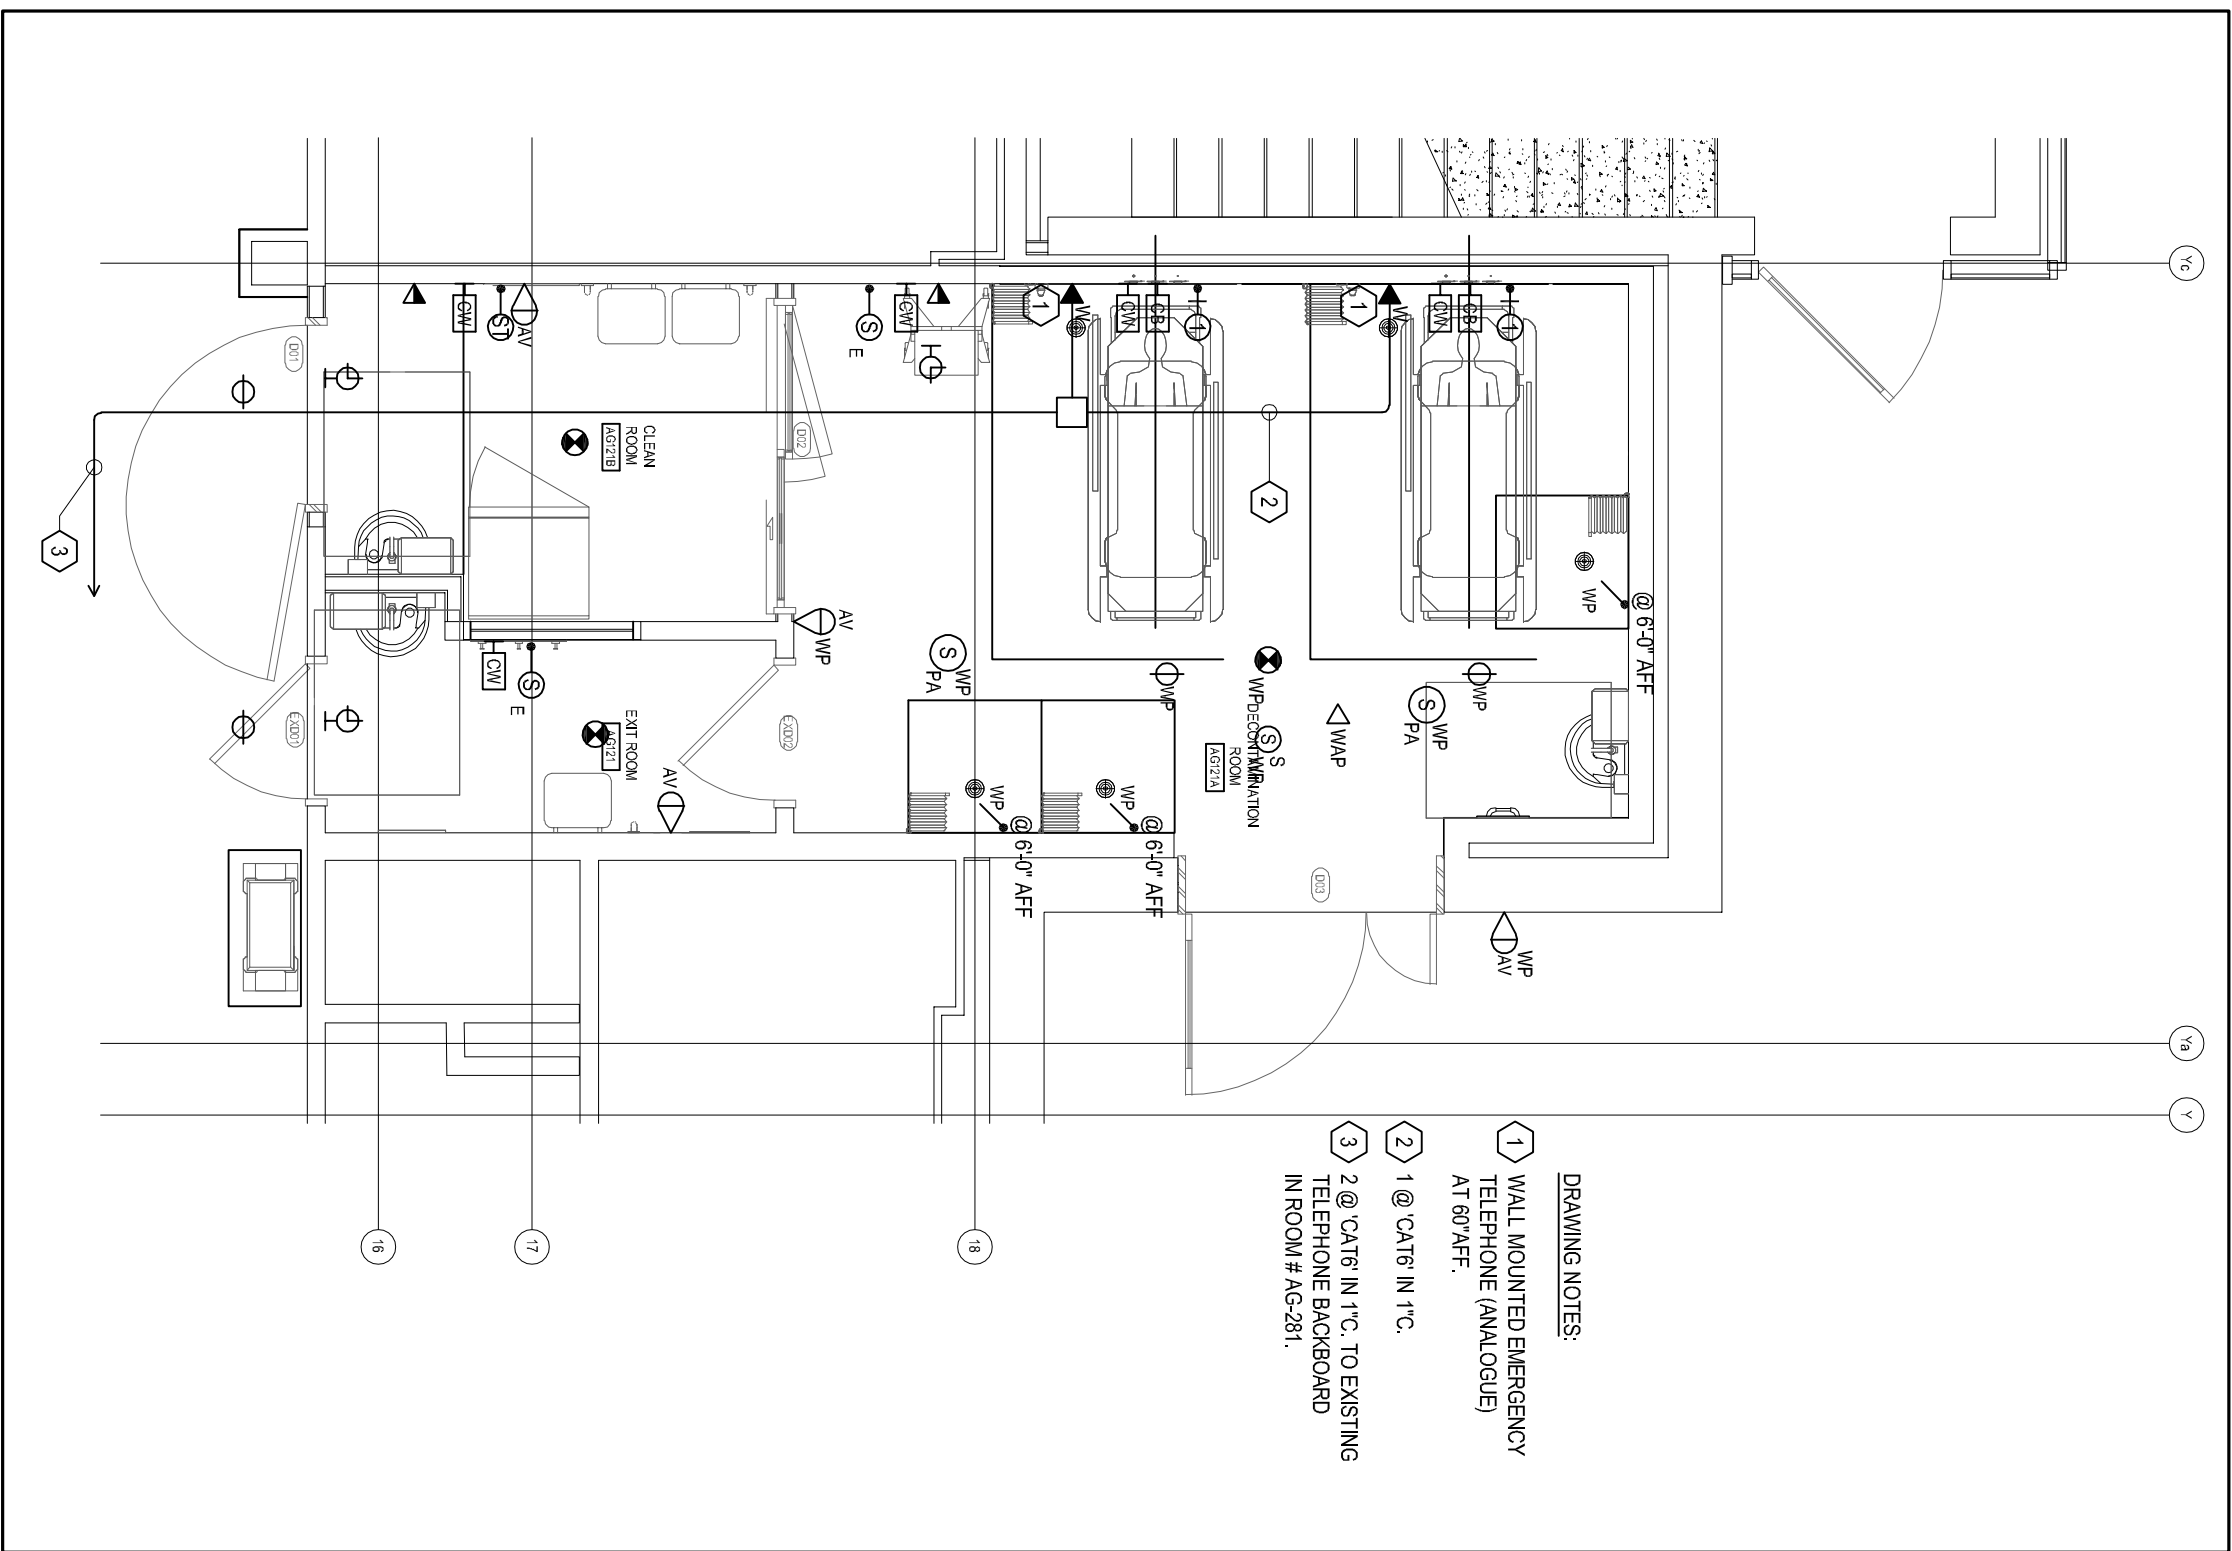

HDR ARCHITECTURE ASSOCIATES INC.
70 UNIVERSITY AVENUE,
SUITE 600

HHangus

HHangus and Associates Limited
Consulting Engineers
1175 Eglinton Avenue East, Suite 800, Toronto,
ON M3C 0G1 | hh@hangus.com | 416-443-8200

SUNNYBROOK HEALTH
SCIENCE CENTRE
EMERGENCY
DEPARTMENT
RENOVATIONS


Project Manager	HDR
Project Architect	HDR
Mechanical Engineer	HHA
Electrical Engineer	HHA
Interior Designer	HDR
Equipment Planner	HDR
Wayfinding	—
Drawn by	Author

MARK	DATE	DESCRIPTION
1	2026-03-31	ISSUED FOR 100% CD
2	2026-04-15	RE-ISSUED FOR 100% CD
3	2026-08-20	ISSUED FOR PERMIT & TENDER

Project Number 10428857 (2250227)

Original Issue 12/19/18 -

Professional

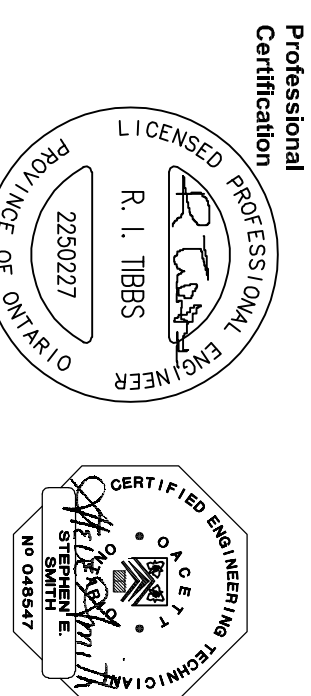


SHEET NAME
PART GROUND FLOOR
OVERALL PLAN

ELECTRICAL

Scale
AS NOTED
Sheet Number

E-7

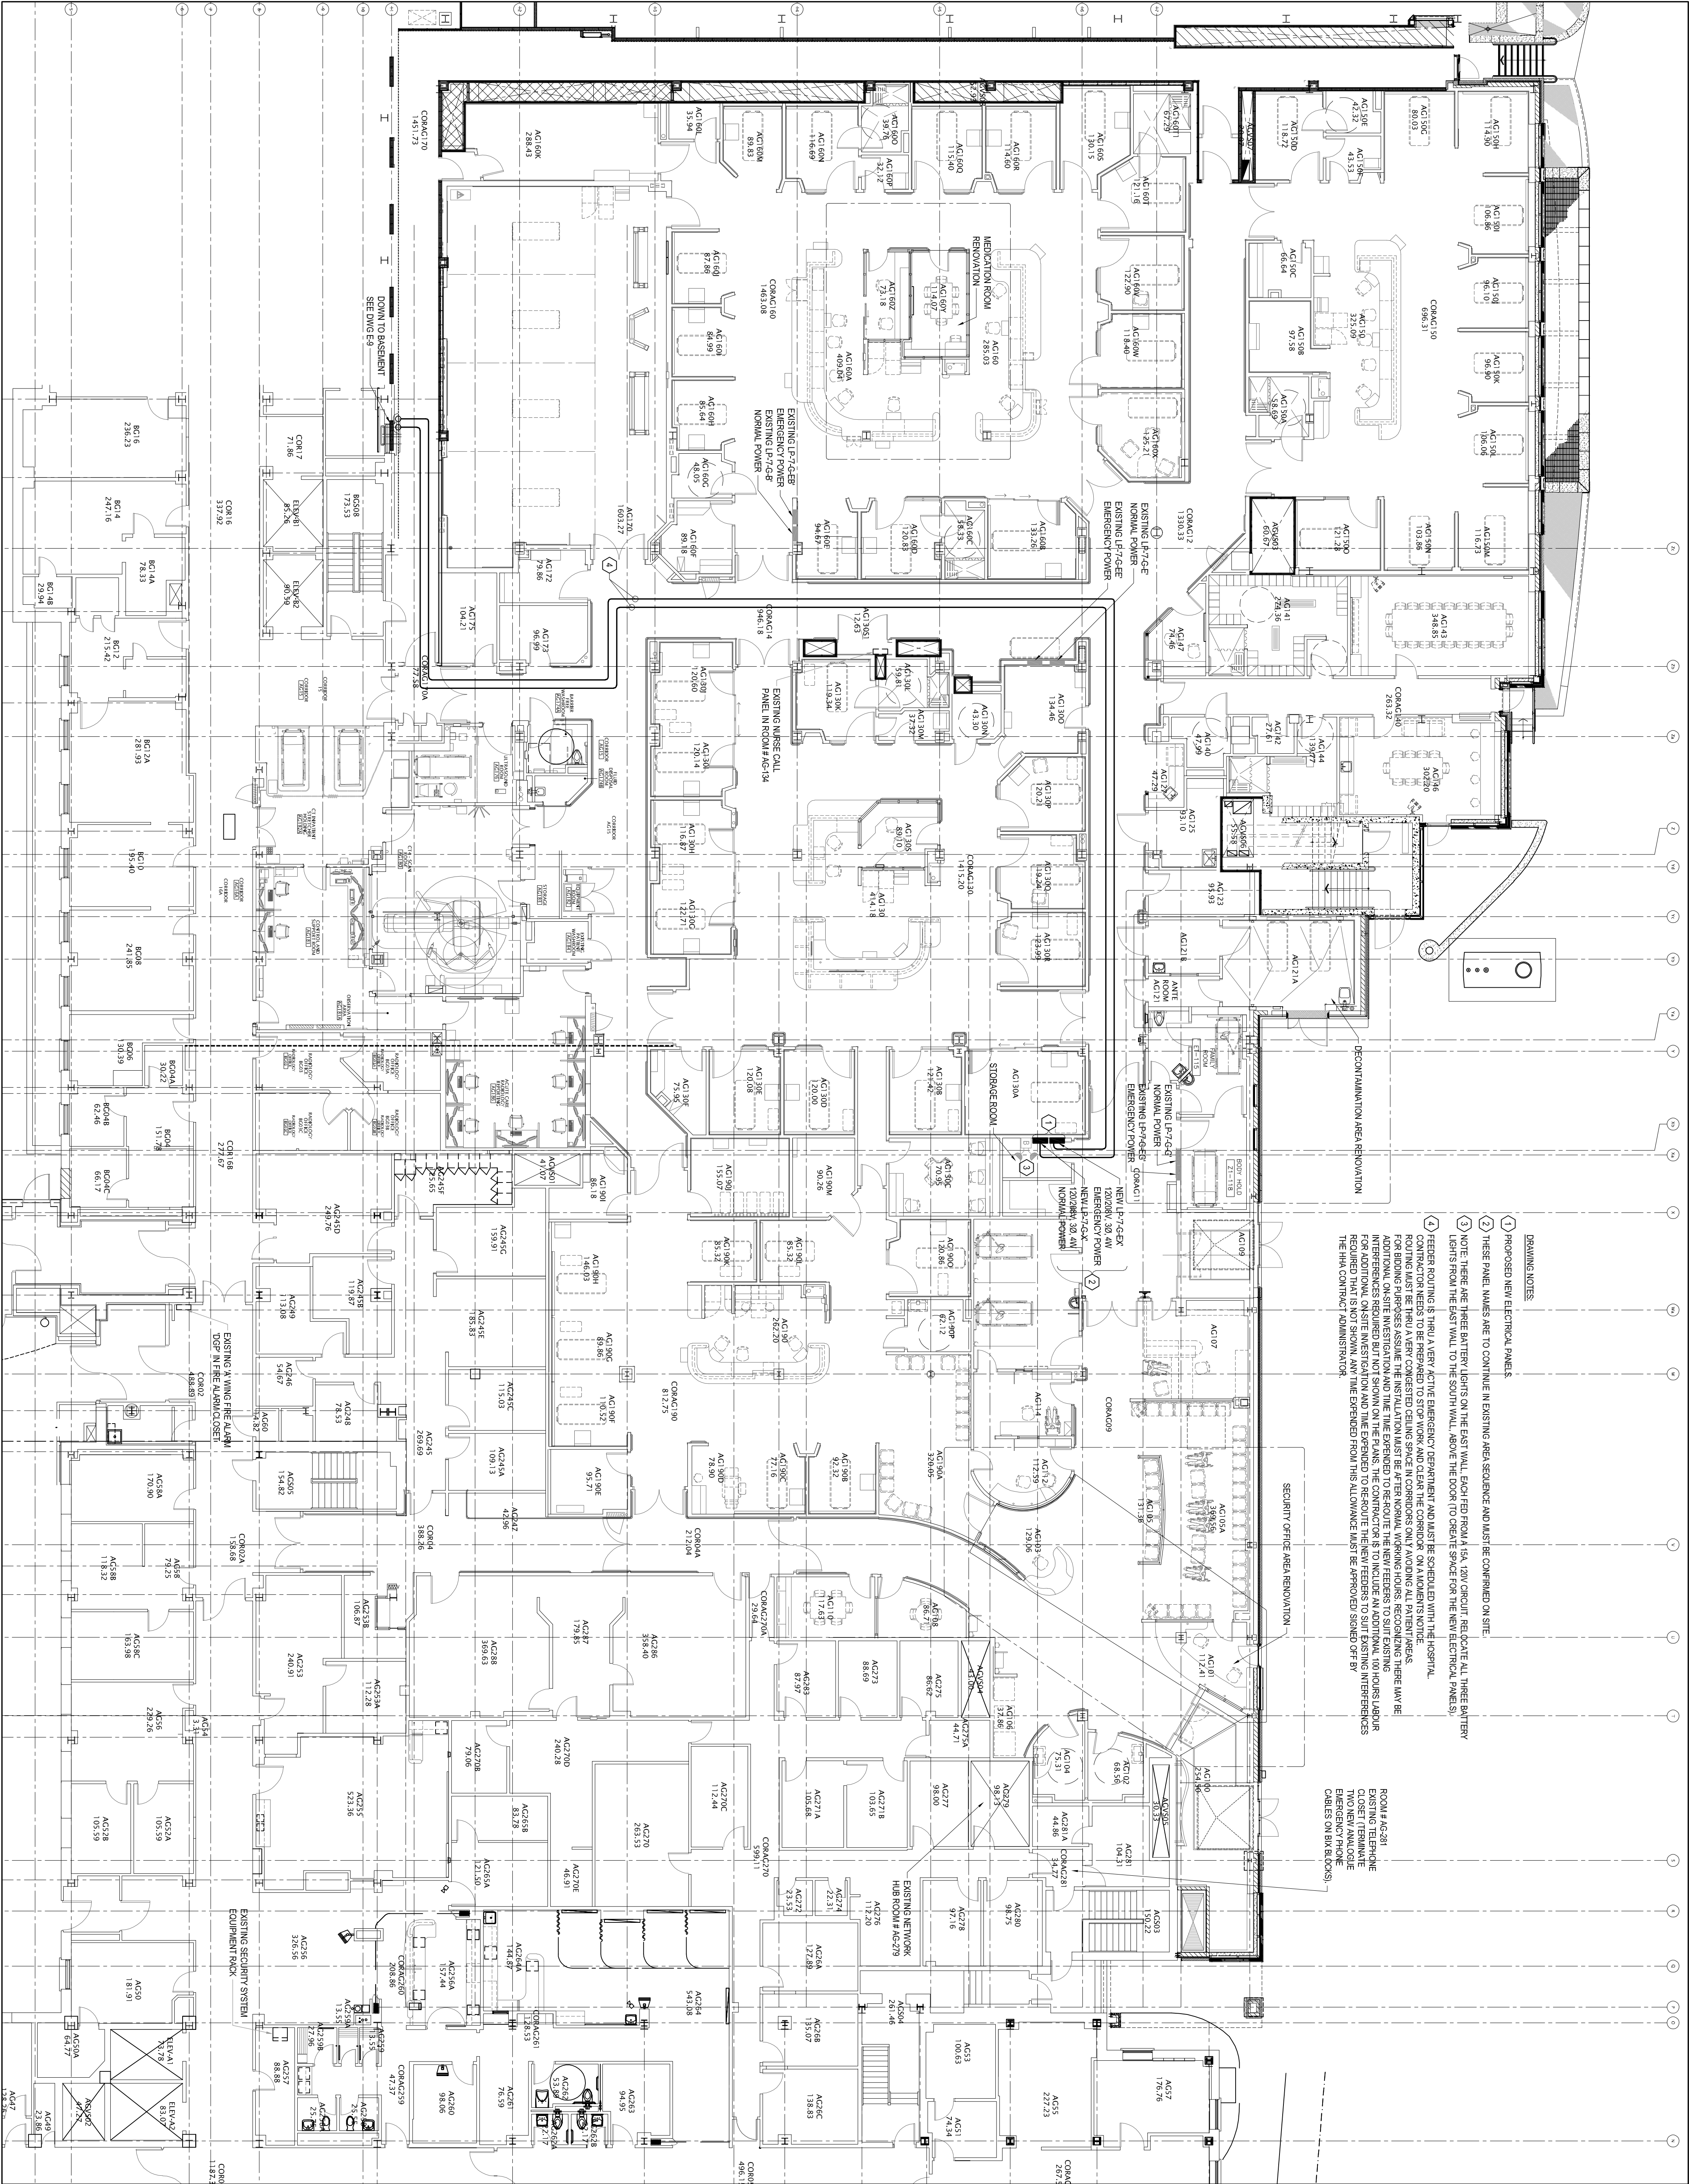

- DRAWING NOTES:
- PROPOSED NEW ELECTRICAL PANELS
 - THESE PANEL NAMES ARE TO CONTINUE IN EXISTING AREA SEQUENCE AND MUST BE CONFORMED ON SITE.
 - NOTE: THERE ARE THREE BATTERY LIGHTS ON THE EAST WALL, LOCATED FROM A 120V CIRCUIT RELOCATE ALL THREE BATTERY LIGHTS FROM THE EAST WALL TO THE SOUTH WALL, ABOVE THE DOOR TO CREATE SPACE FOR THE NEW ELECTRICAL PANELS.
 - FEEDER ROUTING IS THRU A VERY ACTIVE EMERGENCY DEPARTMENT AND MUST BE SCHEDULED WITH THE HOSPITAL. CONTRACTOR NEEDS TO BE PREPARED TO STOP WORK AND CLEAR THE CORRIDOR ON A MOMENT'S NOTICE. FOR BIDDING PURPOSES ASSUME THE INSTALLATION MUST BE AFTER NORMAL WORKING HOURS. RECOGNIZING THERE MAY BE ADDITIONAL ON-SITE INVESTIGATION AND THE TIME EXPENDED TO RE-ROUTE THE NEW FEEDERS TO SUIT EXISTING INTERFERENCES REQUIRED BUT NOT SHOWN ON THE PLANS. THE CONTRACTOR IS TO INCLUDE AN ADDITIONAL 100 HOURS LABOUR REQUIRED TO INVESTIGATE AND RE-ROUTE THE NEW FEEDERS TO SUIT EXISTING INTERFERENCES. THE HHA CONTRACT ADMINISTRATION WILL EXPEND FROM THIS ALLOWANCE AND BE APPROVED SIGNED OFF BY

